

FOUNDATION PLAN

OPTIMUM PERSONAL CARE
 1110 LAKEVIEW DRIVE
 SUGAR LAND, TX 77478

ISSUE HISTORY	
DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION
09/16/14	REVISION Δ

09/16/14

Z:\SEAL.jpg

PE BUILDINGS
 BRIDGES
 INSPECTIONS
 MARINE STRUCTURES
 CIVIL ENGINEERING &
 STRUCTURAL ENGINEERING

**PARAMOUNT
 ENGINEERING
 LLC**

7322 SOUTHWEST FREEWAY STE. 1050
 HOUSTON, TX 77074


TEL : (713) 636-9977
 FAX : (713) 888-9872
 CEL : (713) 204-1742

TBPE REGISTRATION # F-3394

DRAWN BY: E.V. H.P. CHECKED BY: M.M.

PROJ. NO.: PE12-225

SHEET: **S1A**

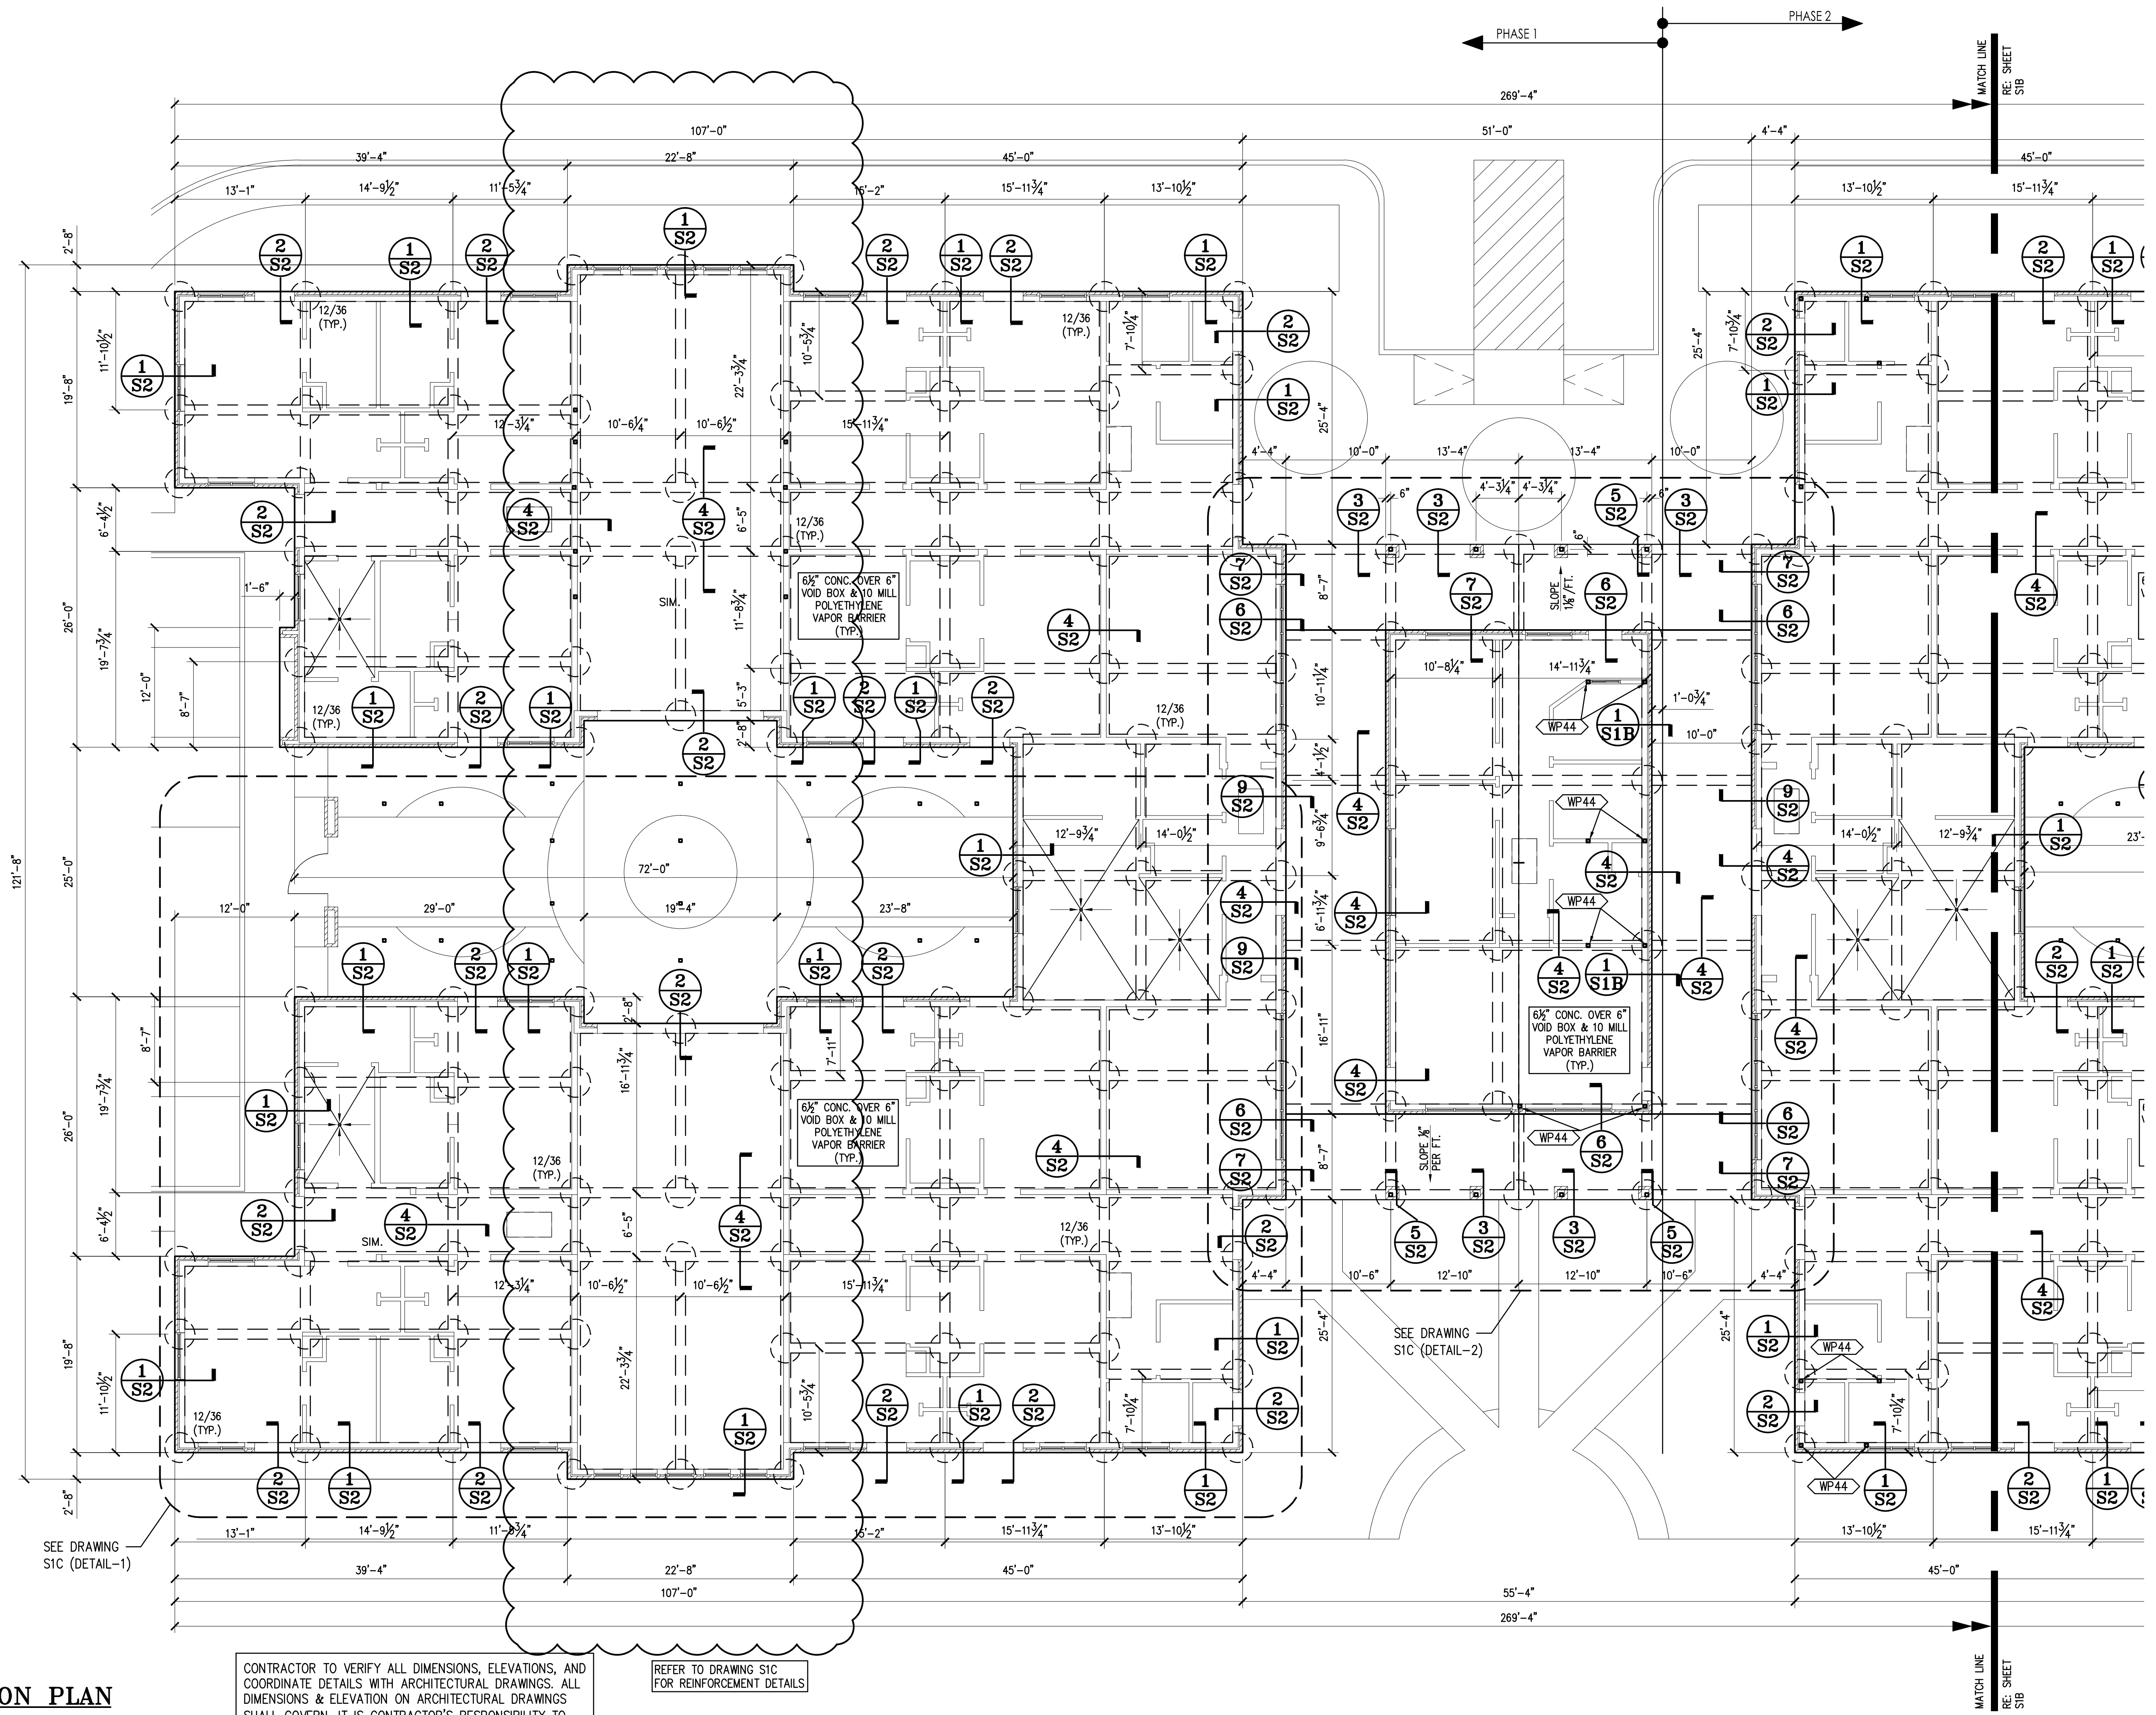


FOUNDATION PLAN

SCALE: 1/8" = 1'-0"

CONTRACTOR TO VERIFY ALL DIMENSIONS, ELEVATIONS, AND COORDINATE DETAILS WITH ARCHITECTURAL DRAWINGS. ALL DIMENSIONS & ELEVATION ON ARCHITECTURAL DRAWINGS SHALL GOVERN. IT IS CONTRACTOR'S RESPONSIBILITY TO REPORT TO ENGINEER ABOUT DISCREPANCY IN DRAWINGS PRIOR TO FABRICATION & BIDDING.

REFER TO DRAWING SIC FOR REINFORCEMENT DETAILS

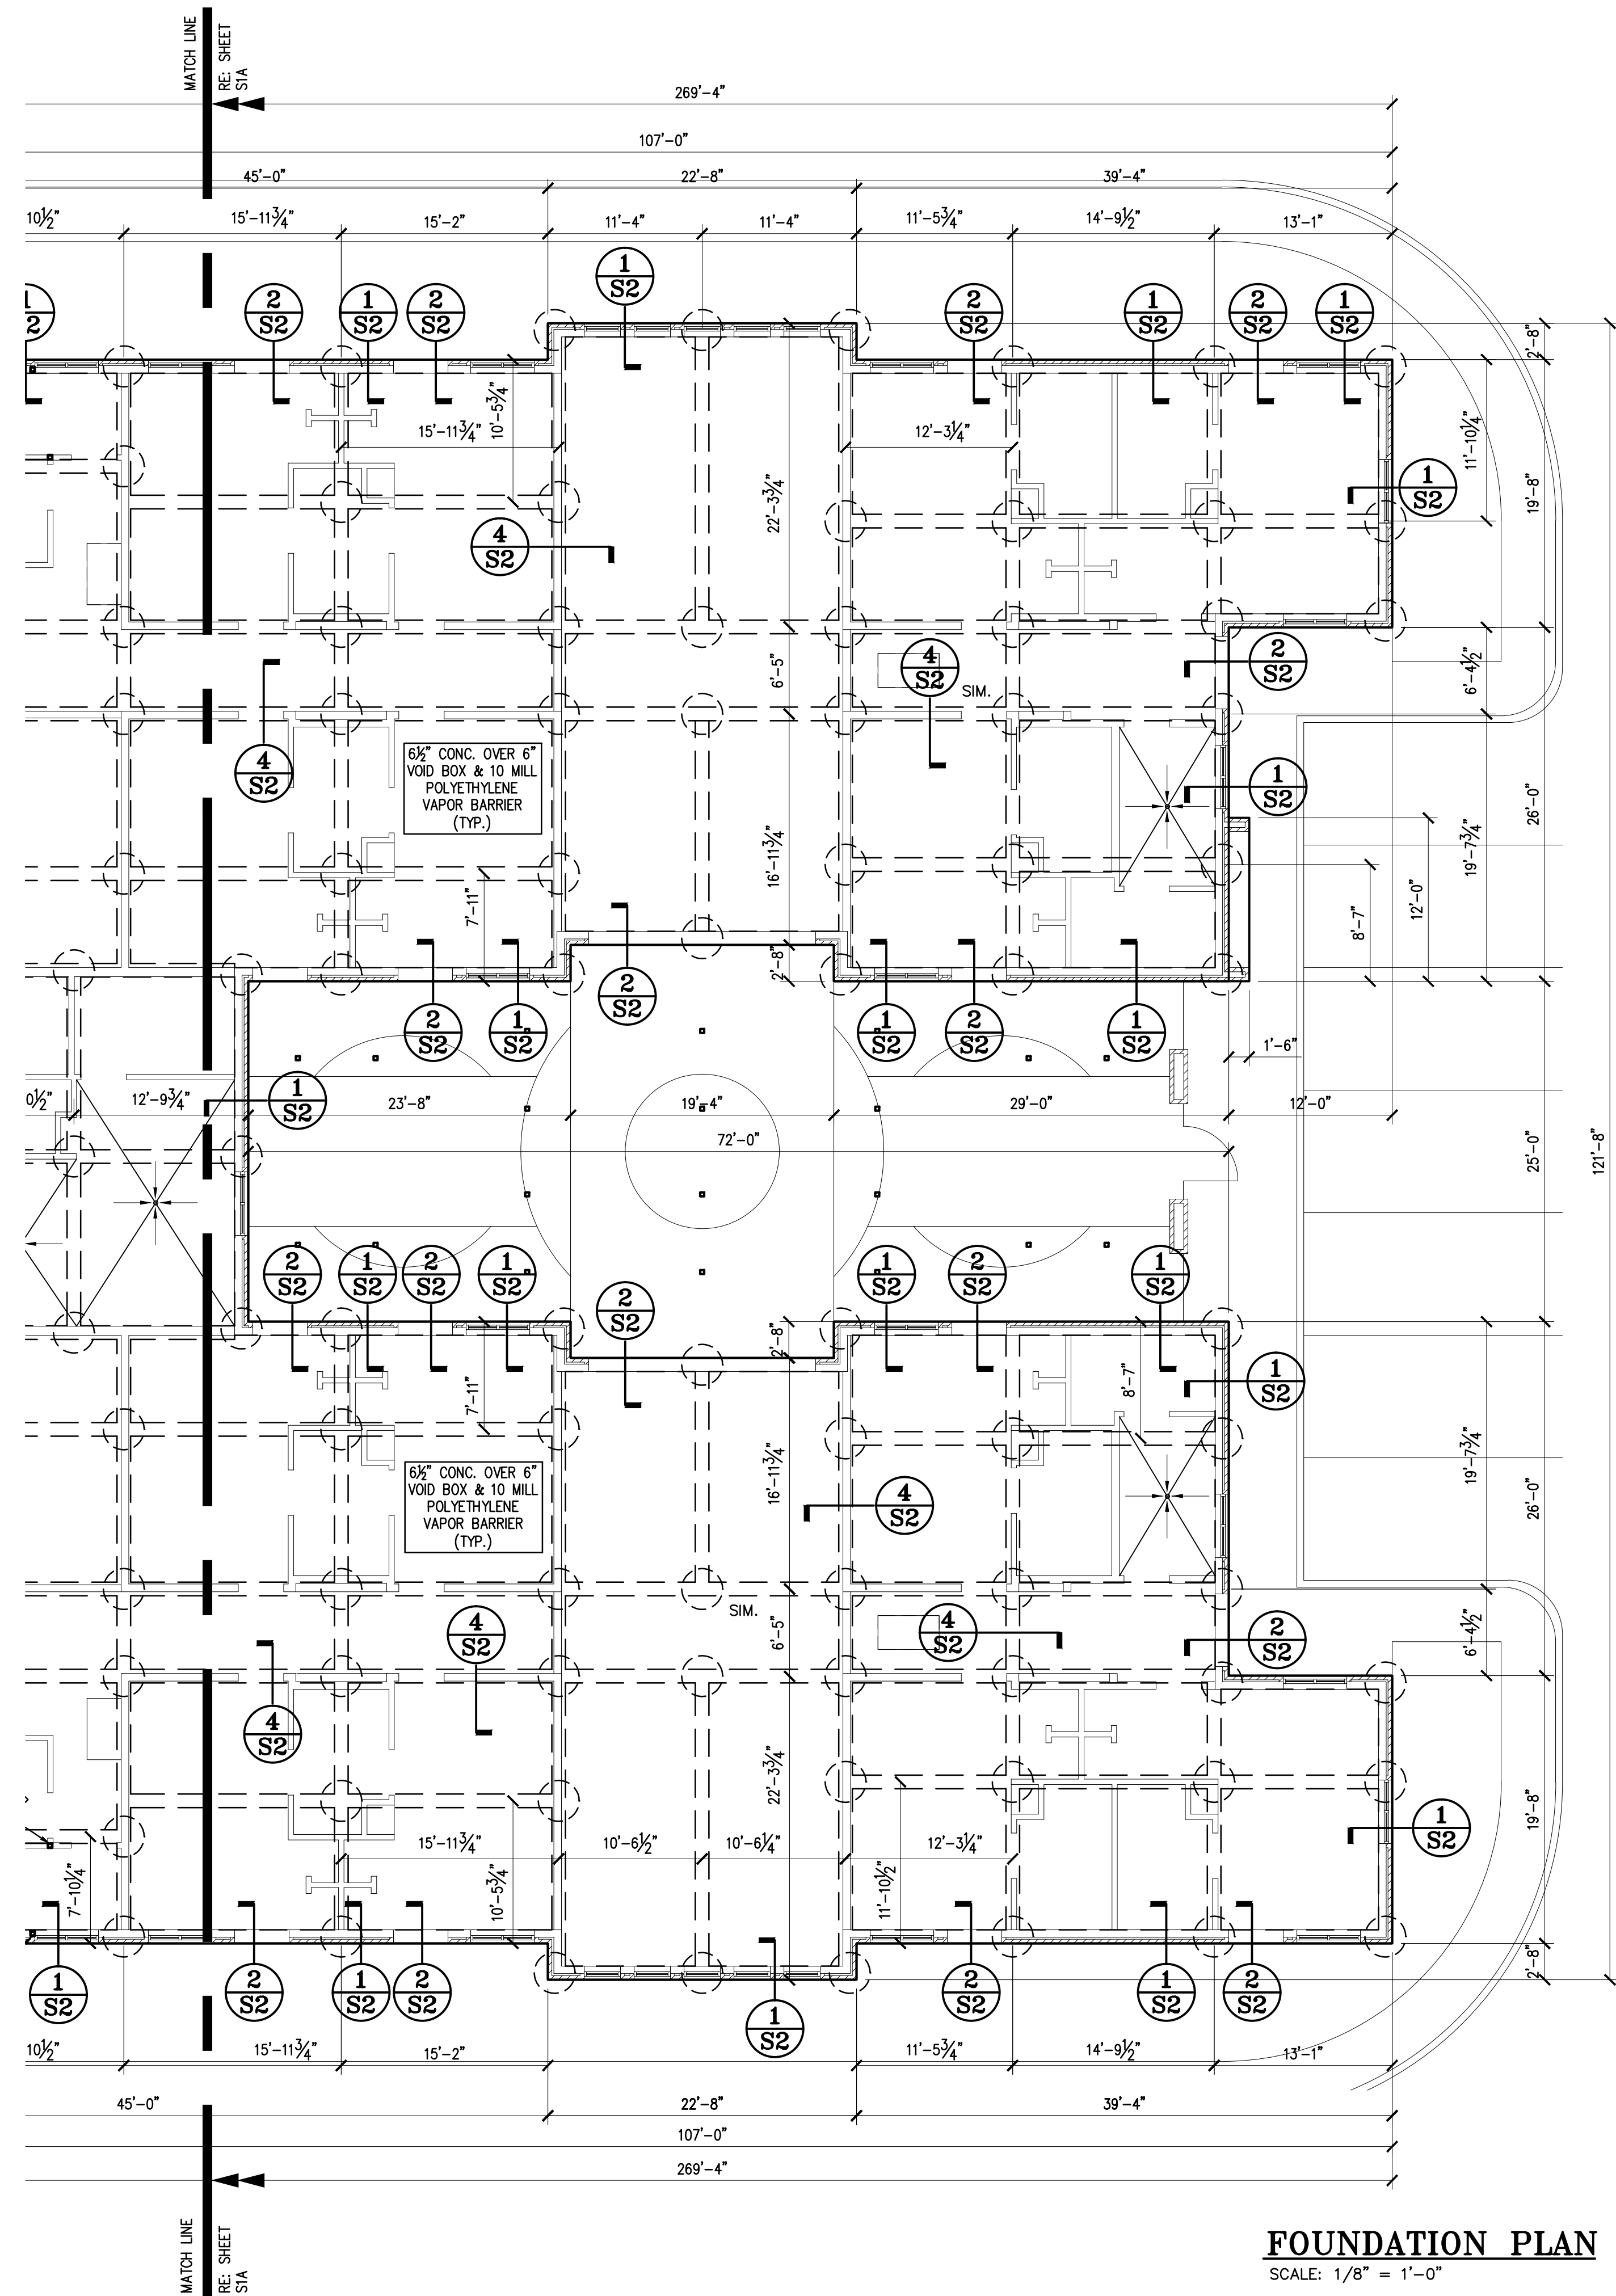

FOUNDATION PLAN
SCALE: 1/8" = 1'-0"

GENERAL NOTES FOR FOUNDATION SYSTEM

- CONTRACTOR SHALL REVIEW & BECOME THOROUGHLY FAMILIAR W/ THE CONTENTS OF REFERENCED SOILS REPORT, WHICH WILL BE CONSIDERED AN INTEGRAL PART OF THE CONSTRUCTION DOCUMENTS. ANY PROBLEMS ARISING FROM THE CONTRACTOR'S LACK OF FAMILIARITY WITH SOILS REPORT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
- CONTRACTOR SHALL VERIFY ALL DIMENSIONS & ELEVATIONS W/ ARCHITECTURAL DRAWING BEFORE FABRICATION.

SUBGRADE PREPARATION AND FILL:

- STRIP AREAS WITHIN BUILDING LINES TO REMOVE ALL VEGETATION, TOP SOIL AND DEBRIS.
- FOLLOWING STRIPPING, PROOF ROLL EXPOSED SUBGRADE TO IDENTIFY WEAK OR SOFT AREAS. SUCH ZONES SHALL BE REMOVED AND REPLACED WITH SELECT FILL.
- GRADE AREA TO PREVENT PONDING OF WATER. DO NOT ALLOW EXPOSED SUBGRADE TO DRY.
- ALL FILL SHALL BE SELECT MATERIALS FOLLOWS:
CLEAN SANDY CLAY, FREE OF ORGANIC MATTER
PLASTICITY INDEX (PI) : 7 TO 20 % LIQUID LIMIT: 28 TO 40 %
- FILL SHALL BE PLACED IN MAXIMUM LOOSE LIFTS OF 8 INCHES AND COMPACTED TO AT LEAST 95% OF STANDARD PROCTOR (ASTM D698 MAXIMUM DRY DENSITY AT OR 2 PERCENTAGE POINTS ABOVE THE OPTIMUM MOISTURE CONTENT).
- PROVIDE 1-8" LOOSE LIFTS OF COMPACTED FILL (TOTAL COMPACTED FILL THICKNESS = 6") AND 2" LEVELLING SAND. (NOTE THAT EXISTING GRADE MAY HAVE TO BE CUT TO ACHIEVE THE COMPACTED FILL DEPTH SPECIFIED HEREIN.)
- TESTING: ALL COMPACTED FILL SHALL BE TESTED BY A CERTIFIED TESTING AGENCY AT THE RATE OF ONE TEST PER 1,000 SQUARE FEET OF EACH LIFT.

CONCRETE:

- ALL CONCRETE WORK SHALL BE IN ACCORDANCE WITH THE "ACI STANDARD BUILDING CODE REQUIREMENT FOR STRUCTURAL CONCRETE: (ACI 318-99)".
- NORMAL WEIGHT CONCRETE (W = 145 PCF) WITH MINIMUM 28 DAY COMPRESSIVE STRENGTH SHALL BE AS BELOW
PIER FC. = 3000 PSI
SLAB & BEAM FC. = 4000 PSI
- CONCRETE SHOULD BE PLACED IN THE FOOTING EXCAVATIONS AS SOON AS POSSIBLE BUT NO LATER THAN THREE HOURS AFTER EXCAVATION TO MINIMIZE THE POSSIBILITY OF CAVING OF DRILLED PIERS.
- CLEAN TOPS OF PIERS AND BOTTOM OF GRADE BEAM TRENCHES THOROUGHLY PRIOR TO PLACEMENT OF CONCRETE IN THE GRADE BEAMS.
- SEE ARCHITECTURAL DRAWINGS FOR FLOOR ELEVATIONS, SLOPES AND THE LOCATION OF FLOOR DEPRESSIONS.

REINFORCING STEEL:

- BARS - CONFORM TO ASTM A-615-GRADE 60, DOWELS AND STIRRUPS - GRADE 40.
- WELDED WIRE FABRIC - CONFORM TO ASTM A-185 OR A-409, FURNISHED IN FLAT SHEETS AND MUST BE SUPPORTED ON CHAIRS SPACED 4'-0" O.C. MAXIMUM EACH WAY.
- DETAILING - CONFORM TO ACI DETAILING MANUAL, 315-80.
REINFORCING STEEL COVERAGE:
FOOTINGS 3" BOTTOM AND SIDES
GRADE BEAMS 1 1/2" TOP, 3" BOTTOM, 2" SIDES (3" SIDES IF EARTH FORMED)
SLABS ON GRADE 1 1/4" TOP
WALLS 1 1/2"
- LAP CONTINUOUS REINFORCING STEEL 36 BAR DIAMETERS.
- SLAB REINFORCEMENT SHALL BE SUPPORTED ON CHAIRS @ 4'-0" MAXIMUM SQUARE GRID.
- GRADE BEAM BOTTOM REINFORCEMENT SHALL BE SUPPORTED ON CHAIRS @ 6'-0" MAXIMUM SPACING.

PIPING PENETRATIONS:

- ALL PIPING PENETRATIONS THROUGH EXTERIOR GRADE BEAMS SHALL BE SLEEVED WITH SCHEDULE 40 PIPE.

IMPORTANT NOTES ON SITE DRAINAGE:

- SOILS AT THIS SITE CONTAIN CLAYS, AND VARIATIONS IN MOISTURE CONTENTS WILL PRODUCE VOLUMEN CHANGES IN THE SOILS THAT MAY DETRIMENTAL TO THE SATISFACTORY PERFORMANCE OF THE FOUNDATION SYSTEM.
- SITE DRAINAGE, ESPECIALLY AROUND SLAB EDGES, MUST BE WELL DEVELOPED, SO THAT SURFACE WATER IS POSITIVELY DIRECTED AWAY FROM SLAB EDGES. A MINIMUM OF 5% GRADE SLOPE MUST BE MAINTAINED AT ALL TIMES WITHIN 10 FEET OF ALL SLAB EDGES.
- LOCALIZED PONDING OF WATER, DUE TO PLANTER BEDS, OR OTHER CAUSES, MUST BE PREVENTED DURING OR AFTER COMPLETION OF CONSTRUCTION, OR LANDSCAPING.
- BUILDER SHALL ADVISE OWNER OF THESE SITE DRAINAGE REQUIREMENTS.

CODE:

INTERNATIONAL RESIDENTIAL CODE (IRC 2006)

DESIGN LOADS:

1. ROOF LIVE LOADS	16 PSF		
2. FLOOR LIVE LOADS	(INT'L RESIDENTIAL CODE-2003, TABLE R301.5)		
EXTERIOR BALCONIES	60 PSF	SLEEPING ROOMS	30 PSF
DECKS	40 PSF	OTHER ROOMS	40 PSF
FIRE ESCAPES	40 PSF	ATTIC W/ STORAGE	20 PSF
STAIRS	40 PSF	ATTIC W/O STORAGE	10 PSF
GUARDRAILS & HANDRAILS	200 PSF *	GARAGE	50 PSF

* A SINGLE CONCENTRATED LOAD APPLIED IN ANY DIRECTION @ ANY POINT ALONG THE TOP.

3. WIND LOADS

BASIC WIND DESIGN VELOCITY	110 MPH (3-SECOND GUST WIND SPEED)
EXPOSURE: B	IMPORTANCE FACTOR: 1

GENERAL NOTES: COORDINATION W/ ARCH. DWGS.

- CONTRACTOR SHALL REVIEW ARCHITECTURAL AND STRUCTURAL DRAWINGS JOINTLY PRIOR TO CONSTRUCTION, TO ENSURE COORDINATION OF ALL PHASES OF CONSTRUCTION DESCRIBED IN THESE DRAWINGS. DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF BOTH ARCHITECT AND ENGINEER, PRIOR TO PROCEEDING WITH CONSTRUCTION WORK.
- THE FOLLOWING ITEMS, IN PARTICULAR, HAVE TO BE CLOSELY COORDINATED BETWEEN ARCHITECTURAL AND STRUCTURAL DRAWINGS:
 - ALL DIMENSIONS;
 - SLAB AND FLOOR ELEVATIONS, SLOPES, AND LOCATION AND DIMENSIONS OF ANY RECESSES, INCLUDING THOSE INTENDED FOR SHOWERS, ELEVATORS, FLOORING MATERIALS, ETC.
 - CURBS AND VENEER LEDGES;
 - CEILING HEIGHTS AND CEILING CONDITIONS;
 - ROOF GEOMETRY AND SLOPES.

SOILS REPORT:

1. REFERENCE:	EE-1227309-G	
REPORT NO:	EE-1227309-G	
DATE:	OCTOBER 2, 2012	
PREPARED BY:	EARTH ENG-INC.	
2. SOIL DATA:		
PLASTICITY INDEX (PI) OF SURFICIAL SOILS:	43-67	
LIQUID LIMIT:	52-92	POTENTIAL VERTICAL RISE (PVR) : VERY HIGH
3. ALLOWABLE DESIGN BEARING PRESSURES:		
DEAD & SUSTAINED LIVE LOADS:	2,500 PSF	TOTAL LOADS: 3,750 PSF
4. DESCRIPTION OF BEARING SURFACE:	VERY STIFF REDDISH BROWN CLAY	
5. CONTRACTOR MUST REVIEW SOIL REPORT FOR SITE PREPARATION, EXISTING CONDITION, SELECT FILL AND DRILLED SHAFT INSTALLATION. IN CASE OF SAND ENCOUNTER AT THE SITE THEN CASTING MUST BE USED WITHOUT ADDITION COST TO THE OWNER.		

NOTES ON PRESSURE-TREATED LUMBER:

- ALL WOOD MEMBERS IN CONTACT WITH CONCRETE, OR EXPOSED TO WEATHER OR MOISTURE (SUCH AS PORCH & BALCONY FRAMING) SHALL BE PRESSURE-TREATED.
- CURRENTLY, THE PRODUCT COMMONLY USED FOR PRESSURE TREATMENT IS ALKALINE COPPER QUATERNARY (ACQ). THIS MATERIAL IS EXTREMELY CORROSIVE. ONLY HOT-DIPPED GALVANIZED ANCHOR BOLTS, THRU BOLTS, NAILS, OR OTHER CORROSION-RESISTANT FASTENERS SHALL BE USED WITH ACQ-TREATED LUMBER. FASTENER MANUFACTURER OR SUPPLIER SHALL BE CONSULTED ON THE SUITABILITY OF GALVANIZED FASTENER FOR USE WITH TREATED LUMBER.

THE CONTRACTOR MUST HAVE A MINIMUM OF 10 YEARS EXPERIENCE IN RESIDENTIAL CONSTRUCTION


NOTES:

IT IS STRONGLY RECOMMENDED THAT INSPECTION IS REQD PRIOR TO CONC. POUR TO AVOID MISPLACEMENT OF REINFORCEMENT

NOTES:

- ALL FOOTING ARE AS SHOWN ON PLAN.
- ALL COLUMN ARE AS SHOWN ON CEILING PLAN.
- C.J. ON PLAN INDICATES CONTROL JOINT & K.W INTACATEX KEY AWAY
- REPLACE EXISTING SOIL WITHING BUILDING AS RECOMENDED BY GEOTECHNICAL REPORT NO. EE-1227309-G BY ASSOCIATED EARTH ENGINEERING, INC. HOUSTON, TEXAS.
- ALL ANCHOR BOLTS MUST BE IN PLACE BEFORE POURING CONCRETE.
- SITE SHOULD BE GRADED TO SHED ALL RAIN WATER AWAY FROM STRUCTURE. NO WATER POND ALLOWED AROUND BUILDING.
- WATER & SAND MAY ENCOUNTER, IT IS CONTRACTORS RESPONSIBILITY TO USE PUMP TO DE WATERING SYSTEM & STRAIGHT DRILLED SHAFT IF REQUIRED DUE TO SAND. (REFER TO SOIL REPORT).
- USE 6" VOID BOXES UNDER CONC. SLAB

REFER TO DRAWING SIC FOR REINFORCEMENT DETAILS

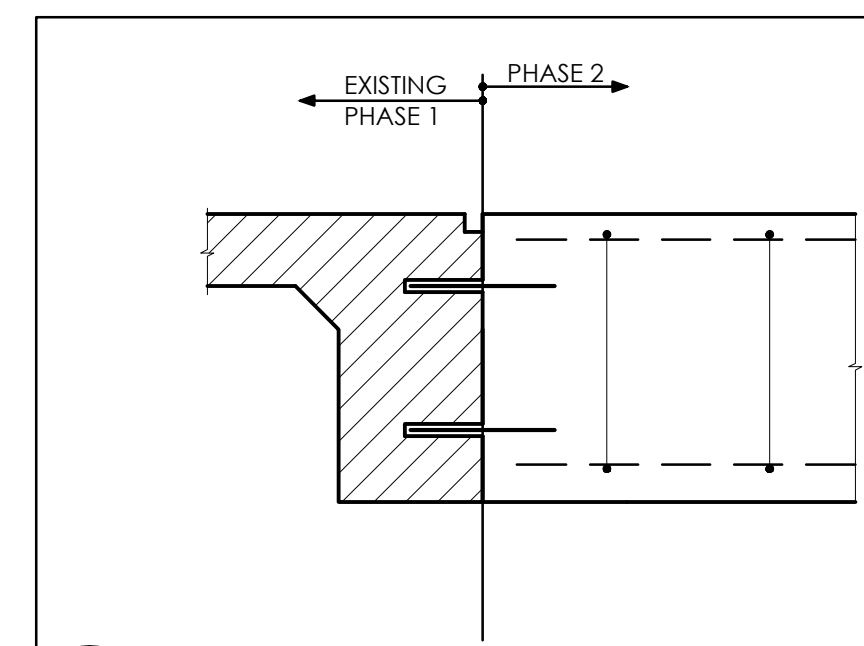

1 SECTION:

FOUNDATION PLAN

OPTIMUM PERSONAL CARE
1110 LAKEVIEW DRIVE
SUGAR LAND, TX. 77478

ISSUE HISTORY

DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION

09/03/13

Z:\SEAL.jpg

PE BUILDINGS
BRIDGES
INSPECTIONS
MARINE STRUCTURES
CIVIL ENGINEERING &
STRUCTURAL ENGINEERING

PARAMOUNT ENGINEERING LLC


7322 SOUTHWEST FREEWAY STE. 1050
HOUSTON, TX 77074
TEL : (713) 636-9977
FAX : (713) 888-9872
CEL : (713) 204-1742

TBPE REGISTRATION # F-3394

DRAWN BY: E.V. H.P. CHECKED BY: M.M.

PROJ. NO.: PE12-225


SHEET: **S1B**

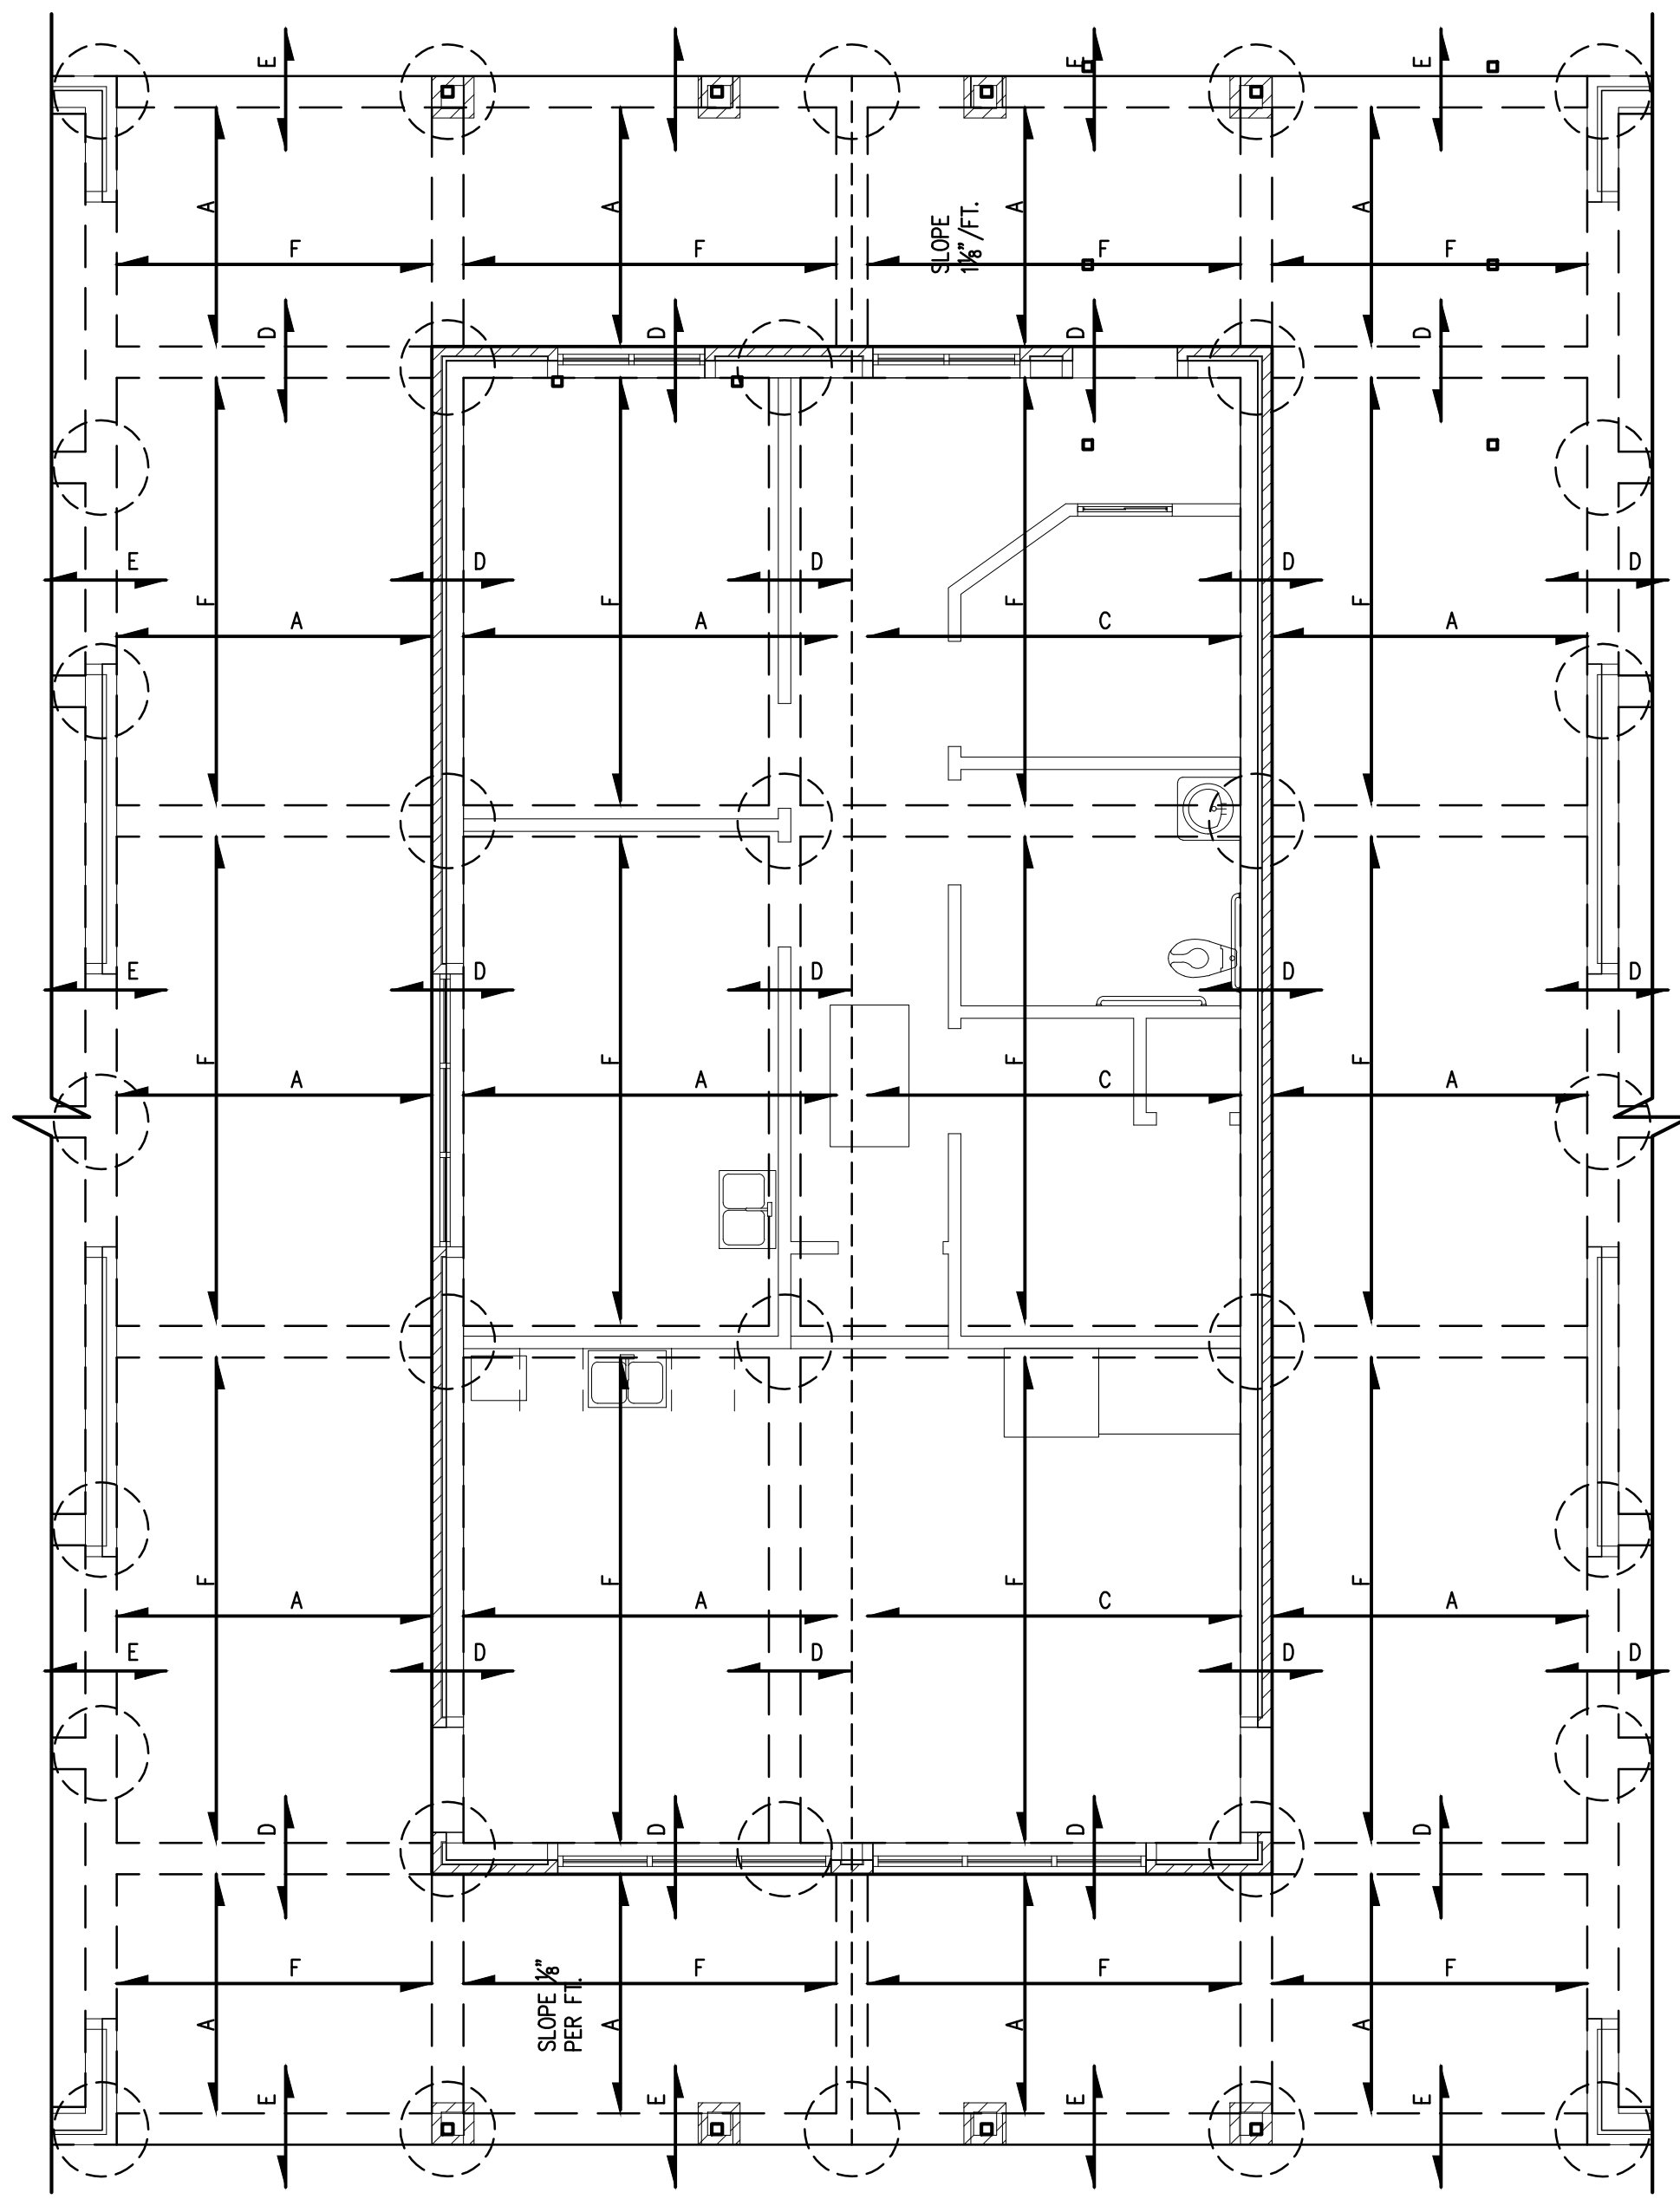

DETAIL-2: TYPICAL SLAB REINFORCEMENT
SCALE: 3/16" = 1'-0"


SCHEDULE OF REINFORCEMENT OF STRUCTURAL SLAB		
BAR I.D.	LOCATION	SIZE & SPACING
A	MAIN BAR AT BOTTOM	#5 @ 12"
B	MAIN BAR AT BOTTOM	#5 @ 9"
C	MAIN BAR AT BOTTOM	#5 @ 8"
D	TOP BAR AT SUPPORT. SEE DETAIL A ON THIS SHEET	#5 @ 12"
E	3'-6" LONG BAR TOP AT SUPPORT	#5 @ 12"
F	SECONDARY BAR AT BOTTOM	#3 @ 15"

LEGEND:
 DIRECTION OF REINFORCEMENT EXTEND SUPPORT TO SUPPORT

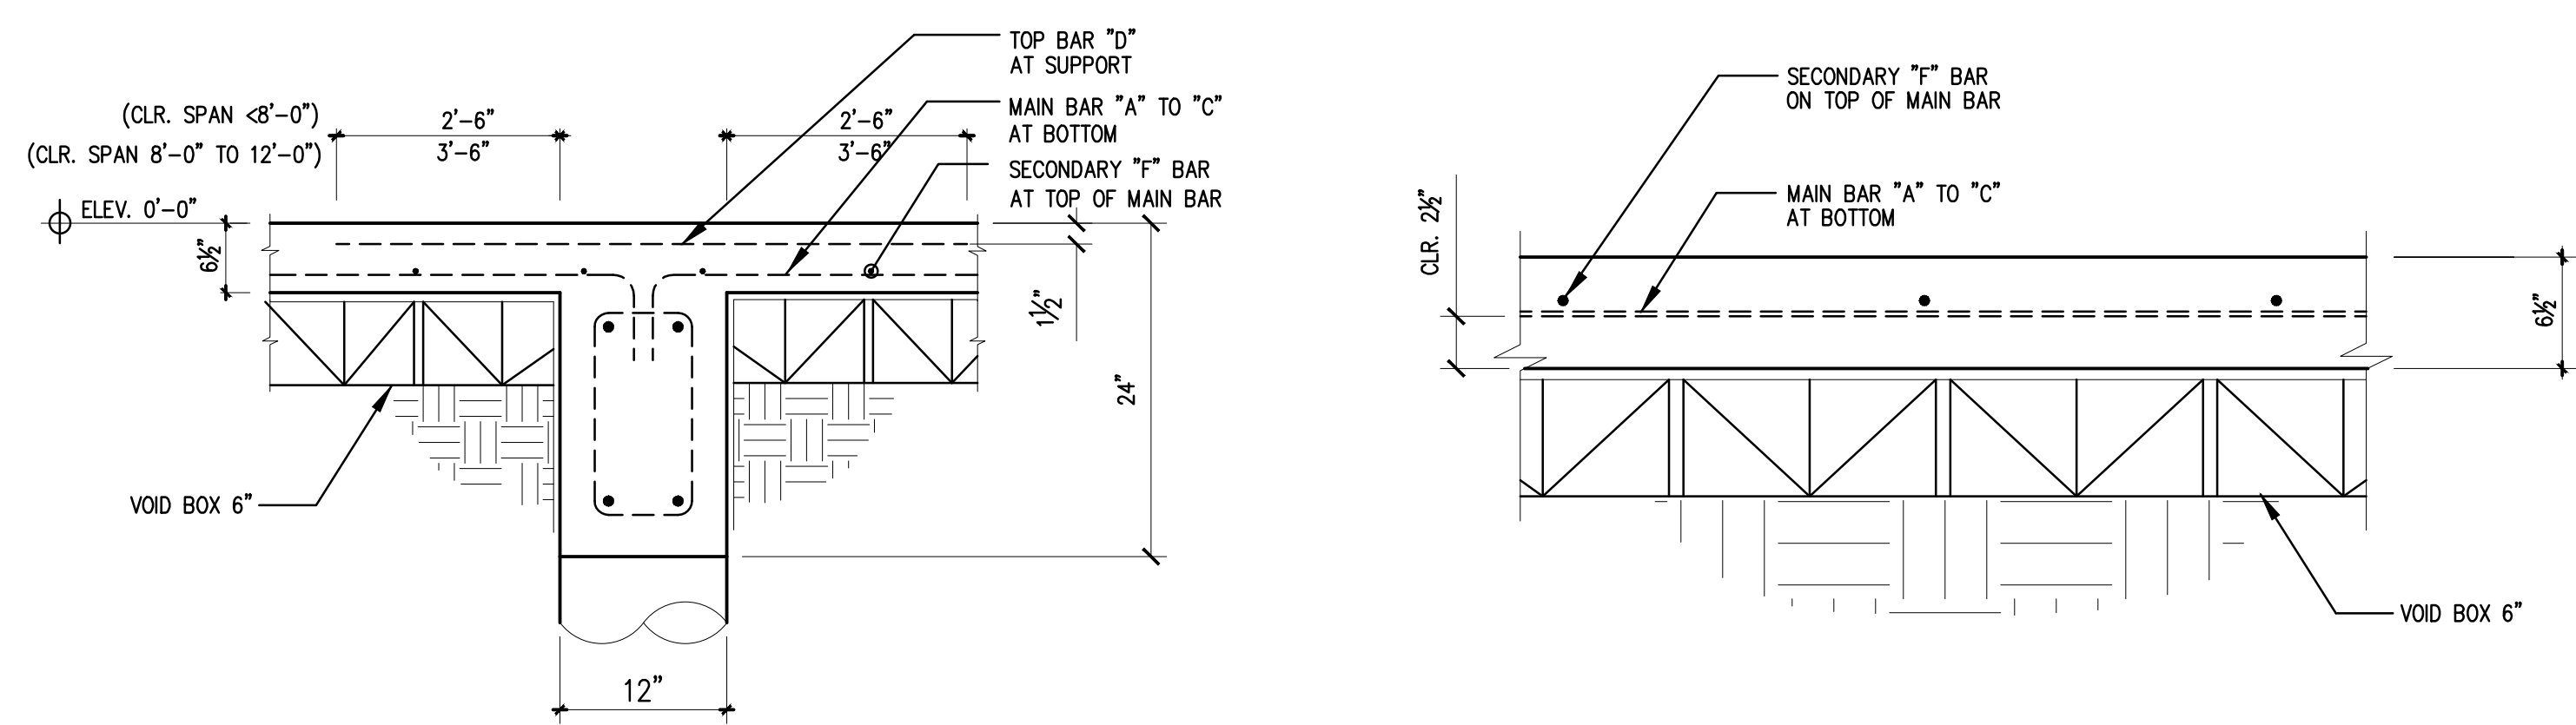

DETAIL-A
SLAB REINFORCEMENT AT INTERIOR SUPPORT BEAM
NOT TO SCALE

SECTION: TYPICAL SLAB REINFORCEMENT ARRANGEMENT
NOT TO SCALE

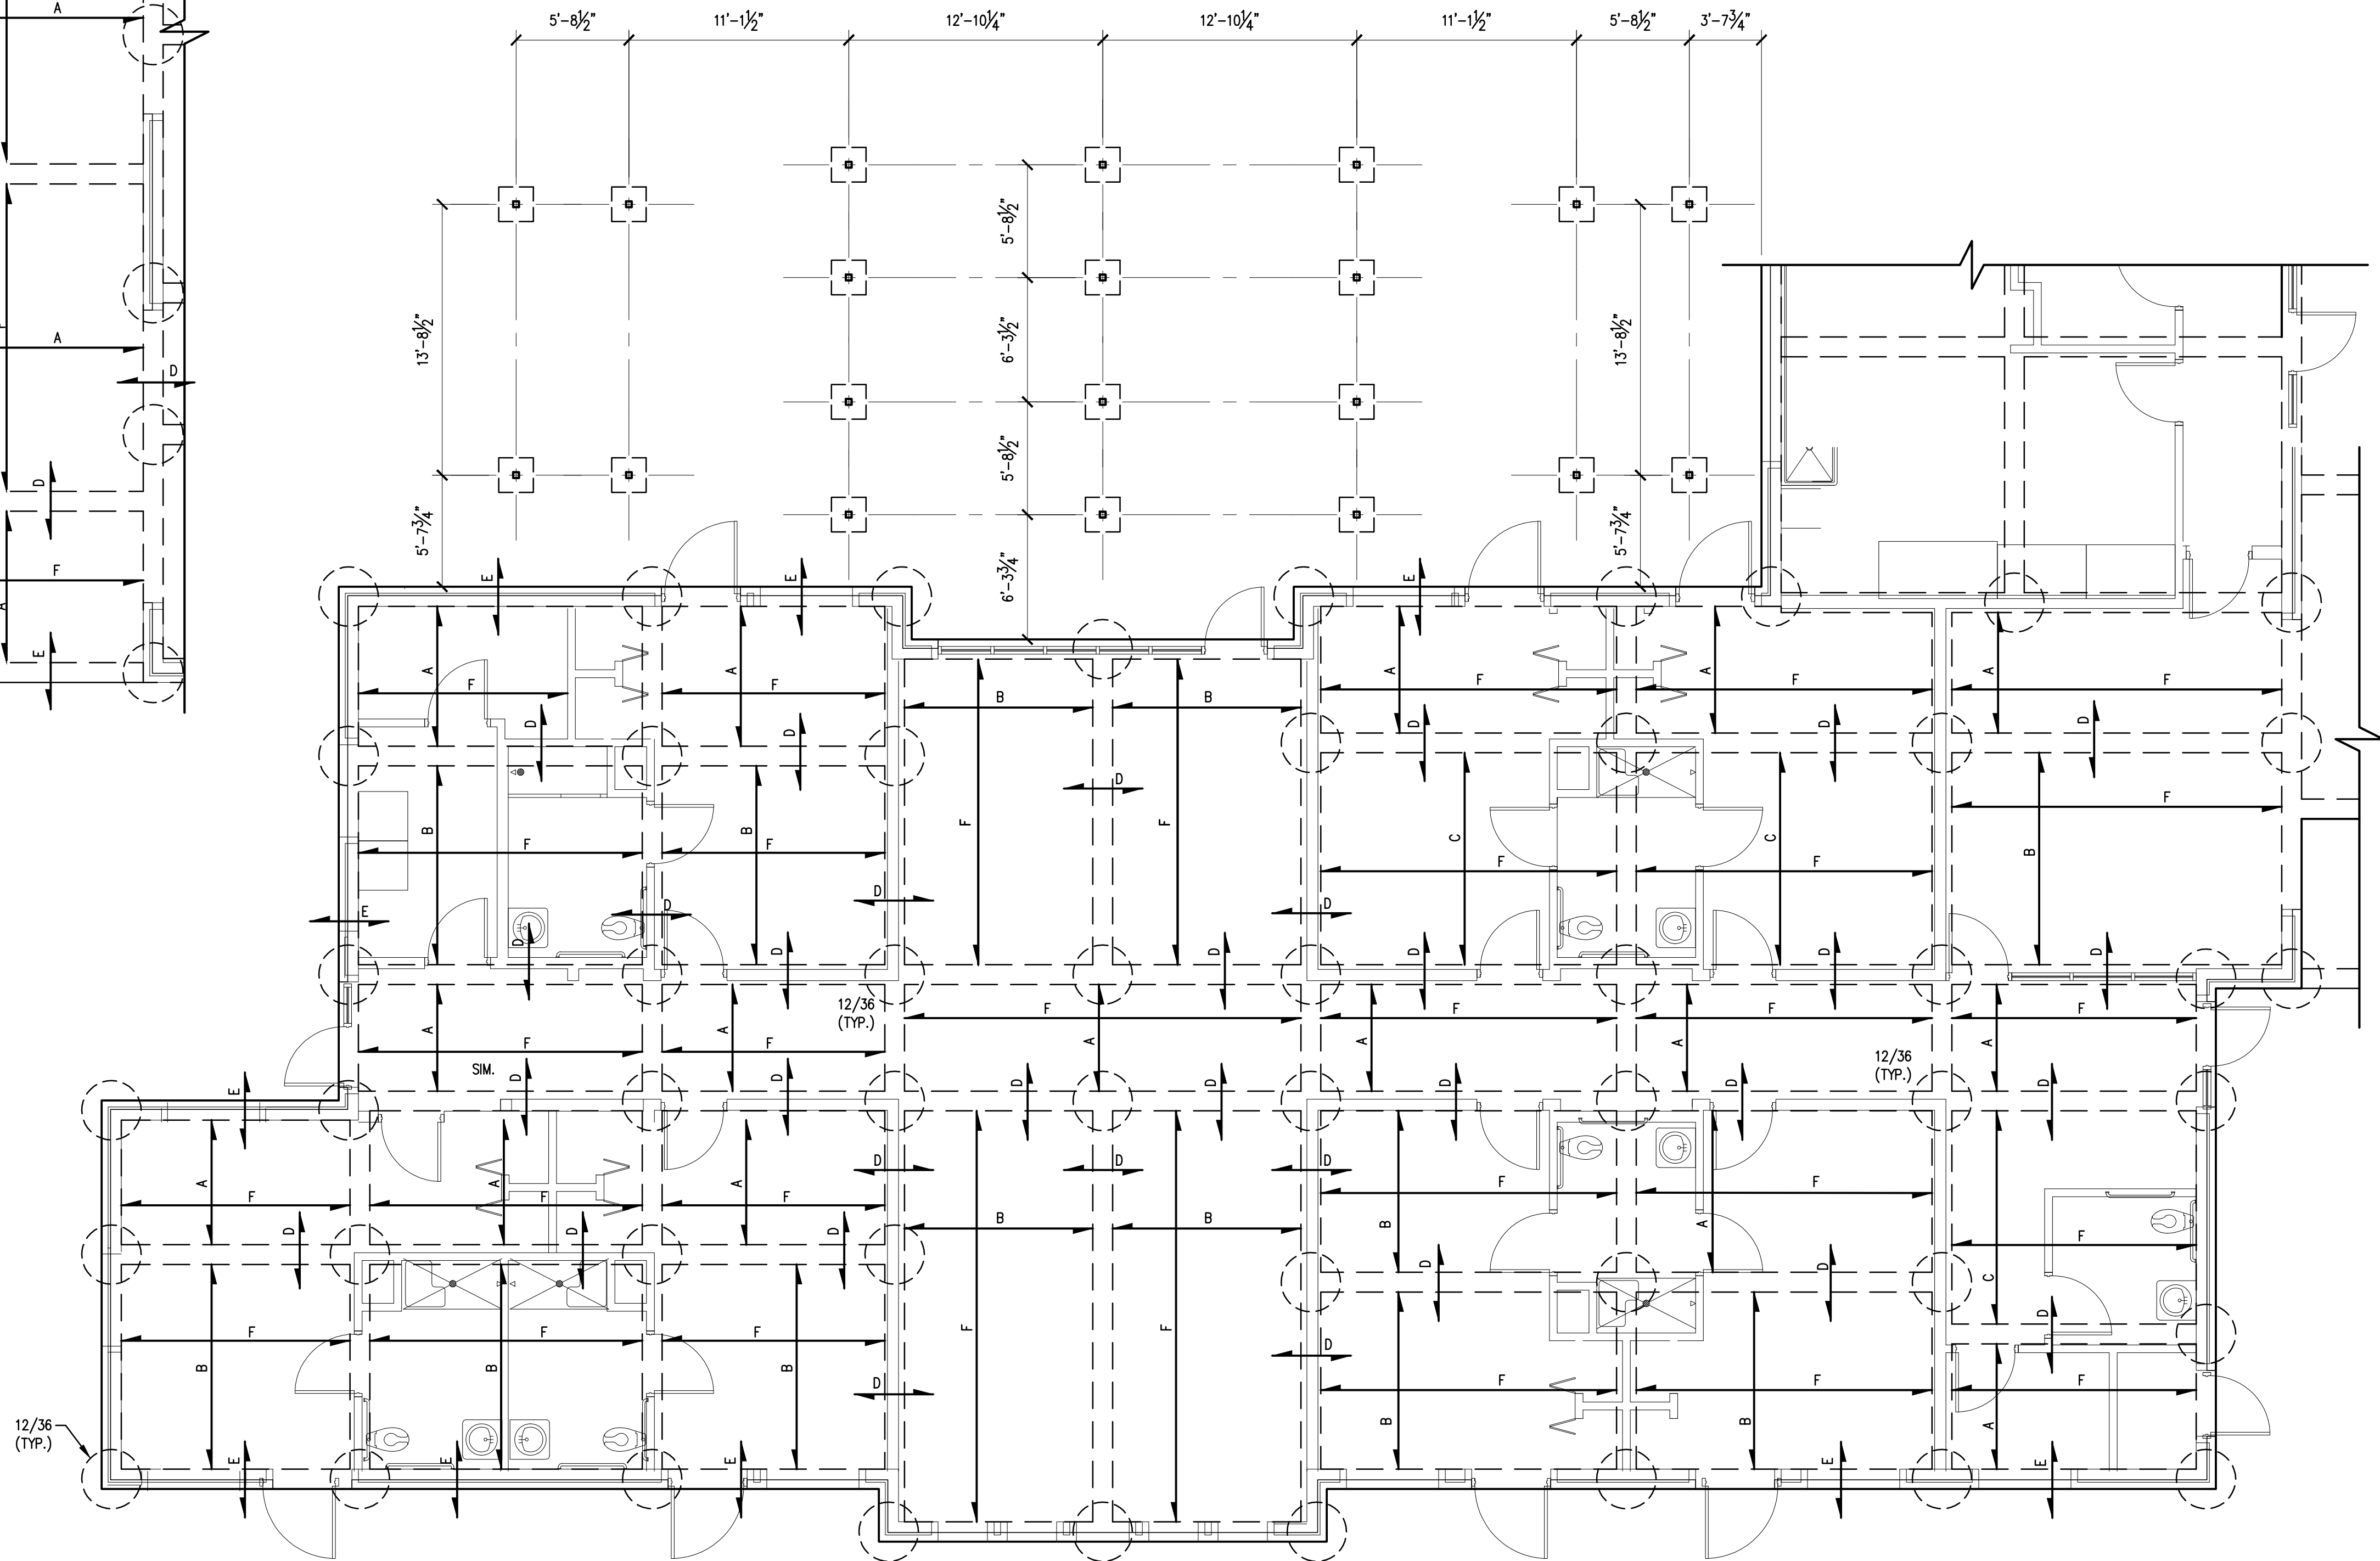

DETAIL-1: TYPICAL SLAB REINFORCEMENT
SCALE: 3/16" = 1'-0"

PARTIAL FOUNDATION PLANS

OPTIMUM PERSONAL CARE
1110 LAKEVIEW DRIVE
SUGAR LAND, TX. 77478

ISSUE HISTORY	
DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION
08/04/14	REVISION Δ

08/04/14
Z:\SEAL.jpg


PE BUILDINGS
BRIDGES
INSPECTIONS
MARINE STRUCTURES
CIVIL ENGINEERING &
STRUCTURAL ENGINEERING

PARAMOUNT ENGINEERING LLC
7322 SOUTHWEST FREEWAY STE. 1050
HOUSTON, TX 77074
TEL : (713) 636-9977
FAX : (713) 888-9872
CEL : (713) 204-1742


TBPE REGISTRATION # F-3394
DRAWN BY: E.V. H.P. CHECKED BY: M.M.

PROJ. NO.: PE12-225


SHEET: **S1C**

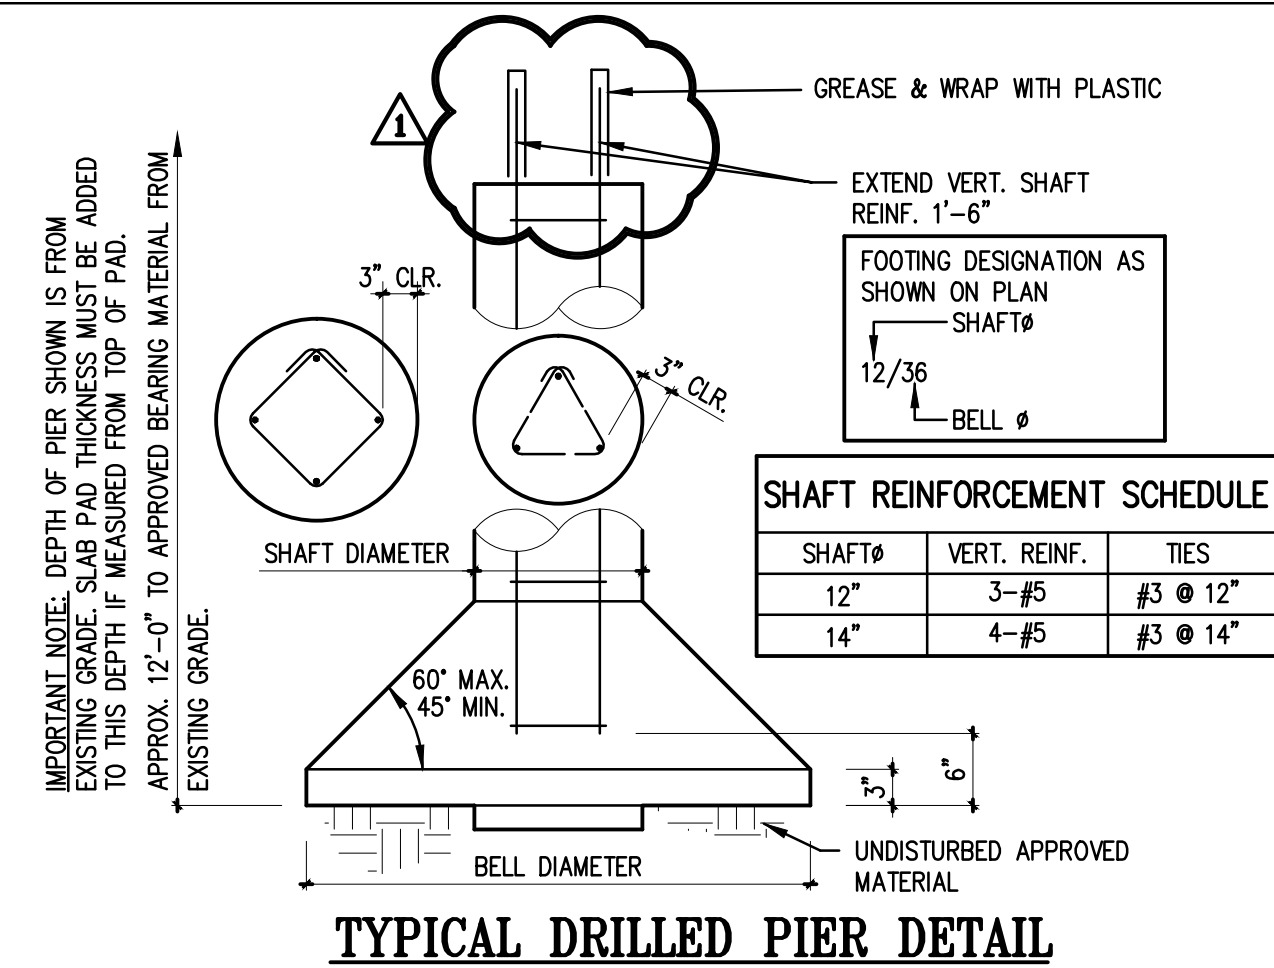


TYPICAL DRILLED PIER DETAIL

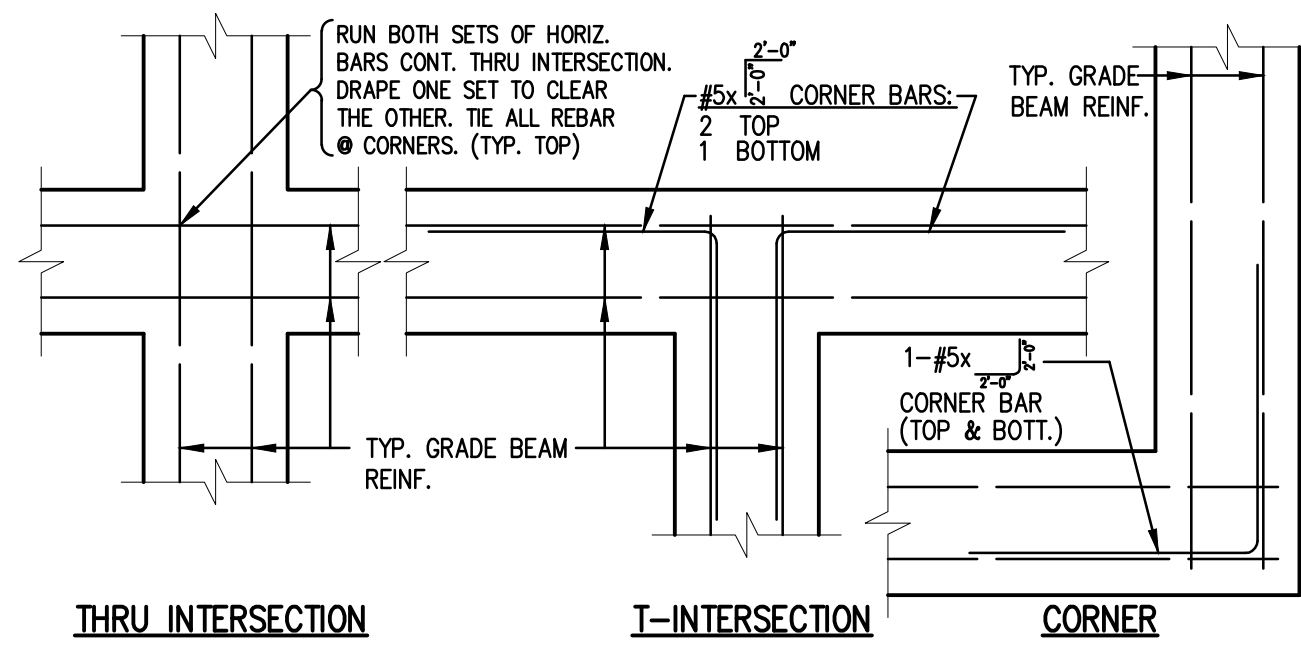


TYPICAL REINFORCEMENT DETAILS @ GRADE BEAM INTERSECTIONS

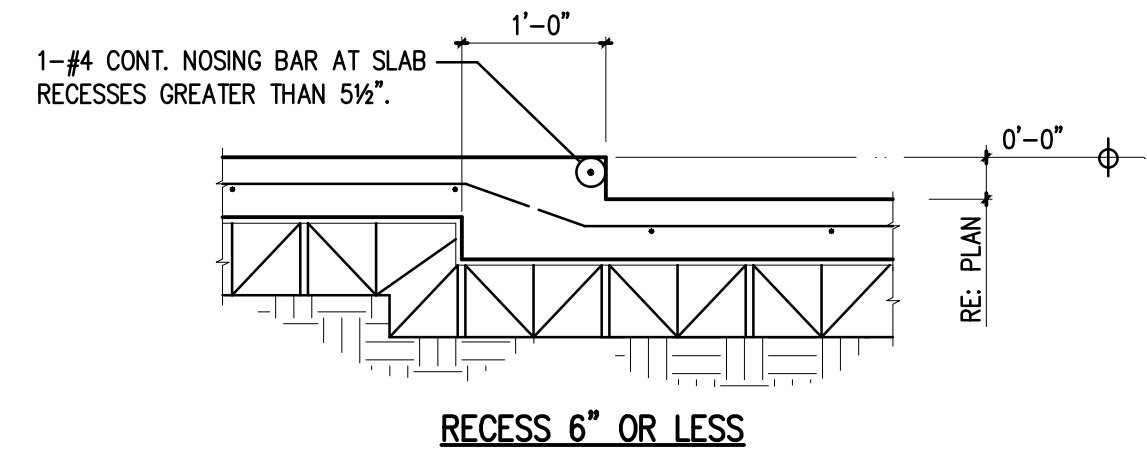


NOTE: USE THIS DETAIL WHERE SLAB RECESS DOES NOT OCCUR OVER A BEAM

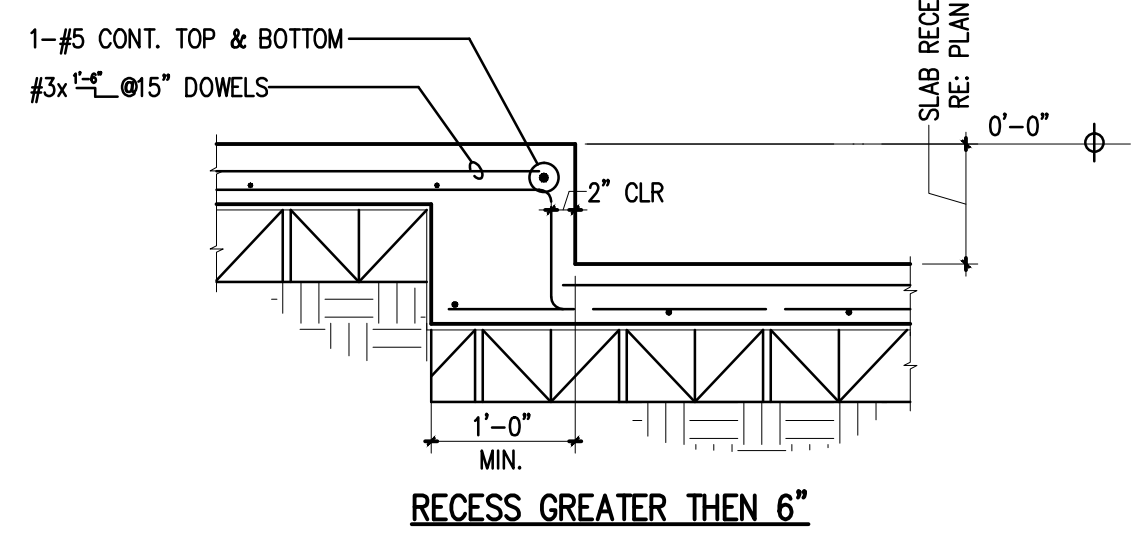


TYPICAL SLAB RECESS DETAIL

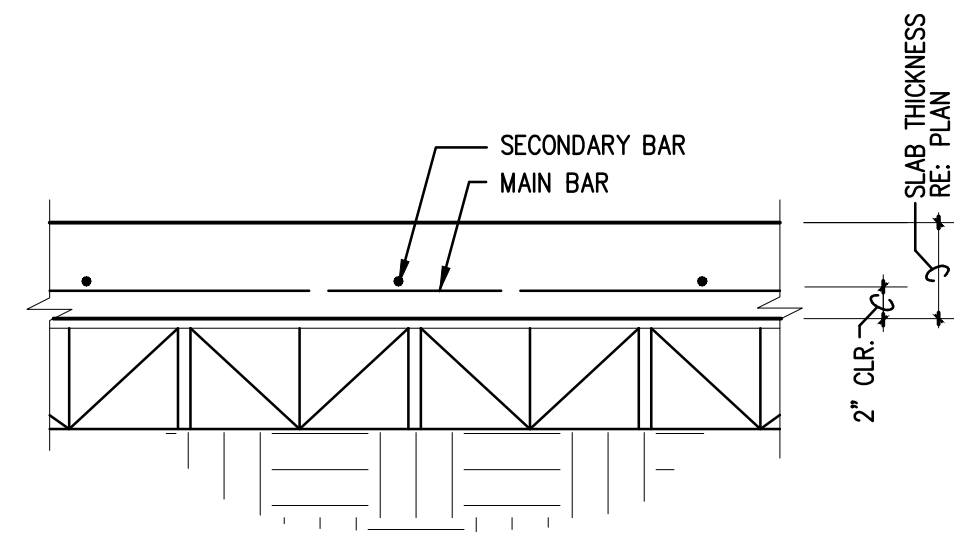


TYPICAL SLAB REINFORCEMENT ARRANGEMENT
NOT TO SCALE

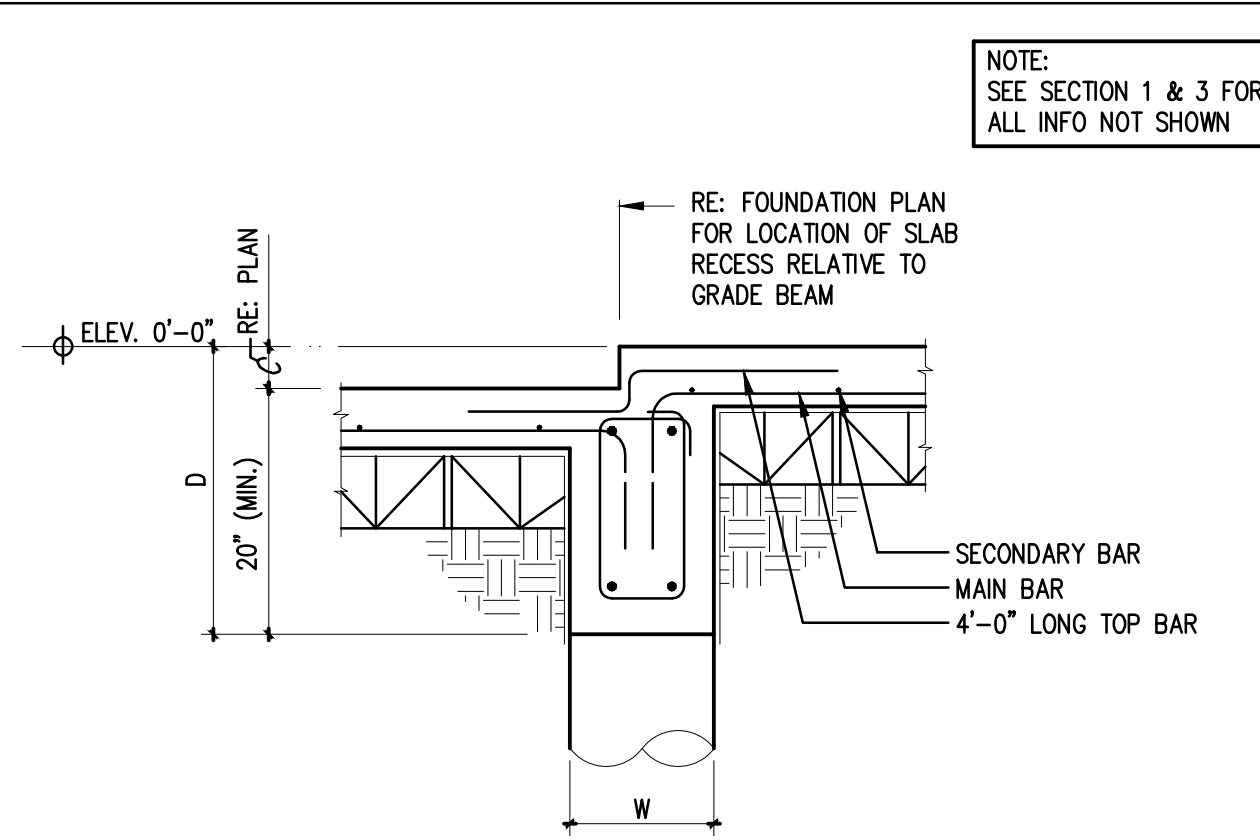


6 SECTION: TYPICAL GRADE BEAM @ SLAB RECESS

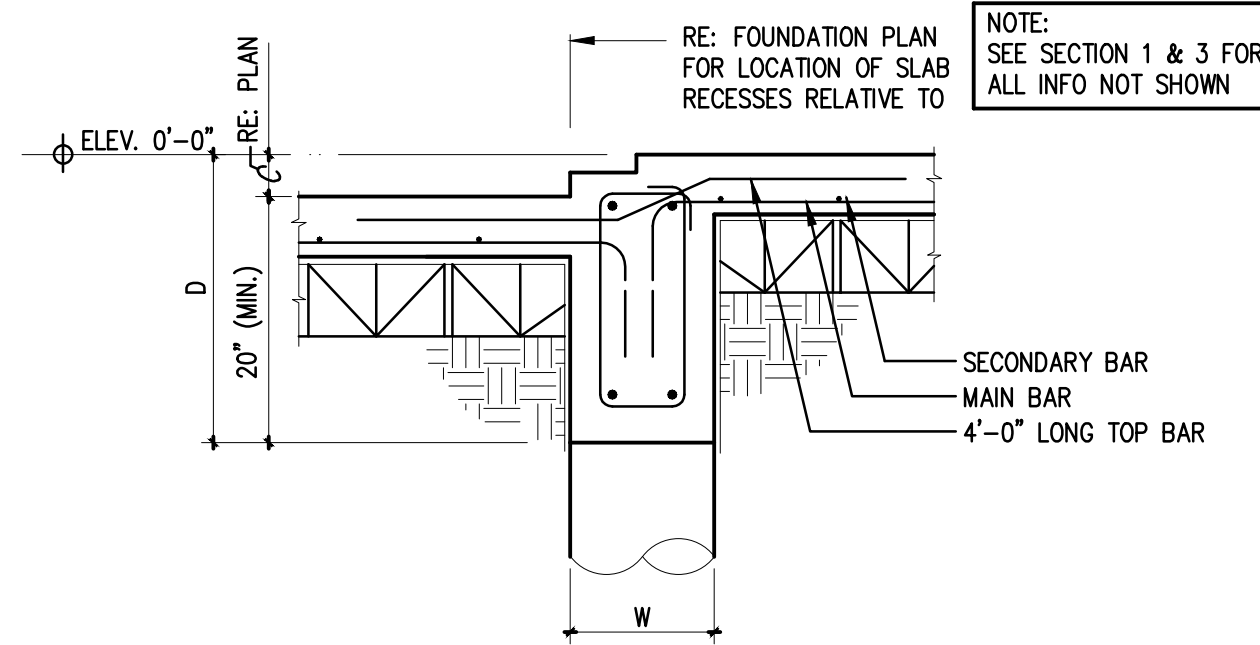


7 SECTION: TYPICAL GRADE BEAM @ SLAB RECESS W/ BRICK

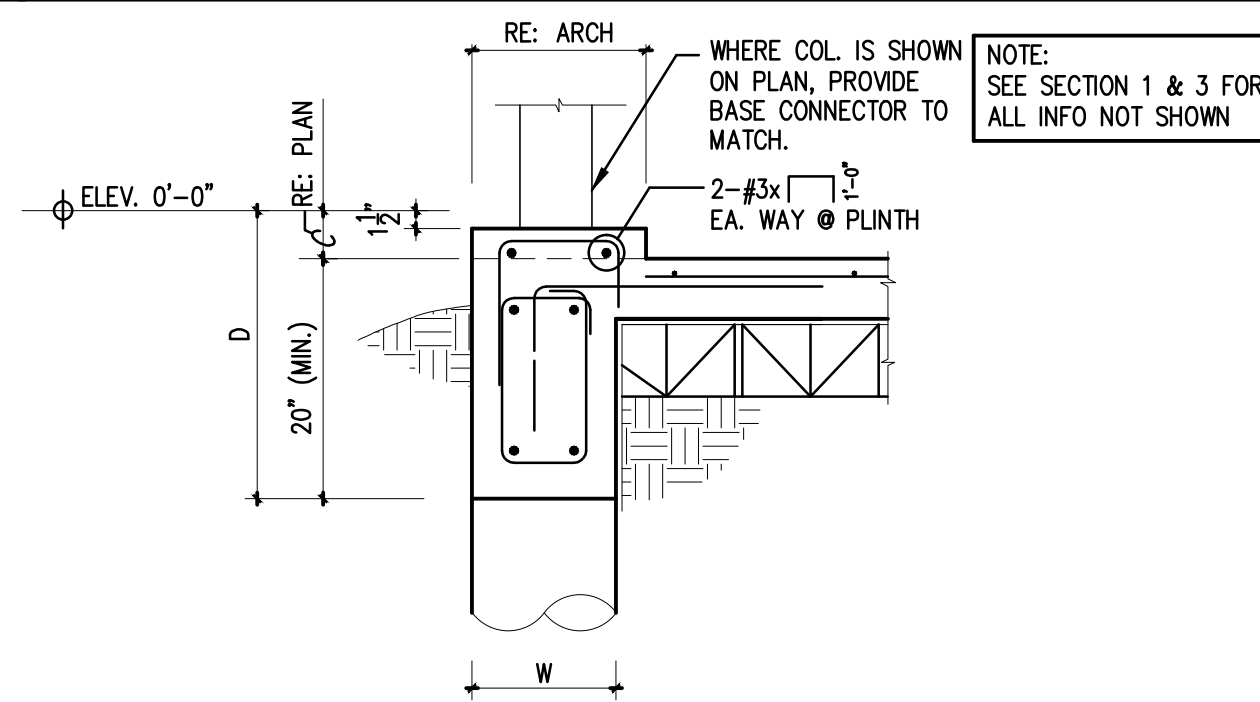


8 SECTION: TYPICAL GRADE BEAM @ PLINTH

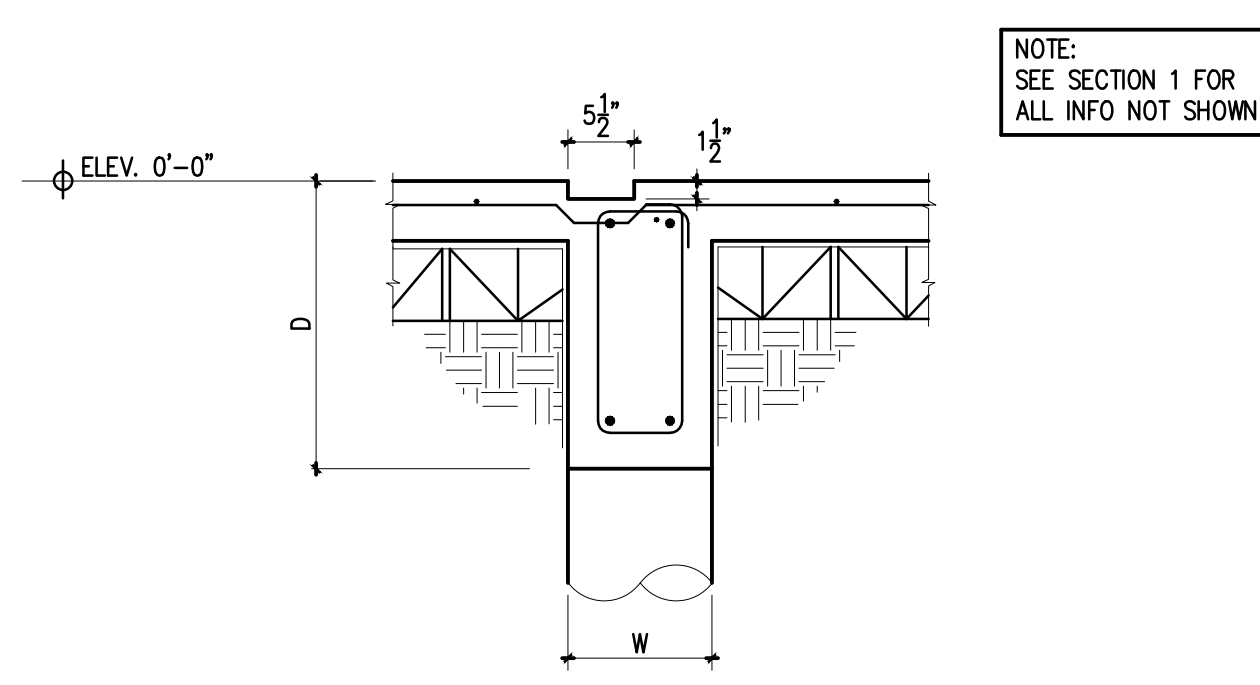


9 SECTION: TYPICAL INTERIOR GRADE BEAM W/ BRICK

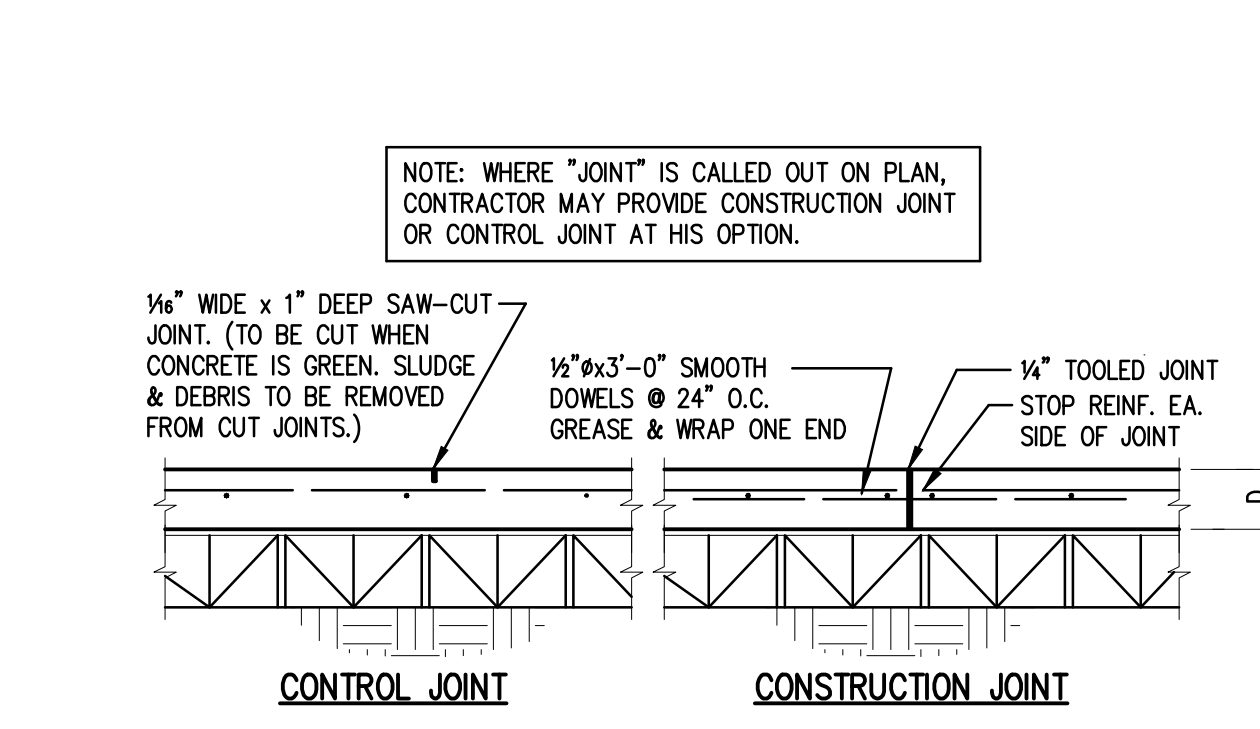


TYPICAL SLAB JOINT DETAILS

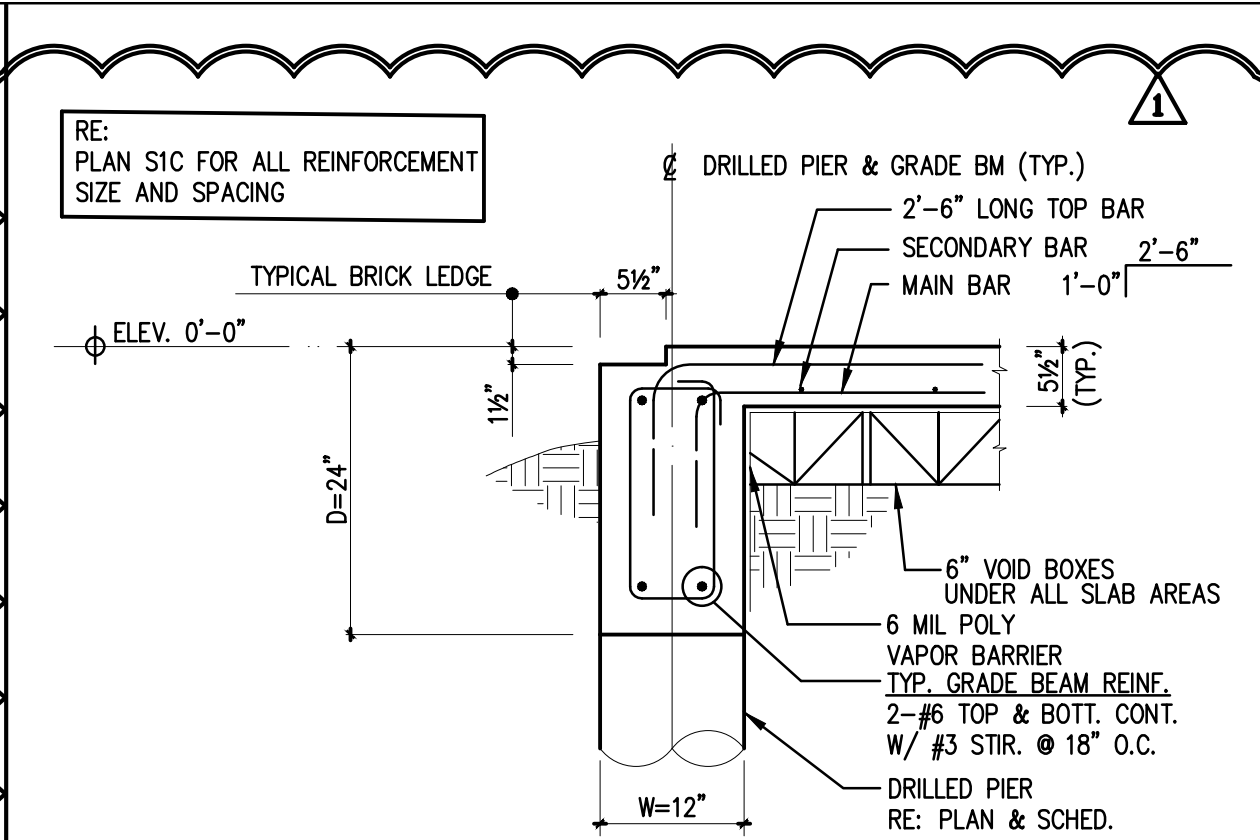


1 SECTION: TYPICAL GRADE BEAM @ BRICK LEDGE

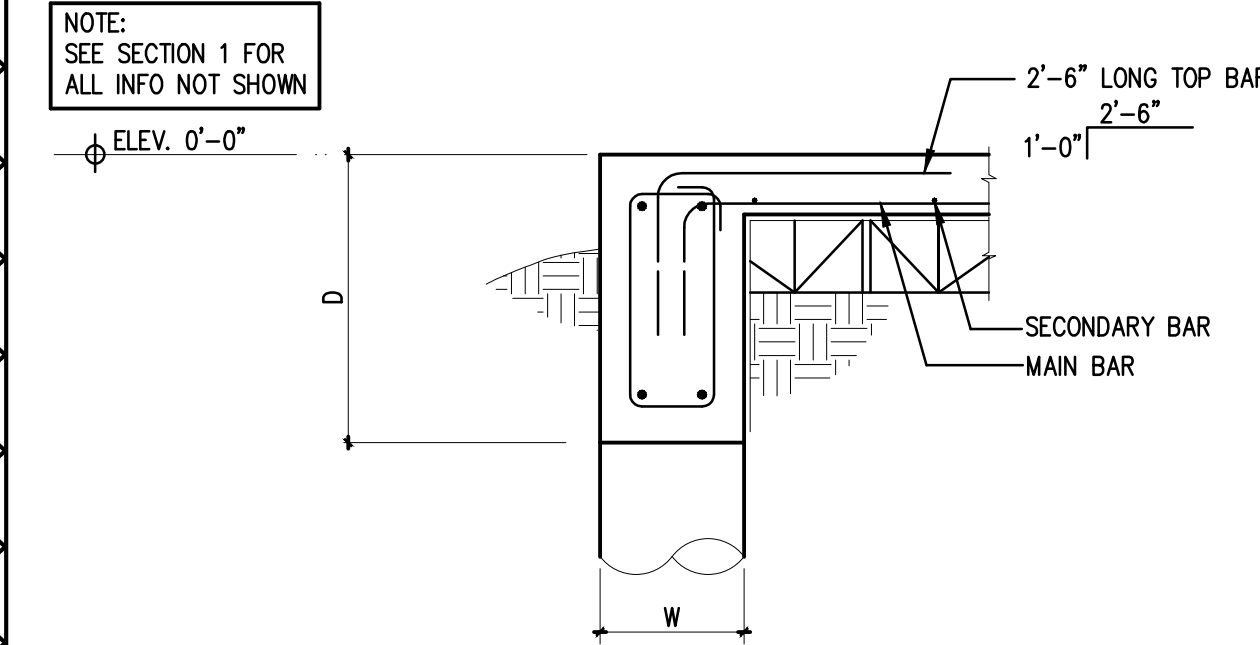


2 SECTION: TYPICAL GRADE BEAM

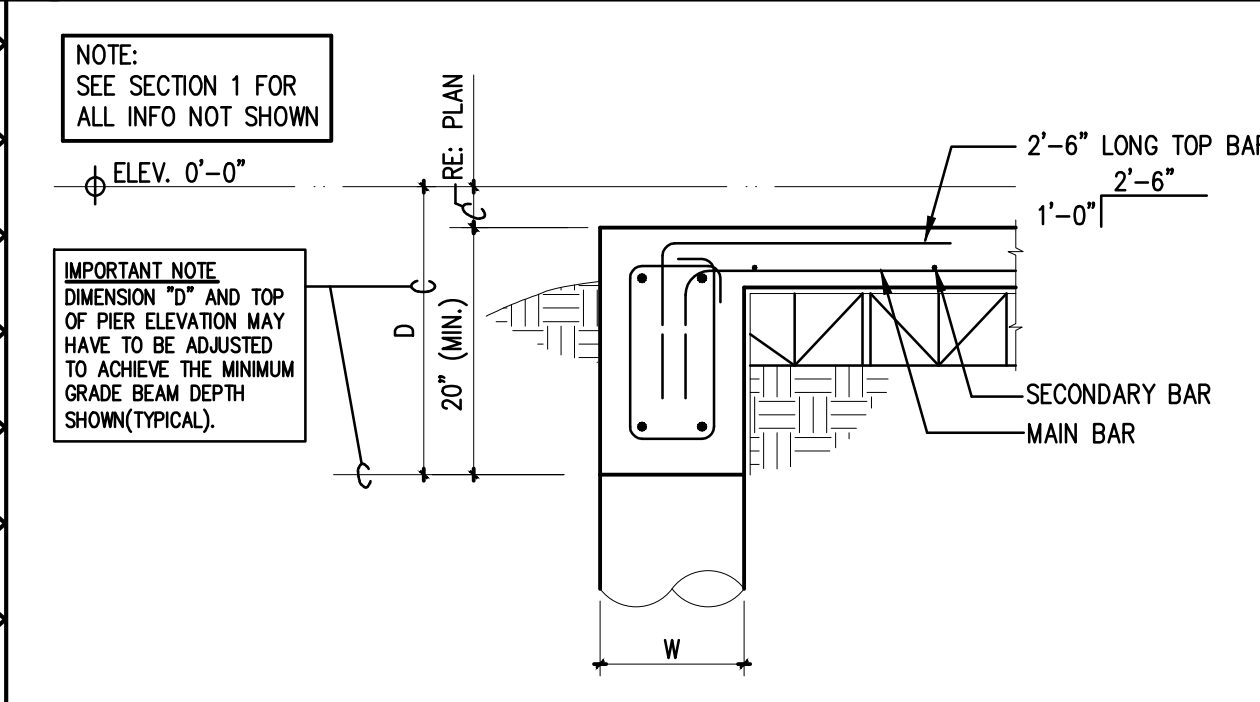

3 SECTION: TYPICAL GRADE BEAM @ DROPPED SLAB

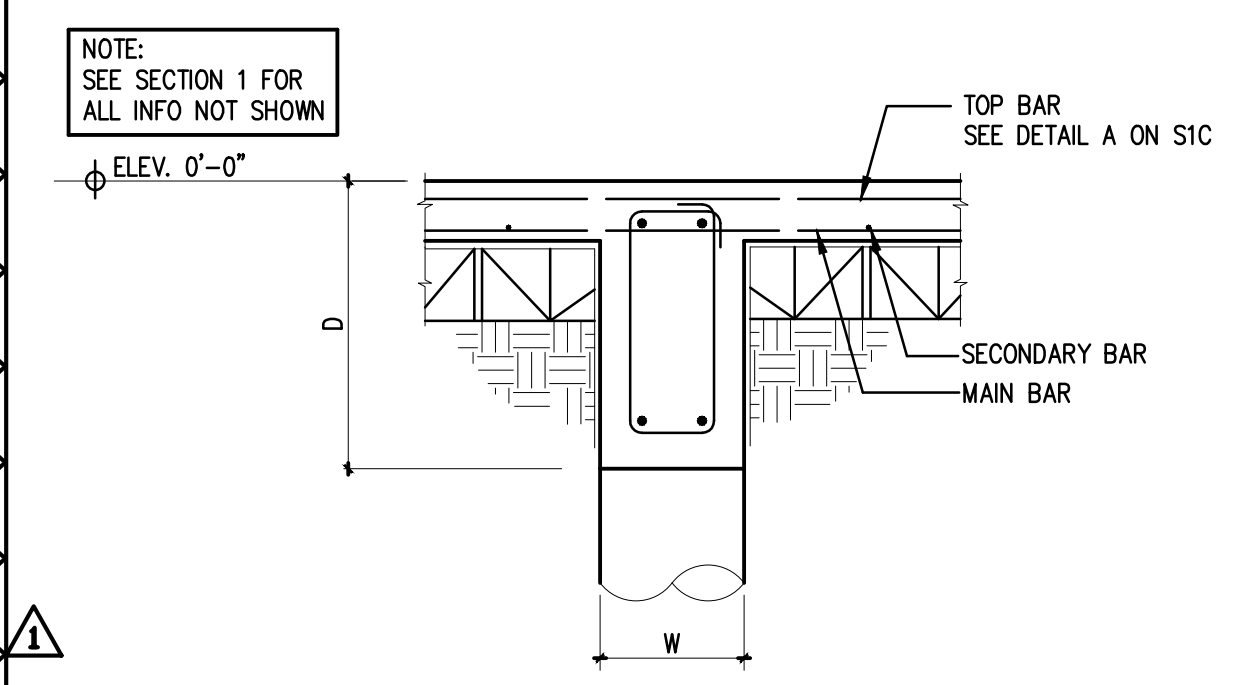

4 SECTION: TYPICAL INTERIOR GRADE BEAM

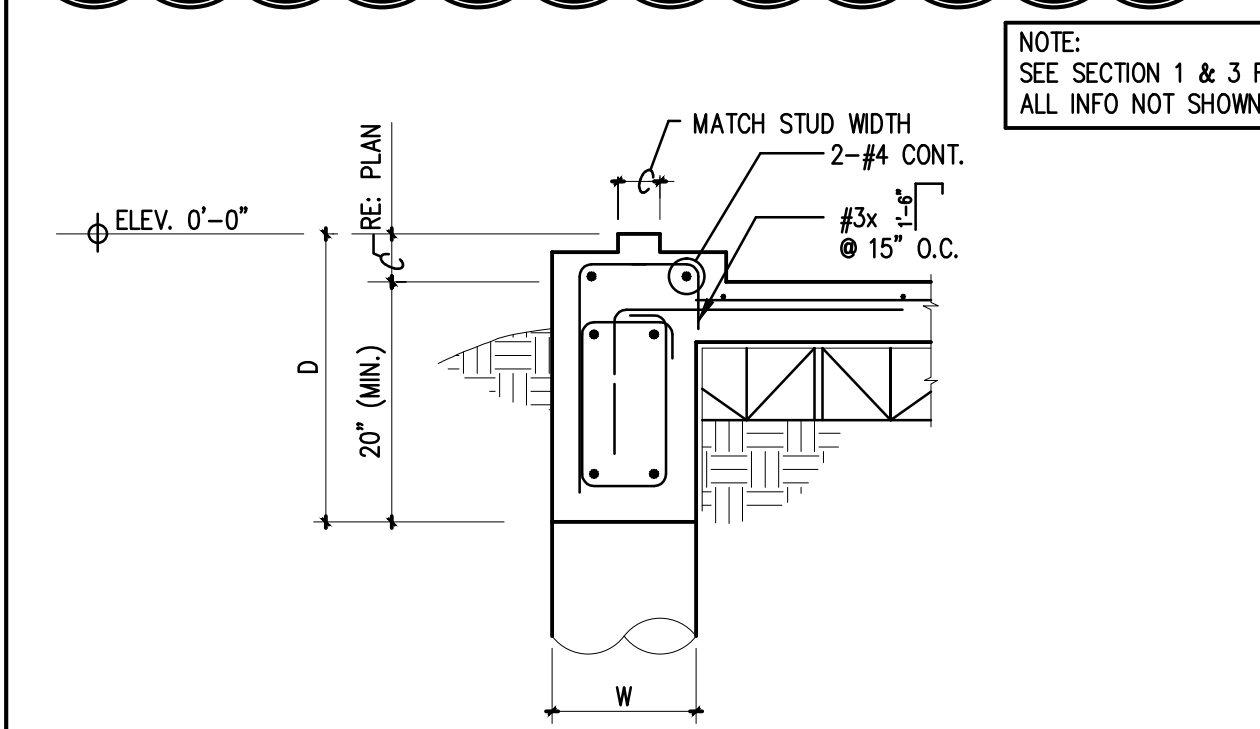

5 SECTION: TYPICAL GRADE BEAM @ PLINTH W/ BRICK BOTH SIDES

FOUNDATION SECTIONS

OPTIMUM PERSONAL CARE
1110 LAKEVIEW DRIVE
SUGAR LAND, TX. 77478

ISSUE HISTORY

DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION
08/04/14	REVISION Δ

PE BUILDINGS BRIDGES INSPECTIONS MARINE STRUCTURES CIVIL ENGINEERING & STRUCTURAL ENGINEERING

PARAMOUNT ENGINEERING LLC

7322 SOUTHWEST FREEWAY STE. 1050 HOUSTON, TX 77074
TEL : (713) 636-9977
FAX : (713) 888-9872
CEL : (713) 204-1742

TBPE REGISTRATION # F-3394

DRAWN BY: E.V. CHECKED BY: M.M.

PROJ. NO.: PE12-225

SHEET: S2

FRAMING LEGEND

JOISTS

- J612 2x6 @ 12" O.C.
- J616 2x6 @ 16" O.C.
- J619 2x6 @ 19" O.C.
- J816 2x8 @ 16" O.C.
- J1012 2x10 @ 12" O.C.
- J1016 2x10 @ 16" O.C.

BEAM (BEAM JOIST)

- BJ10 2x10
- BJ12 2x12
- BJ210 2- 2x10
- BJ212 2- 2x12
- BJ312 3- 2x12

COLUMNS (WOOD COLUMNS)

- WP44 4x4 WOOD POST
- C32-4 3-2x4 STUD
- C32-6 3-2x6 STUD

CONNECTORS

(SIMPSON STRONG-TIE OR EQUAL)

- BH1 (HU 212(MAX)) BEAM HANGER
- BH2 (HUC 212(MAX)) BEAM HANGER (CONCEALED FLANGE)
- BH3 (LQU3.63-SDS) BEAM HANGER
- BH4 (MGU5.50-SDS) BEAM HANGER
- BH5 (HGUS5.50-SDS-12GA.) BEAM HANGER
- BH6 (HGUS-12GA) BEAM HANGER
- BH6 (MGU3.63-SDS) BEAM HANGER
- BH7 (HHGU5.50-SDS) BEAM HANGER
- BH8 (HHGU7.25-SDS) BEAM HANGER
- BH9 (HGUS-12GA) BEAM HANGER
- WPC1 (CCQ/ECCQ) WOOD POST CAP
- WPB1 (CBQ) WOOD POST BASE

MEMBER DESCRIPTION

- RSB ROOF SUPPORTING BEAM
- BEAM 2.0E PARALLAM BEAM (PSL)
- BP311 3/2"x11 1/4" LSL
- BP312 3/2"x11 7/8" LSL
- BP314 3/2"x14" LSL

ALL WOOD FRAMING MEMBER SHALL BE 1 HOUR FIRE-RETARDANT TREATED

PLAN LEGEND


1. --- DESIGNATES LOCATION OF FLOOR WALLS
2. ---> DESIGNATES DIRECTION OF CEILING JOIST
3. --- DESIGNATES SHEAR WALL
4. P4 DESIGNATES SHEAR WALL TYPE. RE: SCHEDULE, NOTES, AND DETAILS ON SHEET S2.05.
5. P5 DESIGNATES SHEAR WALL HOLD-DOWN ANCHOR AT FLOOR LEVEL.
6. --- DESIGNATES BEAM HANGER, IF NOT IDENTIFIED ON PLAN, USE TYPICAL HANGERS SPECIFIED IN GENERAL NOTES.
7. □ □ DESIGNATE STEEL OR WOOD COLUMNS.
8. [Hatched Box] LOCATION OF MECH. EQUIPMENT ON CEILING

PLAN NOTES

1. ALL CEILING JOISTS SHALL BE #3 S.Y.P. (U.O.N.)
2. ALL FLOOR JOISTS SHALL BE #2 S.Y.P. (U.O.N.)
3. ALL BEAMS & HEADERS SHALL BE #2 S.Y.P. (U.O.N.)
4. ALL CEILING BEAMS & HEADERS SHALL BE 2-2x8 (U.O.N.)
5. ALL FLOOR BEAMS & HEADERS SHALL BE 2-2x12 (U.O.N.)
6. ALL WINDOWS & DOOR HEADERS ARE DROP BEAMS (U.O.N.)
7. ALL COLUMNS FROM FLOOR ABOVE MUST BE EITHER:
A. SUPPORTED ON A BEAM @ THIS LEVEL.
B. CONTINUED TO SLAB BELOW. (MATCH SIZES)
8. RE: SHEET S7,S8 FOR ALL FRAMING NOTES, DETAILS, AND SCHEDULES.

GENERAL NOTES: COORDINATION W/ ARCH. DWGS.

1. CONTRACTOR SHALL REVIEW ARCHITECTURAL AND STRUCTURAL DRAWINGS JOINTLY PRIOR TO CONSTRUCTION, TO ENSURE COORDINATION OF ALL PHASES OF CONSTRUCTION DESCRIBED IN THESE DRAWINGS. DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF BOTH ARCHITECT AND ENGINEER, PRIOR TO PROCEEDING WITH CONSTRUCTION WORK.
2. THE FOLLOWING ITEMS, IN PARTICULAR, HAVE TO BE CLOSELY COORDINATED BETWEEN ARCHITECTURAL AND STRUCTURAL DRAWINGS:
A. ALL DIMENSIONS;
B. SLAB AND FLOOR ELEVATIONS, SLOPES, AND LOCATION AND DIMENSIONS OF ANY RECESSES, INCLUDING THOSE INTENDED FOR SHOWERS, ELEVATORS, FLOORING MATERIALS, ETC.
C. CURBS AND VENEER LEDGES;
D. CEILING HEIGHTS AND CEILING CONDITIONS;
E. ROOF GEOMETRY AND SLOPES.

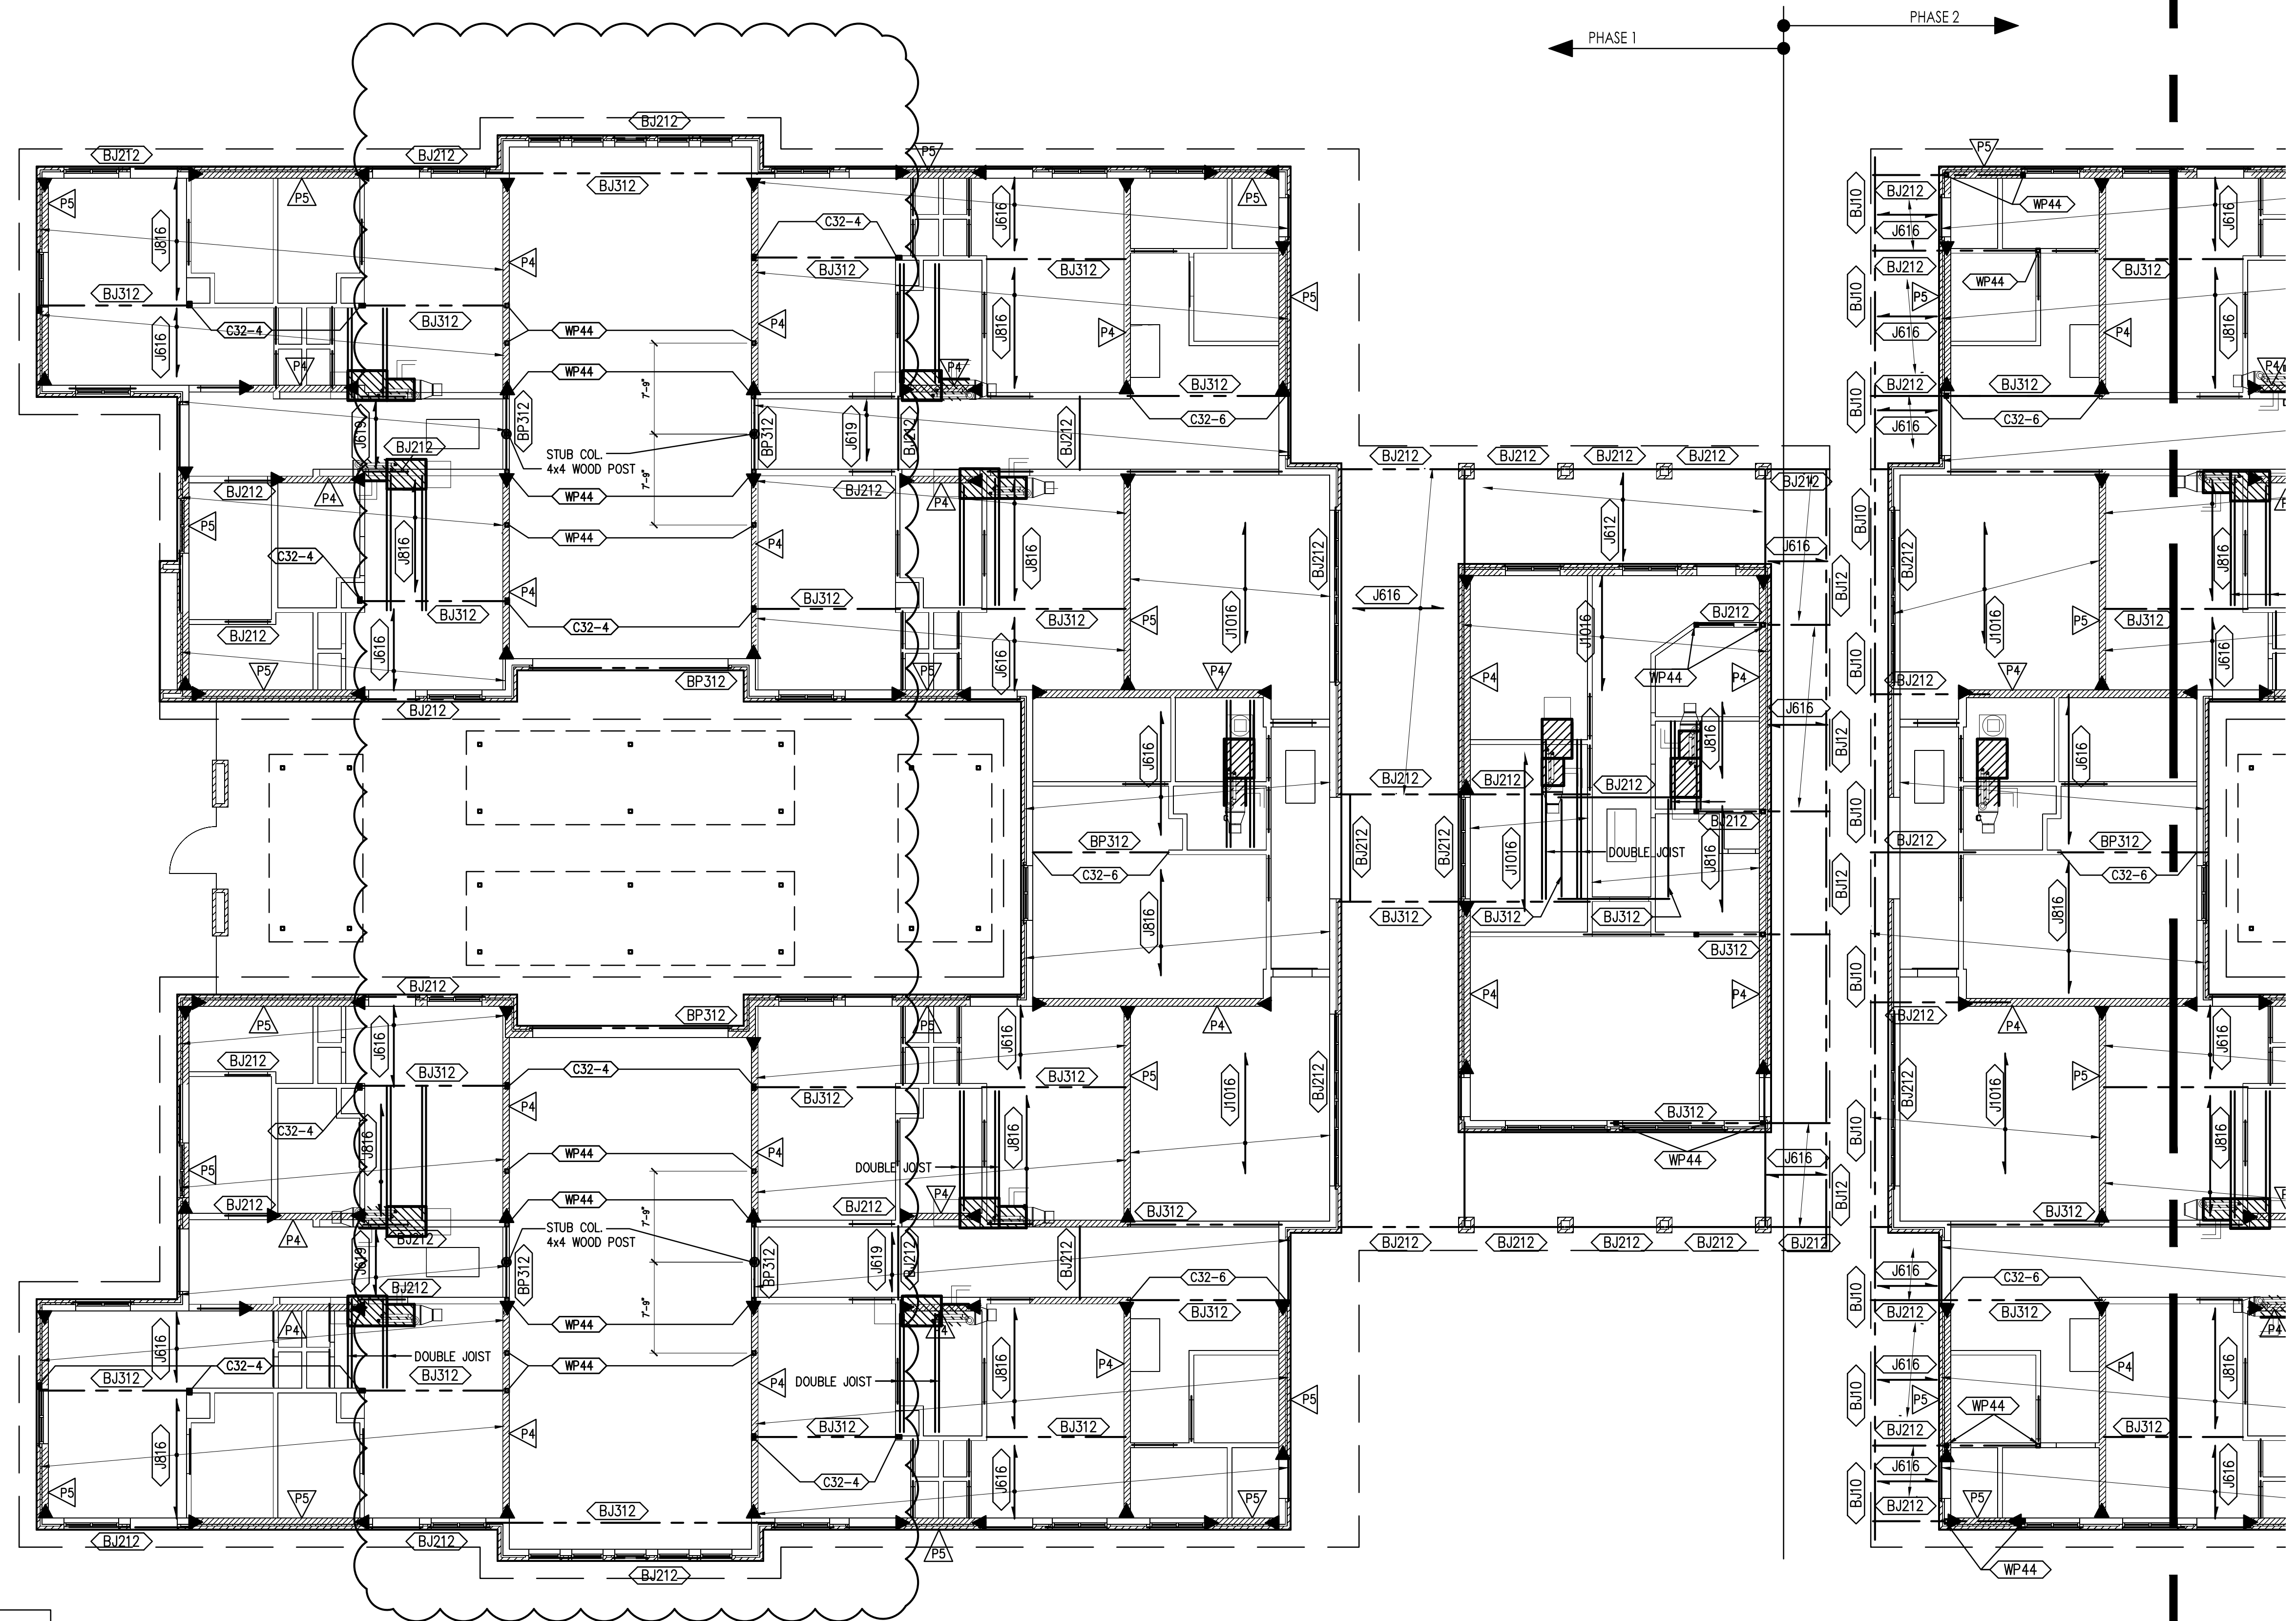

CEILING FRAMING PLAN

SCALE: 1/8" = 1'-0"

CONTRACTOR TO VERIFY ALL DIMENSIONS, ELEVATIONS, AND COORDINATE DETAILS WITH ARCHITECTURAL DRAWINGS. ALL DIMENSIONS & ELEVATION ON ARCHITECTURAL DRAWINGS SHALL GOVERN. IT IS CONTRACTOR'S RESPONSIBILITY TO REPORT TO ENGINEER ABOUT DISCREPANCY IN DRAWINGS PRIOR TO FABRICATION & BIDDING.

PROVIDE 3 STUDS BOLTED TOGETHER (MATCH WALL STUD SIZE) AT EACH END OF POOR/WINDOW HEADERS.

CEILING FRAMING PLAN

OPTIMUM PERSONAL CARE
1110 LAKEVIEW DRIVE
SUGAR LAND, TX. 77478

ISSUE HISTORY

DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION
09/16/14	REVISION Δ

09/16/13

Z:\SEAL.jpg

PE BUILDINGS
BRIDGES
INSPECTIONS
MARINE STRUCTURES
CIVIL ENGINEERING &
STRUCTURAL ENGINEERING

**PARAMOUNT
ENGINEERING
LLC**

7322 SOUTHWEST FREEWAY STE. 1050
HOUSTON, TX 77074

TEL : (713) 636-9977
FAX : (713) 888-9872
CEL : (713) 204-1742

TBPE REGISTRATION # F-3394

DRAWN BY: E.V. H.P. CHECKED BY: M.M.

PROJ. NO.: PE12-225

SHEET: **S3**

CEILING FRAMING PLAN

OPTIMUM PERSONAL CARE
 1110 LAKEVIEW DRIVE
 SUGAR LAND, TX. 77478

ISSUE HISTORY

DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION

PE BUILDINGS
 BRIDGES
 INSPECTIONS
 MARINE STRUCTURES
 CIVIL ENGINEERING &
 STRUCTURAL ENGINEERING

**PARAMOUNT
 ENGINEERING
 LLC**


7322 SOUTHWEST FREEWAY STE. 1050
 HOUSTON, TX 77074
 TEL. : (713) 636-9977
 FAX : (713) 888-9872
 CEL. : (713) 204-1742

TBPE REGISTRATION # F-3394

DRAWN BY: E.V. H.P. CHECKED BY: M.M.

PROJ. NO.: PE12-225

SHEET: **S4**

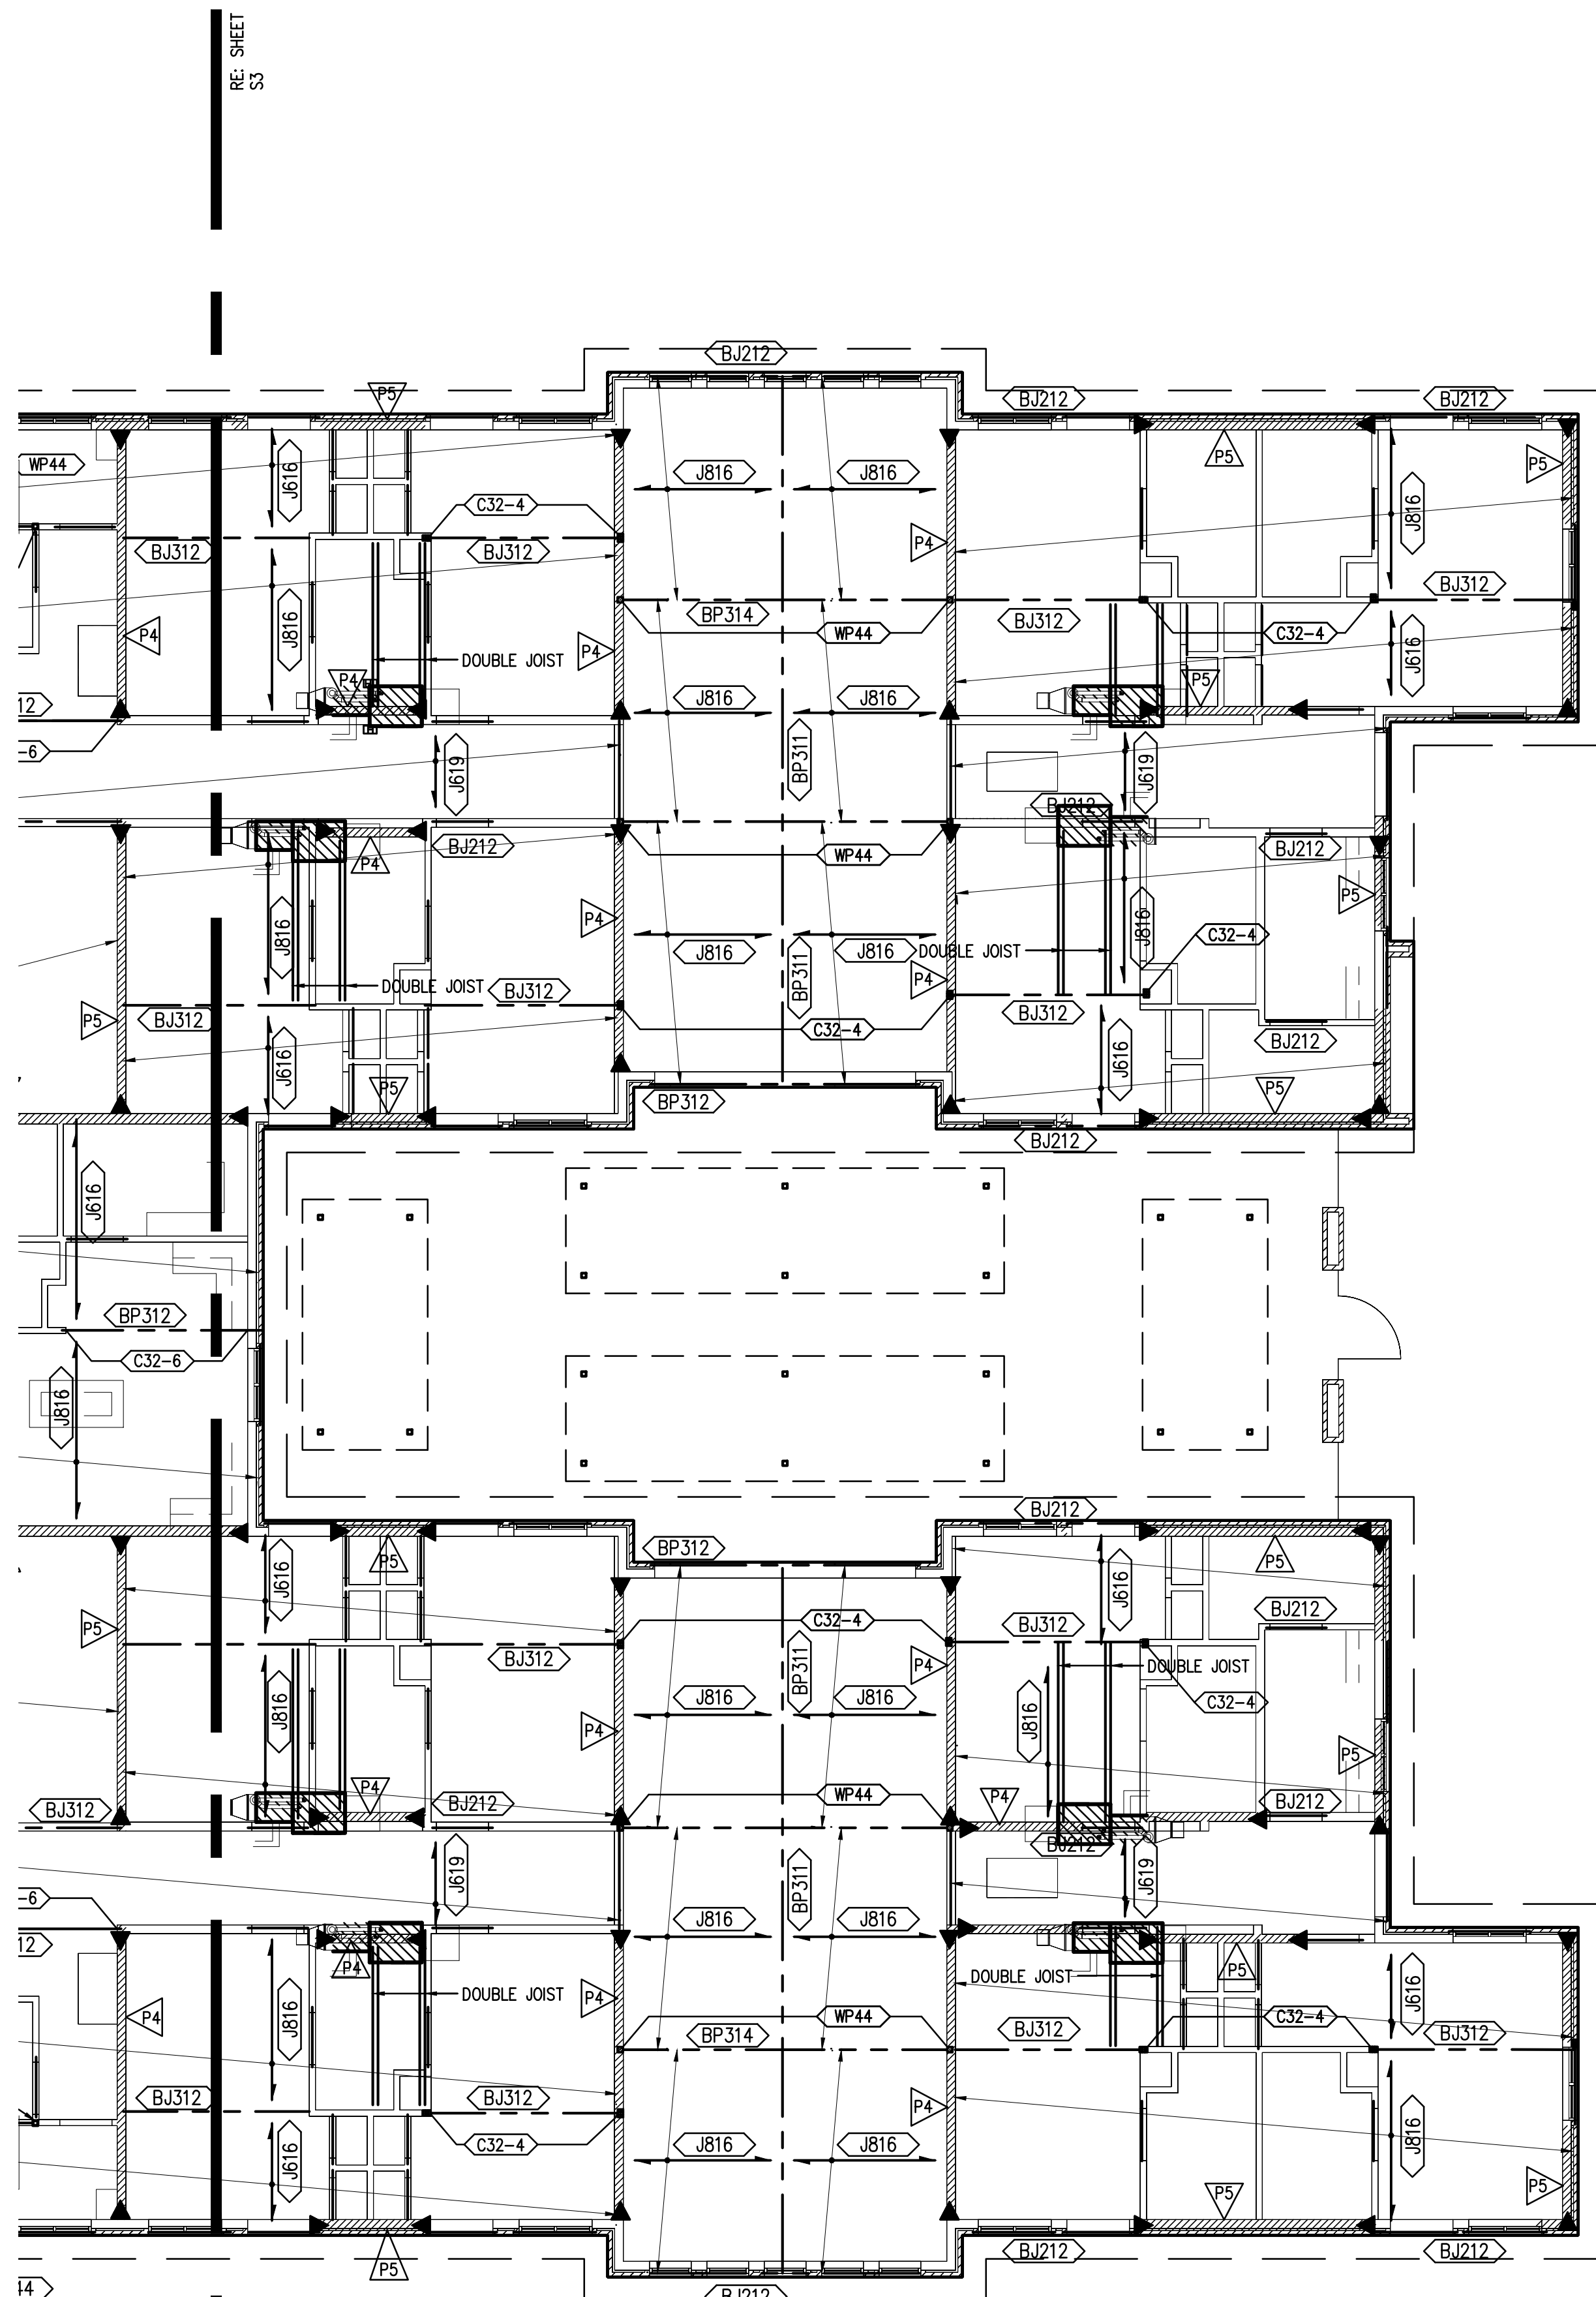

- FRAMING LEGEND**
- JOISTS**
- J612 2x6 @ 12" O.C.
 - J616 2x6 @ 16" O.C.
 - J619 2x6 @ 19" O.C.
 - J816 2x8 @ 16" O.C.
 - J1012 2x10 @ 12" O.C.
 - J1016 2x10 @ 16" O.C.
- BEAM (BEAM JOIST)**
- BJ210 2- 2x10
 - BJ10 2x10
 - BJ12 2x12
 - BJ212 2- 2x12
 - BJ312 3- 2x12
- COLUMNS (WOOD COLUMNS)**
- WP44 4x4 WOOD POST
 - C32-4 3-2x4 STUD
 - C32-6 3-2x6 STUD
- CONNECTORS (SIMPSON STRONG-TIE OR EQUAL)**
- BH1 (HU 212(MAX)) BEAM HANGER
 - BH2 (HUC 212(MAX)) BEAM HANGER (CONCEALED FLANGE)
 - BH3 (LGU3.63-SDS) BEAM HANGER
 - BH4 (MGU5.50-SDS) BEAM HANGER
 - BH5 (HGUS.50-SDS-12GA.) BEAM HANGER
 - BH6 (HGUS-12GA) BEAM HANGER
 - BH6 (MGU3.63-SDS) BEAM HANGER
 - BH7 (HHGU5.50-SDS) BEAM HANGER
 - BH8 (HHGU7.25-SDS) BEAM HANGER
 - BH9 (HGUS-12GA) BEAM HANGER
 - WPC1 (CCQ/ECCQ) WOOD POST CAP
 - WPB1 (CBQ) WOOD POST BASE
- MEMBER DESCRIPTION**
- RSB ROOF SUPPORTING BEAM
 - BEAM 2.0E PARALLAM BEAM (PSL)
 - BP311 3/2"x11/4" LSL
 - BP312 3/2"x11/8" LSL
 - BP314 3/2"x14" LSL

- PLAN LEGEND**
- DESIGNATES LOCATION OF FLOOR WALLS
 - DESIGNATES DIRECTION OF CEILING JOIST
 - DESIGNATES SHEAR WALL
 - DESIGNATES SHEAR WALL TYPE. RE: SCHEDULE, NOTES, AND DETAILS ON SHEET S2.05.
 - DESIGNATES SHEAR WALL HOLD-DOWN ANCHOR AT FLOOR LEVEL.
 - DESIGNATES BEAM HANGER, IF NOT IDENTIFIED ON PLAN, USE TYPICAL HANGERS SPECIFIED IN GENERAL NOTES.
 - DESIGNATE STEEL OR WOOD COLUMNS.
 - LOCATION OF MECH. EQUIPMENT ON CEILING

- PLAN NOTES**
- ALL CEILING JOISTS SHALL BE #3 S.Y.P. (U.O.N.)
 - ALL FLOOR JOISTS SHALL BE #2 S.Y.P. (U.O.N.)
 - ALL BEAMS & HEADERS SHALL BE #2 S.Y.P. (U.O.N.)
 - ALL CEILING BEAMS & HEADERS SHALL BE 2-2x8 (U.O.N.)
 - ALL FLOOR BEAMS & HEADERS SHALL BE 2-2x12 (U.O.N.)
 - ALL WINDOWS & DOOR HEADERS ARE DROP BEAMS (U.O.N.)
 - TRUSS SUPPLIER MAY CHOOSE PARALLAM OR GLU-LAM BEAMS INSTEAD OF TRUSSES UNDER SOME LOAD BEARING WALLS. IN THIS CASE, BEAM DESIGN SHALL BE BY TRUSS MANUFACTURER, WHO SHALL ALSO DESIGNATE REQUIRED COLUMNS UNDER THESE BEAMS. (RE: COLUMN SCHEDULE ON SHEET S2-04)
 - ALL COLUMNS FROM FLOOR ABOVE MUST BE EITHER:
 - SUPPORTED ON A BEAM @ THIS LEVEL
 - CONTINUED TO SLAB BELOW. (MATCH SIZES)
 - RE: SHEET S2-04 FOR ALL FRAMING NOTES, DETAILS, AND SCHEDULES.

ALL WOOD FRAMING MEMBER SHALL BE 1 HOUR FIRE-RETARDANT TREATED

- GENERAL NOTES: COORDINATION W/ ARCH. DWGS.**
- CONTRACTOR SHALL REVIEW ARCHITECTURAL AND STRUCTURAL DRAWINGS JOINTLY PRIOR TO CONSTRUCTION, TO ENSURE COORDINATION OF ALL PHASES OF CONSTRUCTION DESCRIBED IN THESE DRAWINGS. DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF BOTH ARCHITECT AND ENGINEER, PRIOR TO PROCEEDING WITH CONSTRUCTION WORK.
 - THE FOLLOWING ITEMS, IN PARTICULAR, HAVE TO BE CLOSELY COORDINATED BETWEEN ARCHITECTURAL AND STRUCTURAL DRAWINGS:
 - ALL DIMENSIONS;
 - SLAB AND FLOOR ELEVATIONS, SLOPES, AND LOCATION AND DIMENSIONS OF ANY RECESSES, INCLUDING THOSE INTENDED FOR SHOWERS, ELEVATORS, FLOORING MATERIALS, ETC.
 - CURBS AND VENEER LEDGES;
 - CEILING HEIGHTS AND CEILING CONDITIONS;
 - ROOF GEOMETRY AND SLOPES.

IMPORTANT NOTE:
 ALL EXTERIOR WALL SHALL BE SHEATED WITH 1/2" PLYWOOD OR OSB.

STUD WALL SCHEDULE

2x4 @ 16" O.C. STUD WALL
2x6 @ 16" O.C. STUD SHEAR WALL

NOTE: ALL EXTERIOR WALLS SHALL BE 2x6 @ 16" O.C. STUD WALL

CONTRACTOR TO VERIFY ALL DIMENSIONS, ELEVATIONS, AND COORDINATE DETAILS WITH ARCHITECTURAL DRAWINGS. ALL DIMENSIONS & ELEVATION ON ARCHITECTURAL DRAWINGS SHALL GOVERN. IT IS CONTRACTOR'S RESPONSIBILITY TO REPORT TO ENGINEER ABOUT DISCREPANCY IN DRAWINGS PRIOR TO FABRICATION & BIDDING.

PROVIDE 3 STUDS BOLTED TOGETHER (MATCH WALL STUD SIZE) AT EACH END OF POOR/WINDOW HEADERS.

CEILING FRAMING PLAN
 SCALE: 1/8" = 1'-0"

ROOF FRAMING PLAN

OPTIMUM PERSONAL CARE
1110 LAKEVIEW DRIVE
SUGAR LAND, TX. 77478

ISSUE HISTORY

DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION
09/16/14	REVISION Δ

09/16/13

Z:\SEAL.jpg

PE BUILDINGS
BRIDGES
INSPECTIONS
MARINE STRUCTURES
CIVIL ENGINEERING &
STRUCTURAL ENGINEERING

PARAMOUNT
ENGINEERING
LLC

7322 SOUTHWEST FREEWAY STE. 1050
HOUSTON, TX 77074

TEL : (713) 636-9977
FAX : (713) 888-9872
CEL : (713) 204-1742

TBPE REGISTRATION # F-3394

DRAWN BY: E.V. H.P. CHECKED BY: M.M.

PROJ. NO.: PE12-225

SHEET: S5

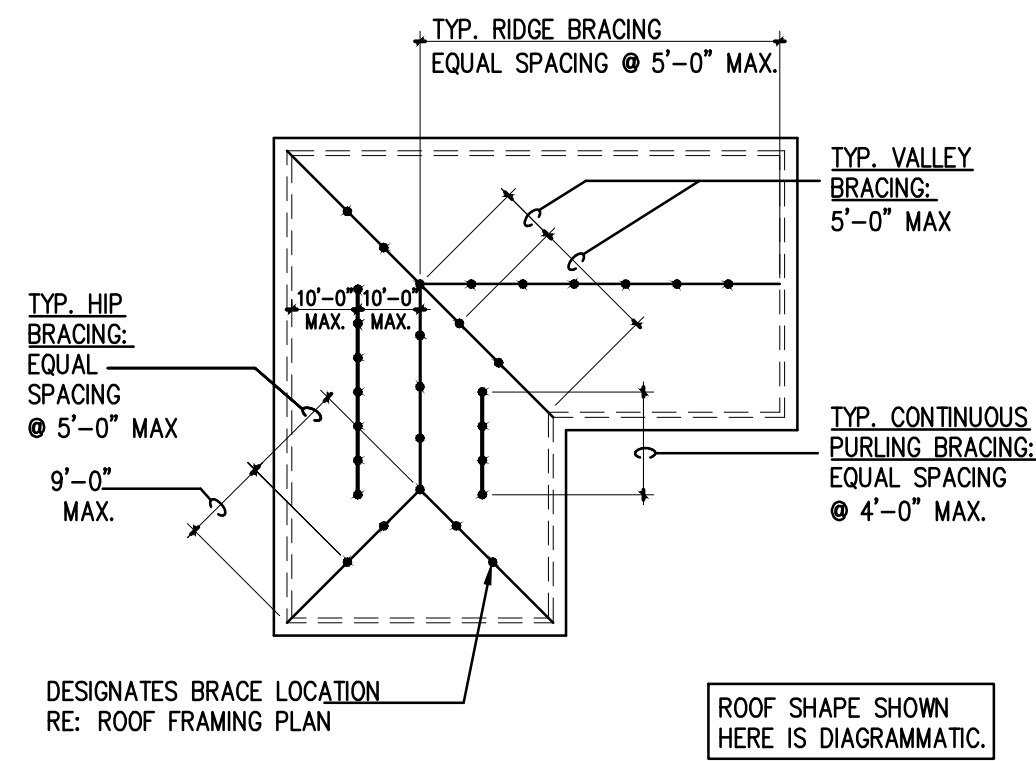
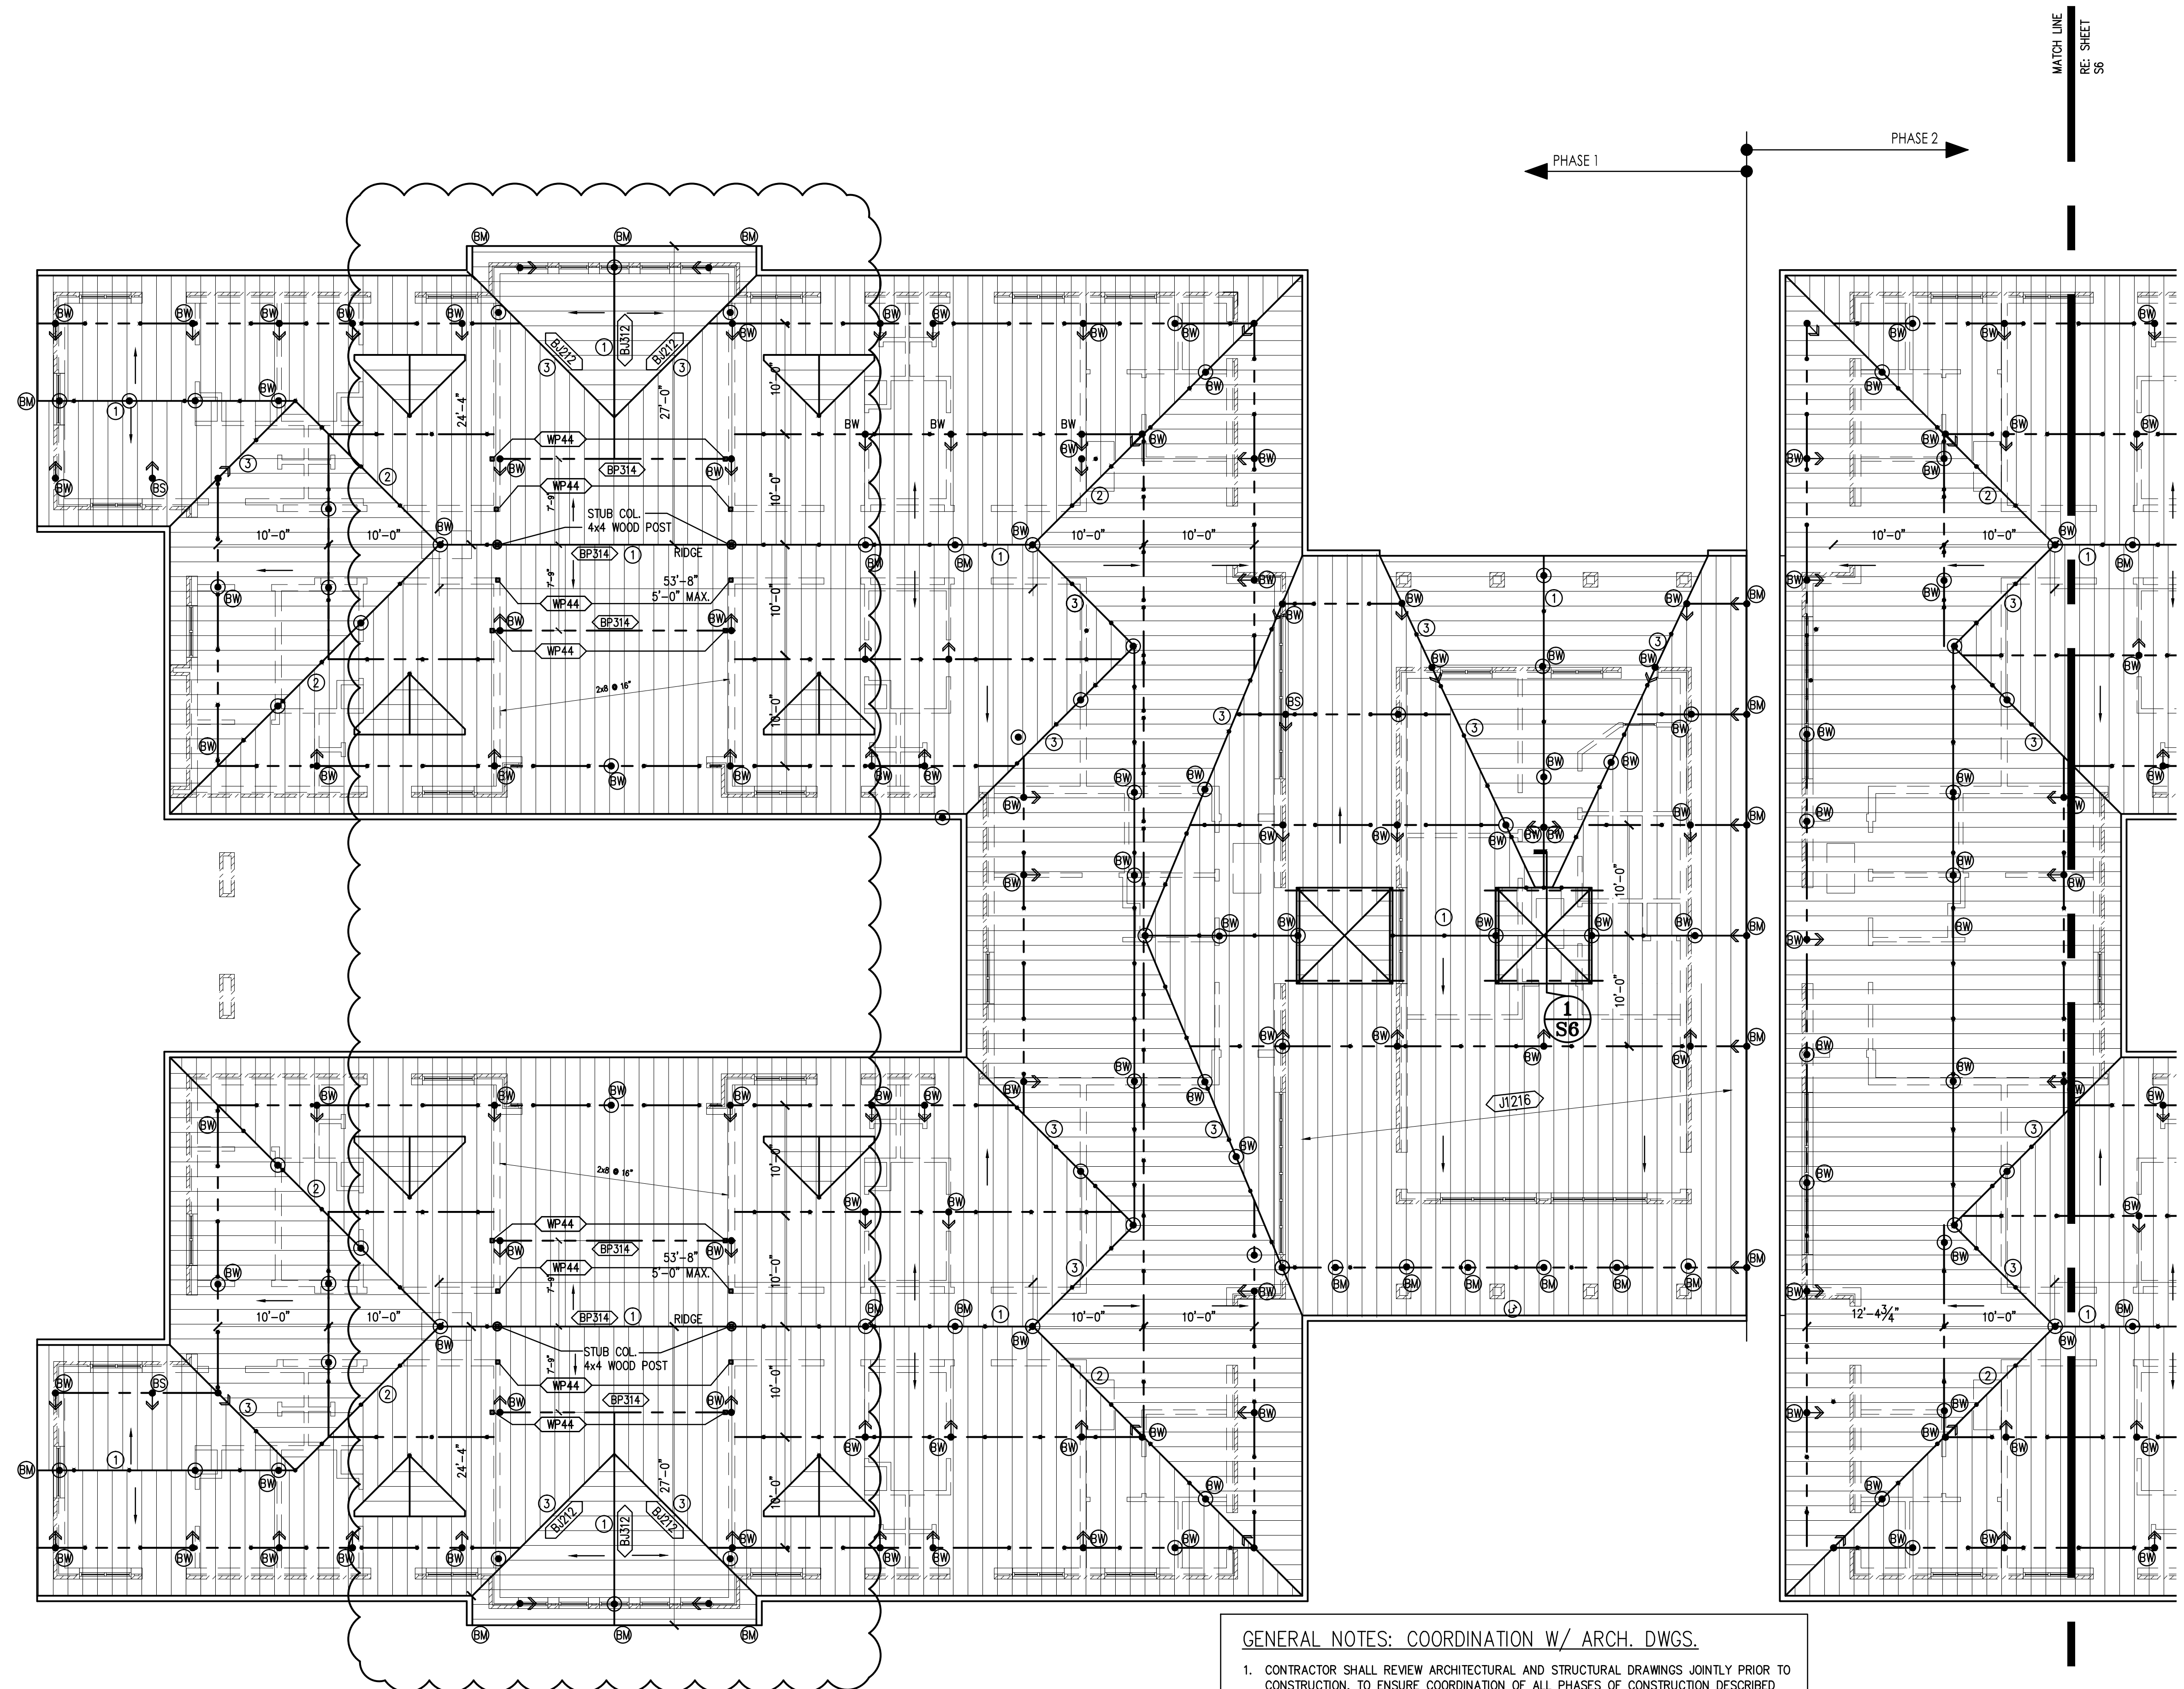


DIAGRAM: TYPICAL BRACE LOCATIONS
(NOT TO SCALE)

PLAN NOTES

- ROOF FRAMING IS DESIGNED FOR METALIC ROOF @ 6.5 PSF.
- ➔ DESIGNATES BRACE (APPROXIMATELY IN THE INDICATED DIRECTION)
- ⊙ INDICATES A VERTICAL (OR NEARLY VERTICAL) BRACE TO SUPPORTING MEMBER BELOW.
- BRACE SUPPORT DESIGNATION:
(ALL BRACING TO WALLS UNLESS OTHERWISE NOTED)
⊙ BRACE TO BEAM
⊙ BRACE TO STRONGBACK
⊙ BRACE TO WALL
- ALL RAFTERS ARE 2x6 #3 S.Y.P. AT 16" O.C. U.O.N.
- PURLINS SHALL BE 2x6 CONTINUOUS MEMBER.
- DEPTH OF RIDGE BEAM, HIP OR VALLEY RAFTER:
A. SHALL BE TWO ONE SIZE WIDER THAN THE LARGEST RAFTER FRAMING INTO IT (EXAMPLE: 2-2x8 BEAM FOR 2x6 RAFTER);
B. SHALL MATCH OR EXCEED THE CUT END OF THE RAFTER.
- PROVIDE DOUBLE FRAMING @ EDGES OF ALL ROOF OPENINGS LARGER THAN 24".
- PROVIDE DOUBLE RAFTERS UNDER ALL DORMER WALL (U.O.N.).
- ROOF DECKING TO BE 5/8" C.D.X. WITH PANEL SPAN RATING OF 24-0.
RE: GENERAL NOTES FOR OTHER REQUIREMENTS.
- RAFTERS SHALL BE NAILED TO ADJACENT CEILING JOISTS TO FORM A CONTINUOUS TIE BETWEEN EXTERIOR WALLS WHEN SUCH JOISTS ARE PARALLEL TO THE RAFTERS. WHERE NOT PARALLEL, RAFTER TIES SHALL BE SPACED NOT MORE THAN 48" O.C.
- PROVIDE 2x6 COLLAR TIES AT EVERY OTHER RAFTER (UPPER 1/2 OF ROOF).
- RE: ARCH. DWG'S FOR ROOF SLOPES & OTHER DATA NOT CONTAINED HEREIN.
- SHEETS S7-S8 FOR FRAMING GENERAL NOTES, TYP. DETAILS & SCHEDULES.

ROOF SLOPE = SEE ARCH.
COORDINATE ROOF SLOPE & GEOMETRY W/ ARCH. DRAWINGS,
WHICH TAKE PRECEDENCE OVER ANY SUCH INFORMATION SHOWN HEREIN.

VERIFY ALL SLOPES & ELEVATION
WITH ARCHITECTURAL DRAWINGS
PRIOR TO CONSTRUCTION

- ① RIDGE 2-2x8
- ② HIP 2-2x8
- ③ VALEY 2-2x8
- ⊙ J1216 2x12 @ 16" O.C.
- ⊙ BJ212 2- 2x12
- ⊙ WP44 4x4 WOOD POST

CONTRACTOR TO VERIFY ALL DIMENSIONS, ELEVATIONS, AND
COORDINATE DETAILS WITH ARCHITECTURAL DRAWINGS. ALL
DIMENSIONS & ELEVATION ON ARCHITECTURAL DRAWINGS
SHALL GOVERN. IT IS CONTRACTOR'S RESPONSIBILITY TO
REPORT TO ENGINEER ABOUT DISCREPANCY IN DRAWINGS
PRIOR TO FABRICATION & BIDDING.

ROOF FRAMING PLAN
SCALE: 1/8" = 1'-0"

GENERAL NOTES: COORDINATION W/ ARCH. DWGS.

- CONTRACTOR SHALL REVIEW ARCHITECTURAL AND STRUCTURAL DRAWINGS JOINTLY PRIOR TO CONSTRUCTION, TO ENSURE COORDINATION OF ALL PHASES OF CONSTRUCTION DESCRIBED IN THESE DRAWINGS. DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF BOTH ARCHITECT AND ENGINEER, PRIOR TO PROCEEDING WITH CONSTRUCTION WORK.
- THE FOLLOWING ITEMS, IN PARTICULAR, HAVE TO BE CLOSELY COORDINATED BETWEEN ARCHITECTURAL AND STRUCTURAL DRAWINGS:
 - ALL DIMENSIONS;
 - SLAB AND FLOOR ELEVATIONS, SLOPES, AND LOCATION AND DIMENSIONS OF ANY RECESSES, INCLUDING THOSE INTENDED FOR SHOWERS, ELEVATORS, FLOORING MATERIALS, ETC.
 - CURBS AND VENEER LEDGES;
 - CEILING HEIGHTS AND CEILING CONDITIONS;
 - ROOF GEOMETRY AND SLOPES.
- IT'S THE OWNER'S RESPONSIBILITY TO HIRE A REPUTABLE CONTRACTOR WHO CAN COORDINATE BETWEEN ARCHITECTURAL & STRUCTURAL DRAWINGS FOR ACCURACY

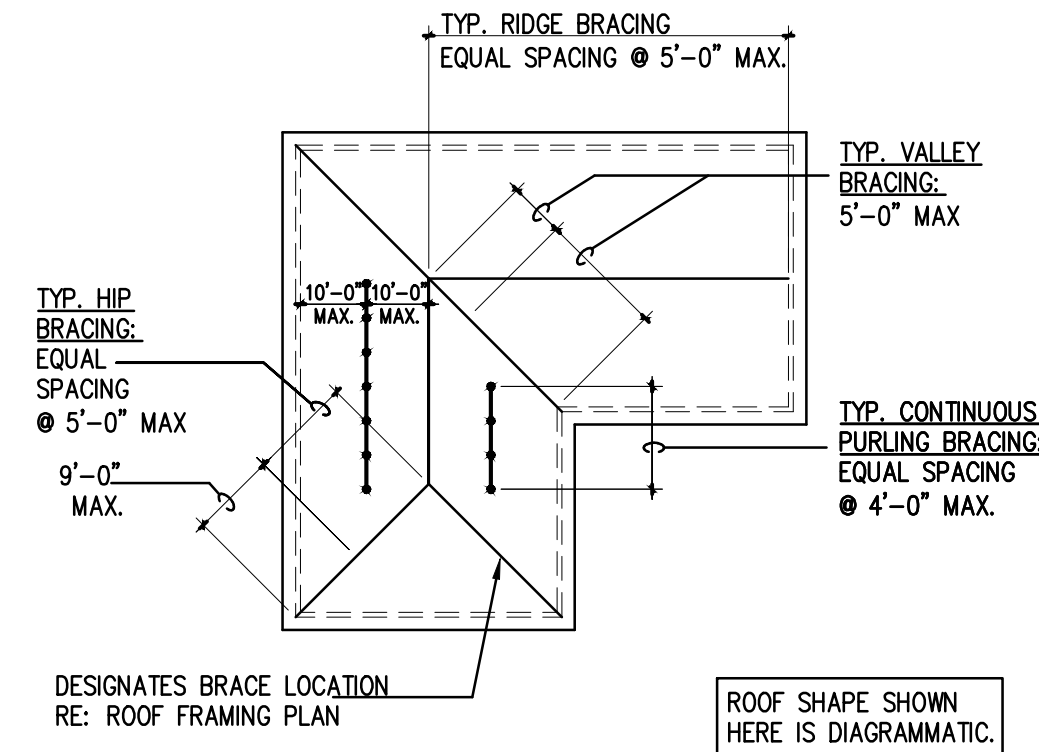
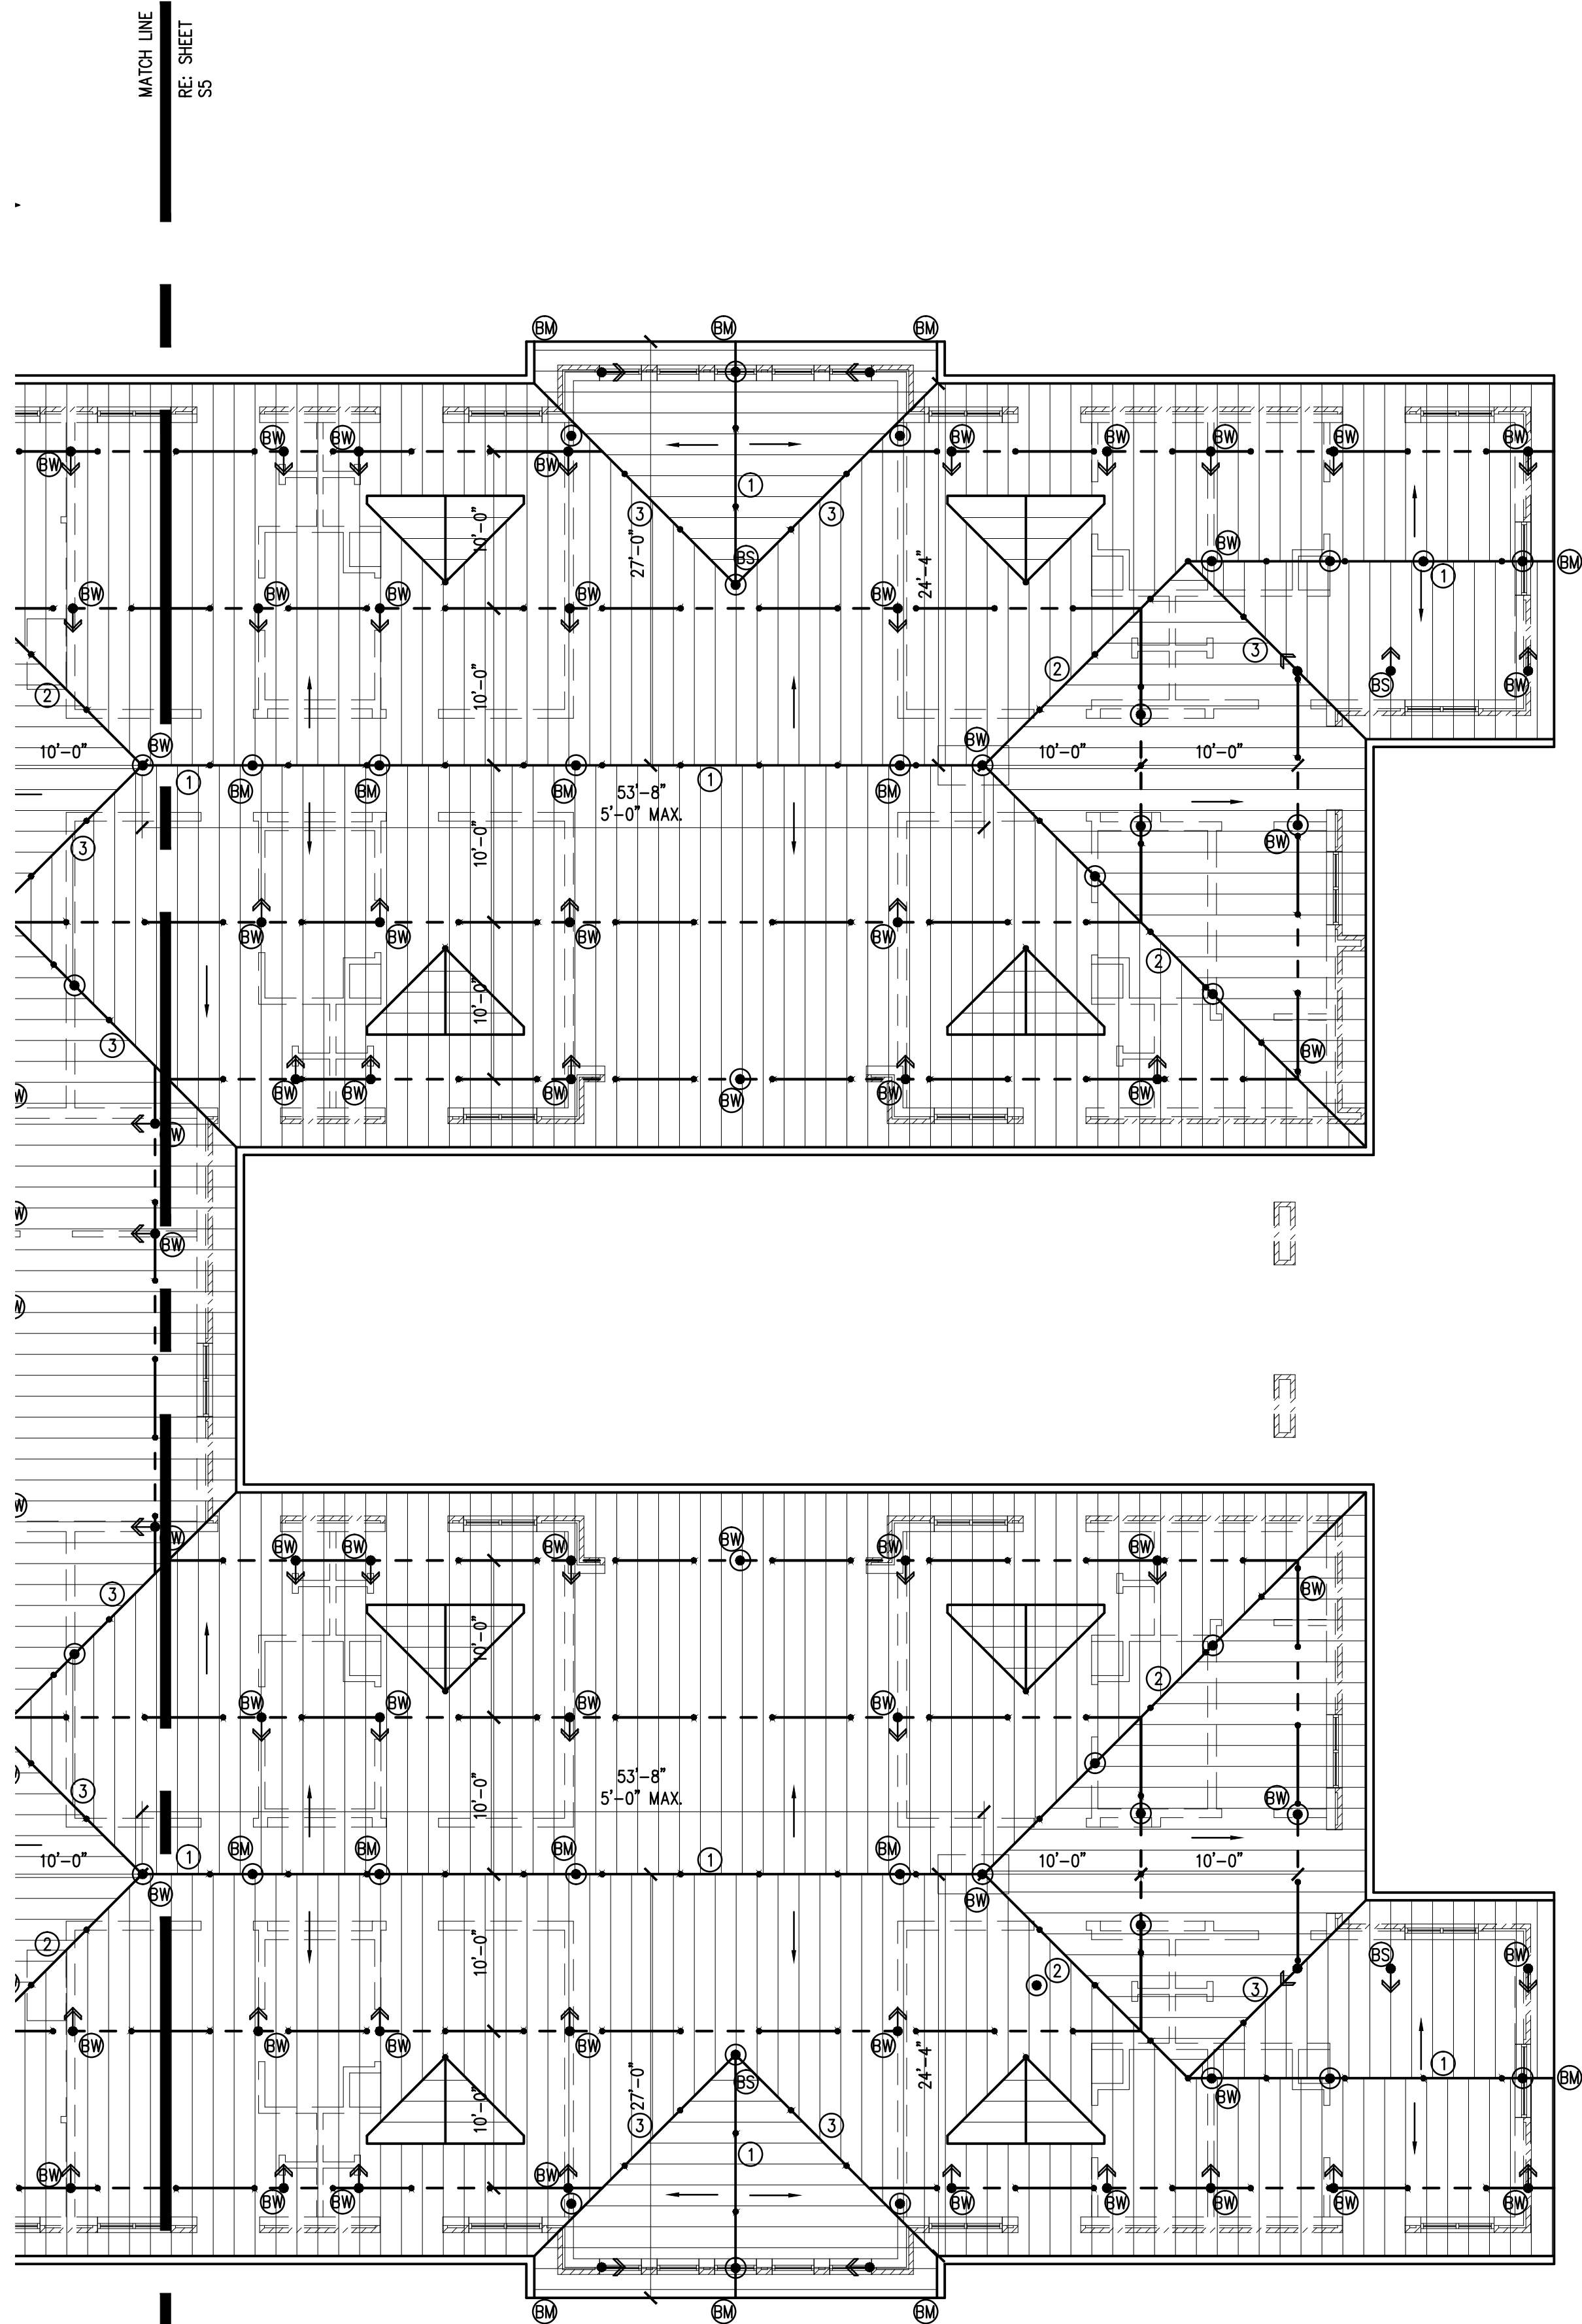


DIAGRAM: TYPICAL BRACE LOCATIONS
(NOT TO SCALE)


- PLAN NOTES**
- ROOF FRAMING IS DESIGNED FOR COMPOSITION SHINGLE ROOF @ 6.5 PSF.
 - DESIGNATES BRACE (APPROXIMATELY IN THE INDICATED DIRECTION)
 - INDICATES A VERTICAL (OR NEARLY VERTICAL) BRACE TO SUPPORTING MEMBER BELOW.
 - BRACE SUPPORT DESIGNATION:
(ALL BRACING TO WALLS UNLESS OTHERWISE NOTED)
EM BRACE TO BEAM
ES BRACE TO STRONGBACK
EW BRACE TO WALL
 - ALL RAFTERS ARE 2x6 #3 S.Y.P. AT 16" O.C. U.O.N.
 - PURLINS SHALL BE 2x6 CONTINUOUS MEMBER.
 - DEPTH OF RIDGE BEAM, HIP OR VALLEY RAFTER:
A. SHALL BE ONE SIZE WIDER THAN THE LARGEST RAFTER FRAMING INTO IT (EXAMPLE: 2x8 BEAM FOR 2x6 RAFTER);
B. SHALL MATCH OR EXCEED THE CUT END OF THE RAFTER.
 - PROVIDE DOUBLE FRAMING @ EDGES OF ALL ROOF OPENINGS LARGER THAN 24".
 - PROVIDE DOUBLE RAFTERS UNDER ALL DORMER WALL (U.O.N.).
 - ROOF DECKING TO BE 5/8" C.D.X. WITH PANEL SPAN RATING OF 24-0.
RE: GENERAL NOTES FOR OTHER REQUIREMENTS.
 - RAFTERS SHALL BE NAILED TO ADJACENT CEILING JOISTS TO FORM A CONTINUOUS TIE BETWEEN EXTERIOR WALLS WHEN SUCH JOISTS ARE PARALLEL TO THE RAFTERS, WHERE NOT PARALLEL, RAFTER TIES SHALL BE SPACED NOT MORE THAN 48" O.C.
 - PROVIDE 2x6 COLLAR TIES AT EVERY OTHER RAFTER (UPPER 1/2 OF ROOF).
 - RE: ARCH. DWGS FOR ROOF SLOPES & OTHER DATA NOT CONTAINED HEREIN.
 - RE: SHEETS S7-S8 FOR FRAMING GENERAL NOTES, TYP. DETAILS & SCHEDULES.

- GENERAL NOTES: COORDINATION W/ ARCH. DWGS.**
- CONTRACTOR SHALL REVIEW ARCHITECTURAL AND STRUCTURAL DRAWINGS JOINTLY PRIOR TO CONSTRUCTION, TO ENSURE COORDINATION OF ALL PHASES OF CONSTRUCTION DESCRIBED IN THESE DRAWINGS. DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF BOTH ARCHITECT AND ENGINEER, PRIOR TO PROCEEDING WITH CONSTRUCTION WORK.
 - THE FOLLOWING ITEMS, IN PARTICULAR, HAVE TO BE CLOSELY COORDINATED BETWEEN ARCHITECTURAL AND STRUCTURAL DRAWINGS:
A. ALL DIMENSIONS;
B. SLAB AND FLOOR ELEVATIONS, SLOPES, AND LOCATION AND DIMENSIONS OF ANY RECESSES, INCLUDING THOSE INTENDED FOR SHOWERS, ELEVATORS, FLOORING MATERIALS, ETC.
C. CURBS AND VENEER LEDGES;
D. CEILING HEIGHTS AND CEILING CONDITIONS;
E. ROOF GEOMETRY AND SLOPES.
 - IT'S THE OWNER'S RESPONSIBILITY TO HIRE A REPUTABLE CONTRACTOR WHO CAN COORDINATE BETWEEN ARCHITECTURAL & STRUCTURAL DRAWINGS FOR ACCURACY

ROOF SLOPE = SEE ARCH.
COORDINATE ROOF SLOPE & GEOMETRY W/ ARCH. DRAWINGS,
WHICH TAKE PRECEDENCE OVER ANY SUCH INFORMATION SHOWN HEREIN.

VERIFY ALL SLOPES & ELEVATION
WITH ARCHITECTURAL DRAWINGS
PRIOR TO CONSTRUCTION

- ① RIDGE 2-2x8
- ② HIP 2-2x8
- ③ VALEY 2-2x8

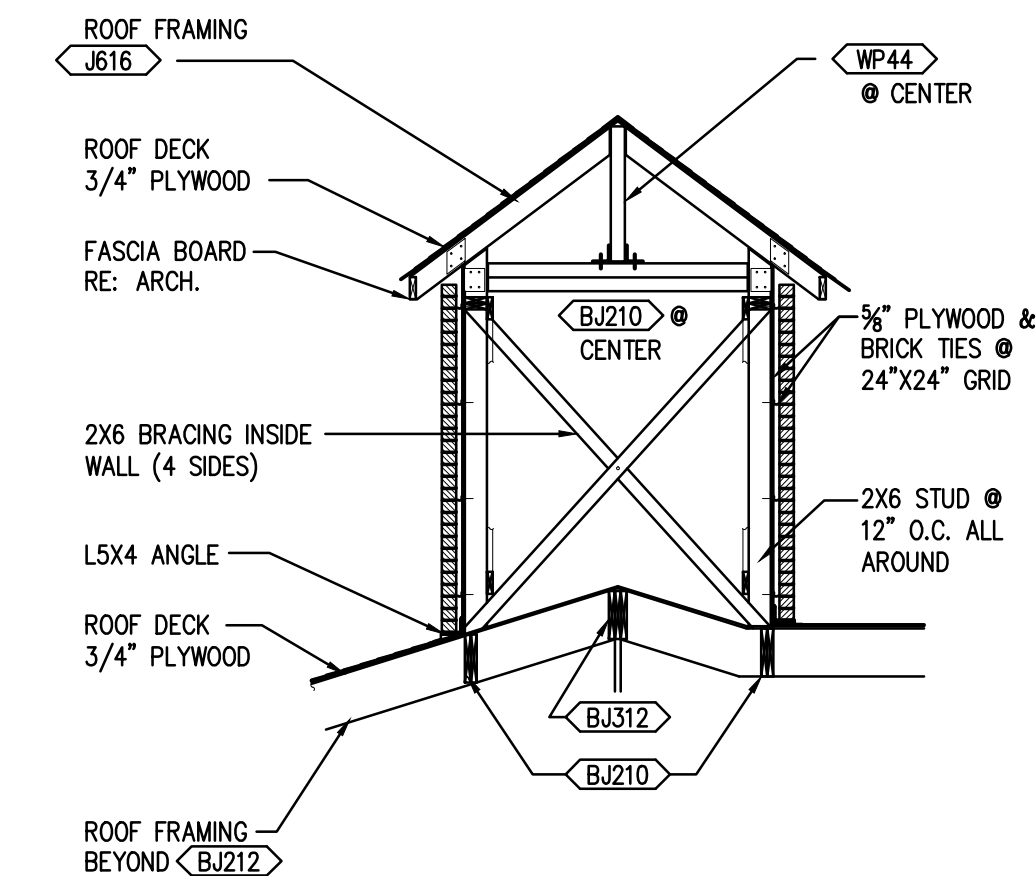

4 SECTION: AT TOWER

ROOF FRAMING PLAN
SCALE: 1/8" = 1'-0"

ROOF FRAMING PLAN

OPTIMUM PERSONAL CARE
1110 LAKEVIEW DRIVE
SUGAR LAND, TX. 77478

ISSUE HISTORY

DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION

09/03/13

Z:\SEAL.jpg

PE BUILDINGS
BRIDGES
INSPECTIONS
MARINE STRUCTURES
CIVIL ENGINEERING &
STRUCTURAL ENGINEERING

**PARAMOUNT
ENGINEERING
LLC**

7322 SOUTHWEST FREEWAY STE. 1050
HOUSTON, TX 77074

TEL : (713) 636-9977
FAX : (713) 888-9872
CEL : (713) 204-1742

TBPE REGISTRATION # F-3394

DRAWN BY: E.V. H.P. CHECKED BY: M.M.

PROJ. NO.: PE12-225

SHEET: **S6**

CONTRACTOR TO VERIFY ALL DIMENSIONS, ELEVATIONS, AND COORDINATE DETAILS WITH ARCHITECTURAL DRAWINGS. ALL DIMENSIONS & ELEVATION ON ARCHITECTURAL DRAWINGS SHALL GOVERN. IT IS CONTRACTOR'S RESPONSIBILITY TO REPORT TO ENGINEER ABOUT DISCREPANCY IN DRAWINGS PRIOR TO FABRICATION & BIDDING.

GENERAL NOTES FOR WOOD FRAMING

(THESE NOTES SHALL CONTROL UNLESS NOTED OTHERWISE ON PLANS AND DETAILS.)

TIMBER GRADES

CEILING AND FLOOR JOISTS:—NO. 2 SOUTHERN YELLOW PINE (SYP) OR EQUAL BEAMS & HEADERS:—NO. 2 SOUTHERN YELLOW PINE (SYP) OR EQUAL STUDS:—STUD GRADE (SYP) OR EQUAL WOOD POSTS:—NO. 2 SYP, SURFACE GREEN.

JOISTS

- JOIST BLOCKING**
 - JOISTS SHALL BE LATERALLY SUPPORTED AT EACH END AND AT EACH SUPPORT BY SOLID BLOCKING EXCEPT WHERE THE ENDS OF JOISTS ARE NAILED INTO A HEADER, BAND OR RIM JOIST OR TO AN ADJOINING STUD. SOLID BLOCKING SHALL NOT BE LESS THAN TWO INCHES IN THICKNESS AND SHALL MATCH THE DEPTH OF THE JOIST.
 - PROVIDE SOLID BLOCKING UNDER ALL BEARING WALLS PERPENDICULAR TO THE DIRECTION OF THE JOISTS.
 - PROVIDE DOUBLE JOISTS UNDER ALL BEARING WALLS PARALLEL TO THE DIRECTION OF THE JOISTS.
- JOIST BRIDGING**

PROVIDE BRIDGING AT ALL FLOOR JOISTS AT SPACING NOT TO EXCEED 8'-0".
- JOIST HOLES AND NOTCHES**
 - NOTCHES IN TOP OR BOTTOM OF JOISTS SHALL NOT EXCEED ONE SIXTH (1/6) THE JOIST DEPTH AND SHALL NOT BE LOCATED WITHIN MIDDLE THIRD OF THE SPAN.
 - HOLES SHALL NOT BE CLOSER THAN 2" TO TOP OR BOTTOM OF JOIST, THE DIAMETER OF ANY HOLE SHALL NOT EXCEED ONE FOURTH (1/4) THE JOIST DEPTH UNLESS APPROVED BY THE ENGINEER.

BEAMS AND HEADERS

- AT BEAMS MADE UP OF A NUMBER OF 2x JOISTS, EACH JOIST WILL BEAR ON A WALL STUD (I.E. NUMBER OF WALL STUDS SHALL MATCH NUMBER OF JOISTS BEARING ON THESE STUDS). THE CENTERLINE OF THE BEAM SHALL BE THE CENTERLINE OF THE SUPPORTING WALL STUDS.
- ALL BEAMS MADE UP OF A NUMBER OF 2x JOISTS SHALL BE FASTENED AS FOLLOWS: FOR THE MAXIMUM HORIZONTAL SPACING OF BOLTS:

2-2x12	16d NAILS	12" TOP & BOTTOM, STAGGER, EA. FACE
3-2x12	20d NAILS	12" TOP & BOTTOM, STAGGER, EA. FACE
4-2x12 (OR MORE)	5/8" BOLTS	12" TOP & BOTTOM, STAGGER

 BOLTS SHALL BE 5/8" LOCATED 2" MINIMUM FROM BEAM EDGES AND SHALL BE STAGGERED IN TOP AND BOTTOM ROWS. PROVIDE STANDARD WASHERS @ EACH FACE.
- ALL DOOR AND WINDOW HEADERS (OR HEADERS AT ANY OTHER OPENING) THAT ARE NOT SPECIFIED ON PLANS SHALL BE AS FOLLOWS:

FLOOR FRAMING:	2-2x12
CEILING FRAMING:	2-2x8
- MINIMUM BEARING OF ANY BEAM OR HEADER AT A STUD WALL IS 3-1/2"

STUD WALLS

- STUDS SHALL BE AS FOLLOWS:

2x4	16"
-----	-----
- PROVIDE A MINIMUM OF TWO (2) STUDS AT EACH SIDE OF OPENINGS LARGER THAN 4'-0", FULL HEIGHT OF WALL (KING STUDS).
- MAXIMUM STUD WALL HEIGHT SHALL BE AS FOLLOWS:

2x4 STUDS @ 16" O.C.	10'-0"
2x6 STUDS @ 16" O.C.	13'-0"
2x8 STUDS @ 16" O.C.	13'-0" TO 18'-0"
- BLOCKING & LATERAL BRACING:
 - PROVIDE BLOCKING AND/OR TEMPORARY CROSS BRACING AS REQUIRED TO ENSURE STUD STRAIGHTNESS ACCORDING TO SPECIFIED TOLERANCES.
 - MAXIMUM TOLERANCE FOR STUD STRAIGHTNESS IN EITHER DIRECTION IS 1/4 INCH PER TEN (10) FEET OF STUD HEIGHT.
 - MINIMUM BLOCKING:

1 ROW FOR STUD HEIGHT UP TO 9'-0";
2 ROWS FOR STUD HEIGHT UP TO 15'-0";
3 ROWS FOR STUD HEIGHT OVER 15'-0".

PLYWOOD FLOOR DECK:

- PLYWOOD SHALL BE 1-1/8" THICKNESS AND SHALL BE RATED STURO-FLOOR (2-4-1) EXPOSURE 1.
- LAY PANELS IN A STAGGERED PATTERN.
- BLOCK ALL EDGES W/ 2-2x4 BLOCKING.
- GLUE & NAIL TO FRAMING MEMBERS AS FOLLOWS:
 - GLUE SHALL CONFORM TO APA SPECIFICATION AF6-01, APPLIED IN A CONTINUOUS BEAD & IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
 - ALL NAILS SHALL BE 3/4" RING OR SCREW SHANK. NAIL SPACING SHALL BE 4" O.C. @ PANEL EDGES & 12" O.C. @ INTERMEDIATE SUPPORTS.

CONNECTORS

- CONNECTORS SHALL BE AS MANUFACTURED BY SIMPSON STRONG-TIE COMPANY, INC., DUBLIN, CA. OR APPROVED EQUAL. NAIL ALL NAIL HOLES.
- CONNECTORS SHALL BE THE MANUFACTURER-DESIGNATED SIZE FOR FRAMED MEMBERS, AND SHALL BE INSTALLED IN STRICT CONFORMANCE WITH MANUFACTURER'S INSTRUCTIONS.
- ALL NAIL & BOLT HOLES SHALL BE ENGAGED, WITH MANUFACTURER-DESIGNATED FASTENERS.
- CONNECTORS SHALL BE INSTALLED AT THE ENDS OF ALL JOISTS & BEAMS FRAMING INTO OTHER (SUPPORTING) MEMBERS (UNLESS OTHERWISE NOTED).
- THE FOLLOWING CONNECTORS SHALL BE PROVIDED AND SHALL BE CONSIDERED THE MINIMUM:

SAWN-LUMBER JOISTS	U	SERIES
I-JOISTS	IUS	SERIES
MULTIPLE-JOIST/BEAMS	HUS	SERIES
PSL & LVL BEAMS	LBV	SERIES
LVL (GLU-LAM) BEAMS	HQUS	SERIES

FASTENERS


- BOLTS**
 - USE ASTM A-307 BOLTS, WITH STANDARD WASHERS AT ALL CONTACT SURFACES.
 - PROVIDE 1/2" x 0'-10" LONG ANCHOR BOLTS @ 3'-0" O.C. AT ALL EXTERIOR WALL SILL PLATES, WITH 2" PROJECTION AND 1" THREAD.
 - ALL BOLTS, NUTS, AND WASHERS EXPOSED TO WEATHER SHALL BE GALVANIZED.
 - ALL BOLTS, NUTS, AND WASHERS IN CONTACT W/ TREATED WOOD SHALL BE GALVANIZED.
- ADHESIVE ANCHORS**
 - USE HILTI HIT RESOQ ANCHORS, OR APPROVED EQUAL.
 - INSTALL IN STRICT ACCORDANCE W/ MANUFACTURER'S RECOMMENDATIONS.
- POWDER-ACTIVATED NAILS**
 - USE HILTI X-EDM (0.145" SHANK) OR APPROVED EQUAL.
 - INSTALL IN STRICT ACCORDANCE W/ MANUFACTURER'S RECOMMENDATIONS.

HURRICANE CLIPS:

ALL HURRICANE CLIP AND NAILS IN CONTACT WITH PRESSURE TREATED WOOD MEMBER SHALL BE GALVANIZED.

MISCELLANEOUS:

ALL WOOD IN CONTACT WITH CONCRETE OR MASONRY SHALL BE TREATED LUMBER.

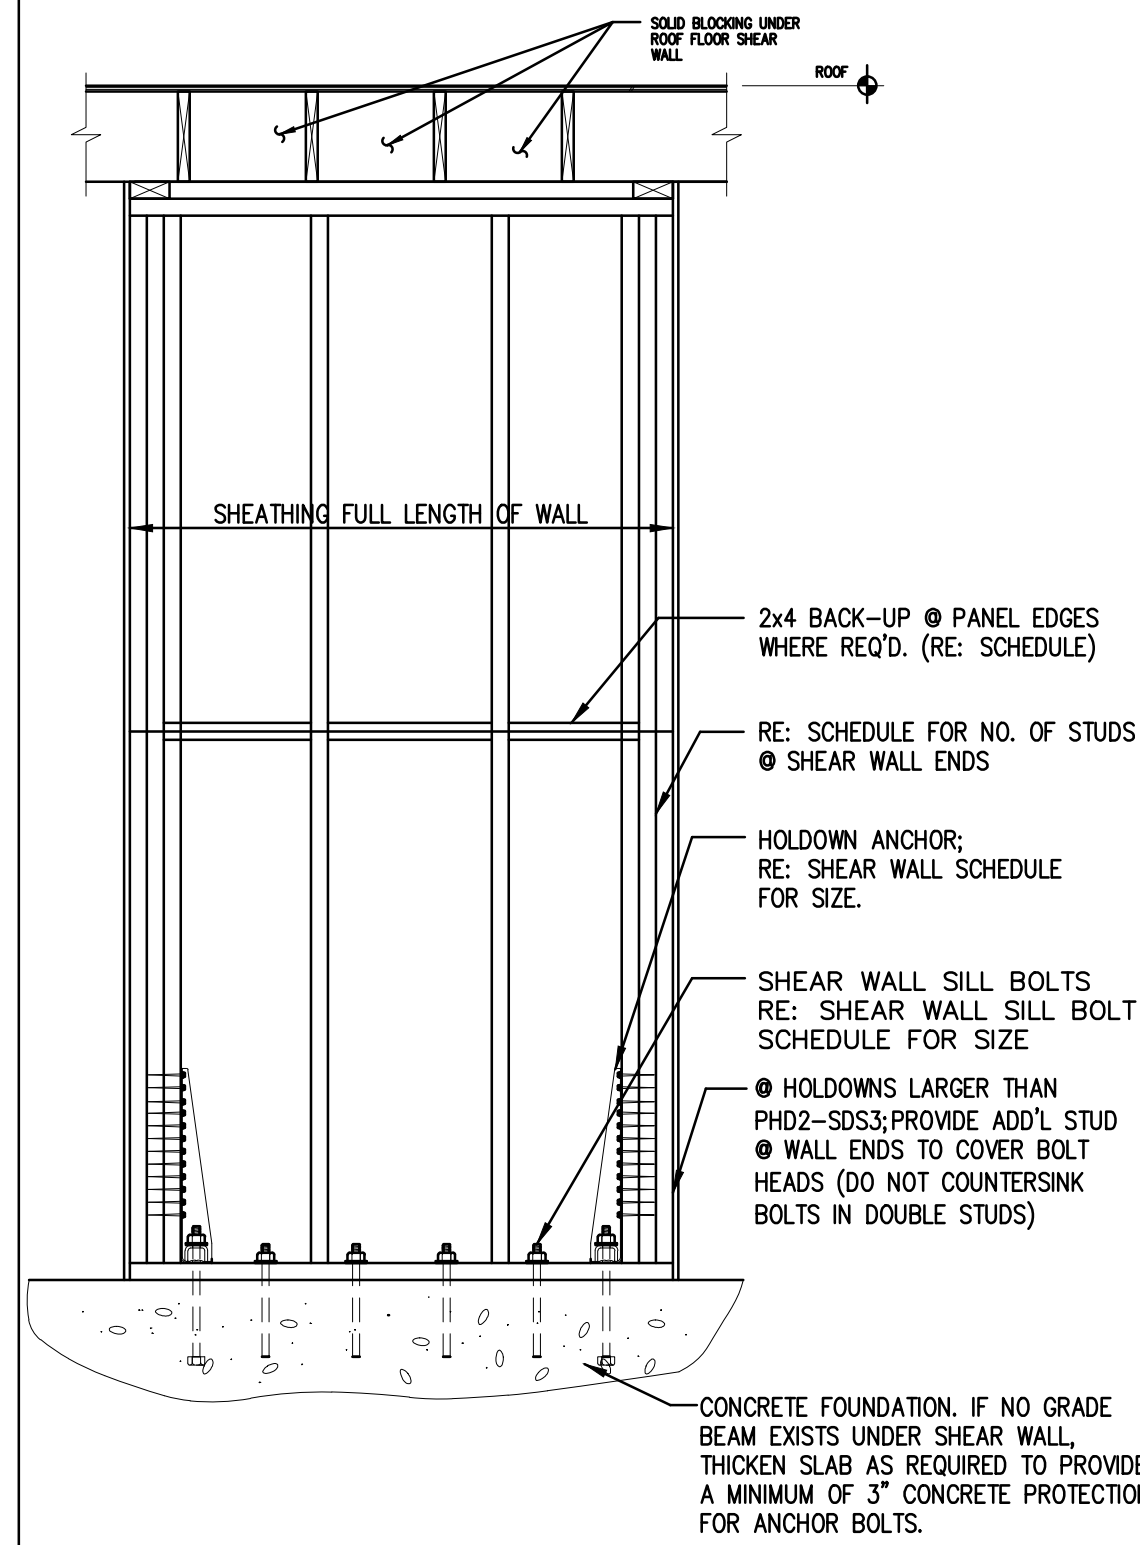

MARK	SHEATHING MATERIAL	BLOCKING	NAILING PATTERN	STUD POST EACH END	HOLD-DOWN MARK	HOLD-DOWN BOLT #
PA	3/8" PLYWOOD C-C	YES	8D COMMON @ 6"	2-2x4	PHD2-SDS3	3/8"
PA	3/8" PLYWOOD C-C	YES	8D COMMON @ 4"	2-2x4	PHD2-SDS3	3/8"
PA	1/2" PLYWOOD C-C	YES	10D COMMON @ 4"	2-2x4	PHD5-SDS3	3/8"
PA	1/2" PLYWOOD C-C	YES	10D COMMON @ 3"	2-2x4	PHD6-SDS3	3/8"
PA	5/8" PLYWOOD C-C	YES	10D COMMON @ 2"	3-2x4	HDQ8-SDS3	3/8"
GA	1/2" GYPBOARD	NO	5D COOLER @ 7"	2-2x4	PHD2-SDS3	3/8"
GA	1/2" GYPBOARD	YES	5D COOLER @ 4"	2-2x4	PHD2-SDS3	3/8"
GA	5/8" GYPBOARD	YES	6D COOLER @ 4"	2-2x4	PHD2-SDS3	3/8"

MARK	SILL PLATE BOLTING FOR SHEAR WALL	MIN. EMBEDMENT
PA	1/2" @ 2'-6" O.C.	6"
PA	1/2" @ 2'-0" O.C.	6"
PA	3/8" @ 2'-0" O.C.	6"
PA	3/8" @ 1'-6" O.C.	6"
PA	3/8" @ 1'-0" O.C.	6"

- SHEAR WALL NOTES:**
- WHERE "BLOCKING" IS INDICATED, PROVIDE 2x4 BACK-UP AT ALL GYPBOARD OR PLYWOOD PANEL EDGES.
 - NAILING PATTERN APPLIES AT ALL PANEL EDGES. AT INTERMEDIATE SUPPORTS, PROVIDE NAILING @ 12" O.C. USING CORRESPONDING NAIL SIZE.
 - SHEATHING MATERIAL AND NAILING PATTERN APPLY TO ONE SIDE OF SHEAR WALL ONLY. WHERE A SHEAR WALL IS CALLED OUT ON A PLAN, PROVIDE SCHEDULED SHEATHING MATERIAL AND NAILING FOR THE FULL LENGTH OF THAT WALL.
 - PROVIDE SCHEDULED STUDS AT EACH END OF SHEAR WALL OR SEGMENT THEREOF.
 - HOLD-DOWN CONNECTORS:
 - CONNECTORS SHALL BE AS MANUFACTURED BY SIMPSON STRONG-TIE COMPANY, INC., SAN LEANDRO, CA OR APPROVED EQUAL.
 - THE FOLLOWING SUBSTITUTIONS MAY BE MADE:

HOLDDOWN MARK	SUBSTITUTION	
	@ SLAB / FOUNDATION	@ FLOOR FRAMING
PHD2-SDS 3	HD2A OR STD10 OR HTT16	HST2 OR M5TC40
PHD5-SDS 3	HD5A OR STD14 OR HTT22	HST3 OR M5TC52
PHD6-SDS 3	HD6A OR HTT22	HST3 OR M5TC66

- ALL HOLD-DOWNS MUST BE INSTALLED IN STRICT ADHERENCE TO MANUFACTURER'S INSTRUCTIONS, USING BOLT & NAIL NUMBERS, SIZES & LENGTHS AS SPECIFIED BY MANUFACTURER.
- WHERE PLYWOOD IS SHOWN ON BOTH FACES OF A SHEAR WALL:
 - DOUBLE STUDS OR 3" WIDE STUDS MUST BE USED.
 - STAGGER PLYWOOD JOINTS AT WALL FACES.
 - USE 4x4 WOOD POSTS @ EA. END TO BOLT HOLD-DOWNS.
 - PROVIDE DOUBLE 2x SILL PLATE W/ 1/2" ANCHOR BOLTS @ 24" c. IN ADDITION TO HOLD-DOWN ANCHOR BOLTS.
- SIMPSON "WEDGE-ALL" WEDGE ANCHORS MAY BE USED IN LIEU OF SCHEDULED ANCHOR BOLTS TO MATCH (DIAMETERS). MINIMUM EMBEDMENT LENGTHS AS SUGGESTED BY MANUFACTURER.
- BOLTS SPECIFIED FOR THIS TABLE MUST BE A490 RATED BOLTS

TYPICAL SHEAR WALL DETAILS

NAILING SCHEDULE (FLOOR & ROOF DECK)

DECK TYPE & THICKNESS	NAIL SIZE	NUMBER OR NAILING PATTERN
PLYWOOD OR PARTICLE BOARD		
1/2" OR LESS	8D COMMON OR EQUAL	6" O.C. @ PANEL EDGES
19/32" THRU 3/4"	8D COMMON OR EQUAL	10" O.C. @ INTERMEDIATE SUPPORTS TYPICAL (TYPICAL)
7/8" THRU 1" (FLR.)	8D COMMON OR EQUAL	
1 1/8" THRU 1 1/4" (FLR.)	10D COMMON OR EQUAL	

NAILING SCHEDULE (FRAMING MEMBERS)

CONNECTED MEMBERS	NAIL SIZE	NUMBER OR NAILING PATTERN
BRIDGING TO JOIST	8D COMMON	2 TOE NAIL EA. END
SOLE PLATE TO JOIST OR BLOCKING	16D COMMON	@ 16" O.C. FACENAIL
TOP PLATE TO STUD	16D COMMON	2 END NAIL
STUD TO SOLE PLATE	8D COMMON OR 16D COMMON	4 TOE NAIL 2 END NAIL
DOUBLE STUDS	16D COMMON	@ 24" FACE NAIL
DOUBLED TOP PLATES	16D COMMON	@ 16" FACE NAIL
TOP PLATES: LAPS & INTERSECTIONS	16D COMMON	2 FACE NAIL
CONTINUOUS HEADER, TWO PIECE	16D COMMON	@ 16" FACE NAIL ALONG EA. EDGE
CEILING JOISTS TO PLATE	8D COMMON	3 TOE NAIL
CONTINUOUS HEADER TO STUD	8D COMMON	4 TOE NAIL
CEILING JOISTS, LAPS OVER PARTITIONS	16D COMMON	3 FACE NAIL
CEILING JOISTS TO PARALLEL RAFTERS	16D COMMON	3 FACE NAIL
RAFTER TO PLATE	8D COMMON	3 TOE NAIL
1" BRACE TO EACH STUD & PLATE	8D COMMON	2 FACE NAIL
BUILT UP CORNER STUDS	16D COMMON	@ 24" FACE NAIL
CONTINUOUS HEADER, 3 OR MORE PIECE & BUILT UP ORDERS OR BEAMS	BOLTS	RE: GEN. NOTES.




NAILING SCHEDULE (WALL SHEATHING AND SIDING)

SHEATHING TYPE & THICKNESS	FASTNER SIZE & TYPE	NAILING PATTERN
PLYWOOD & PARTICLE BOARD		
LESS THAN 1/2"	6D COMMON OR EQUAL	6" O.C. @ PANEL EDGES
1/2" THRU 3/4"	8D COMMON OR EQUAL	12" O.C. @ INTERMEDIATE SUPPORTS
FIBERBOARD		
1/2" OR LESS	6D COMMON OR EQUAL	6" O.C. @ PANEL EDGES
25/32"	8D COMMON OR EQUAL	12" O.C. @ INTERMEDIATE SUPPORTS
GYP-SUM SHEATHING		
1/2" OR 5/8"	12 GA. (4) OR EQUAL	4" O.C. @ EDGES 6" O.C. @ INTERMEDIATE SUPPORTS
GYP-SUM WALLBOARD		
1/2"	1 3/8" DRYWALL NAILS	7" O.C. @ CEILINGS
5/8"	1 1/2" DRYWALL NAILS	8" O.C. @ WALLS
PANEL SIDING (TO FRAMING)		
1/2" OR LESS	6D COMMON OR EQUAL	1 EACH PANEL
5/8"	8D COMMON OR EQUAL	

NOTES ON "NAILING--WALL SHEATHING & SIDING"

- CORROSION-RESISTANT SIDING OR CASING NAILS CONFORMING TO THE REQUIREMENTS OF IRC
- CORROSION-RESISTANT ROOFING NAILS WITH 7/16-INCH DIAMETER HEAD AND 1 1/2-INCH LENGTH FOR 1/2-INCH SHEATHING AND 1 3/4-INCH LENGTH FOR 25/32-INCH SHEATHING CONFORMING TO THE REQUIREMENTS OF IRC
- CORROSION-RESISTANT STAPLES WITH NOMINAL 7/16-INCH CROWN AND 1 1/8-INCH LENGTH FOR 1/2-INCH SHEATHING AND 1 1/2-INCH LENGTH FOR 25/32-INCH SHEATHING CONFORMING TO THE REQUIREMENTS OF IRC
- CORROSION-RESISTANT, LARGE HEAD.

TYPICAL NAILING SCHEDULE

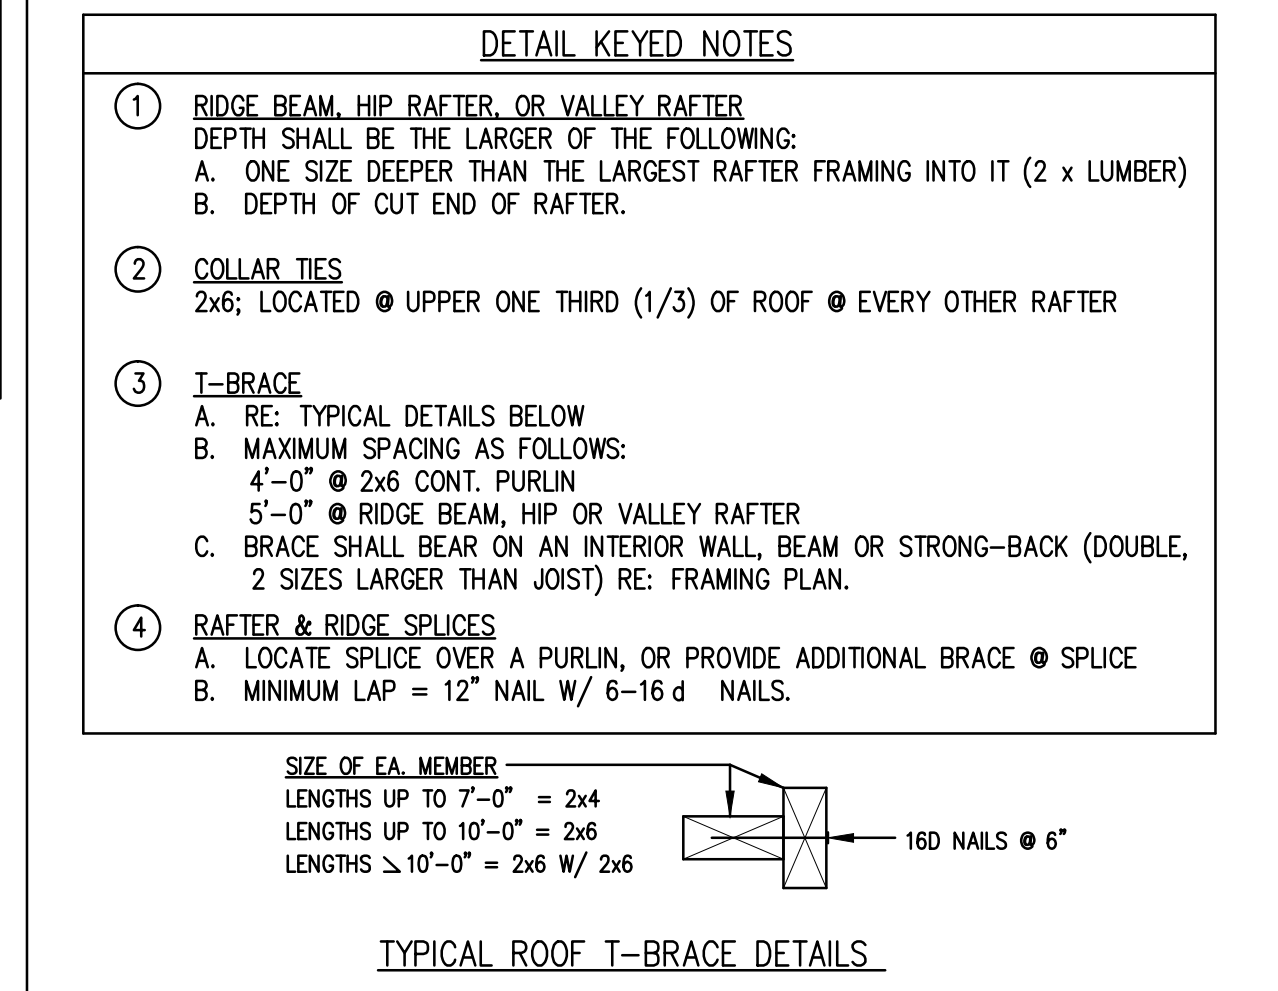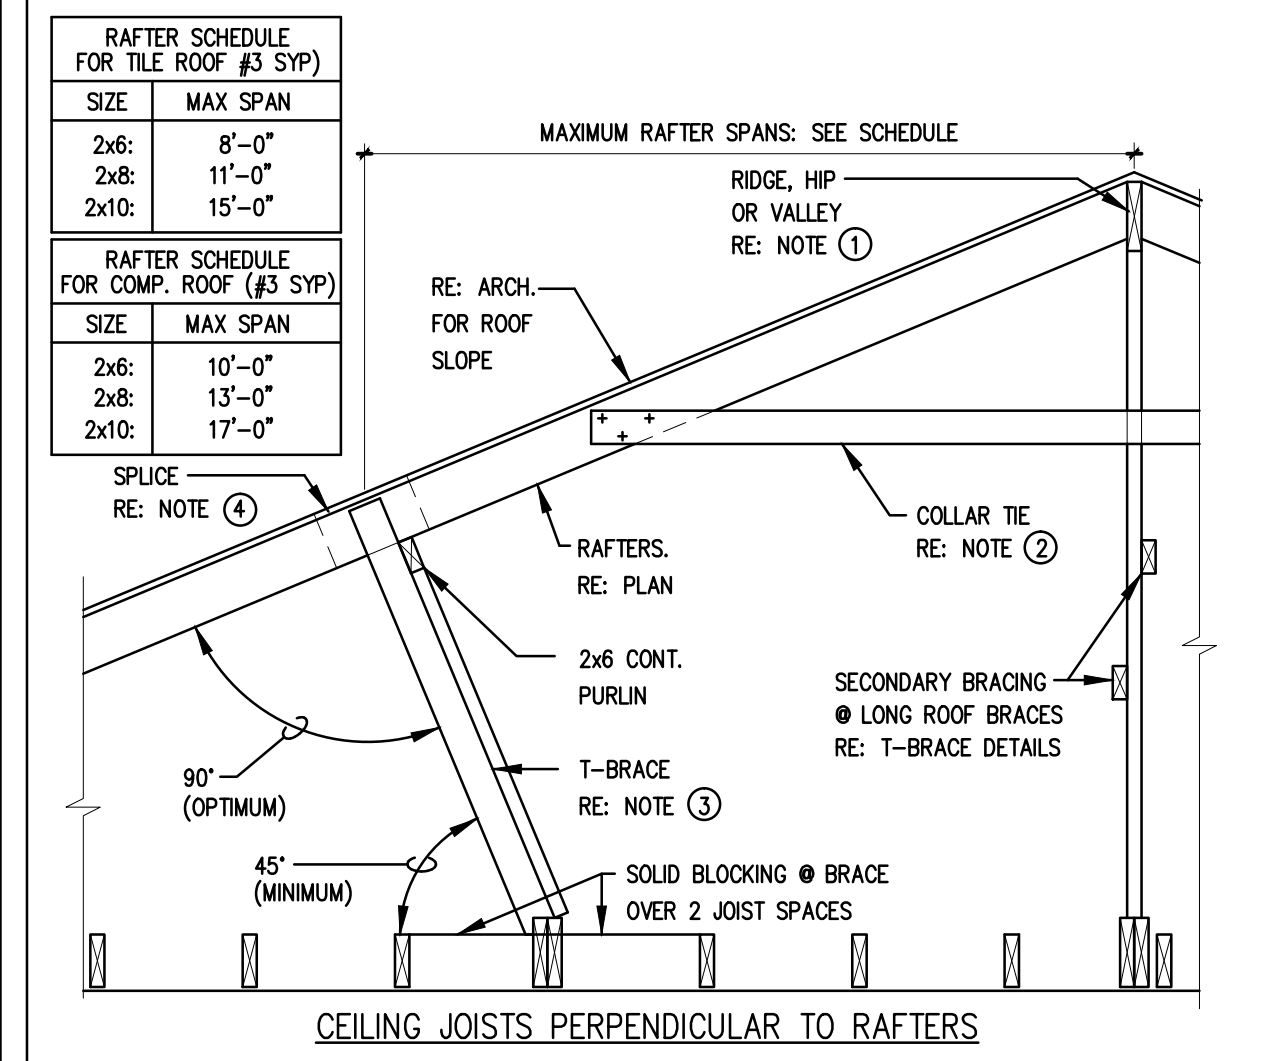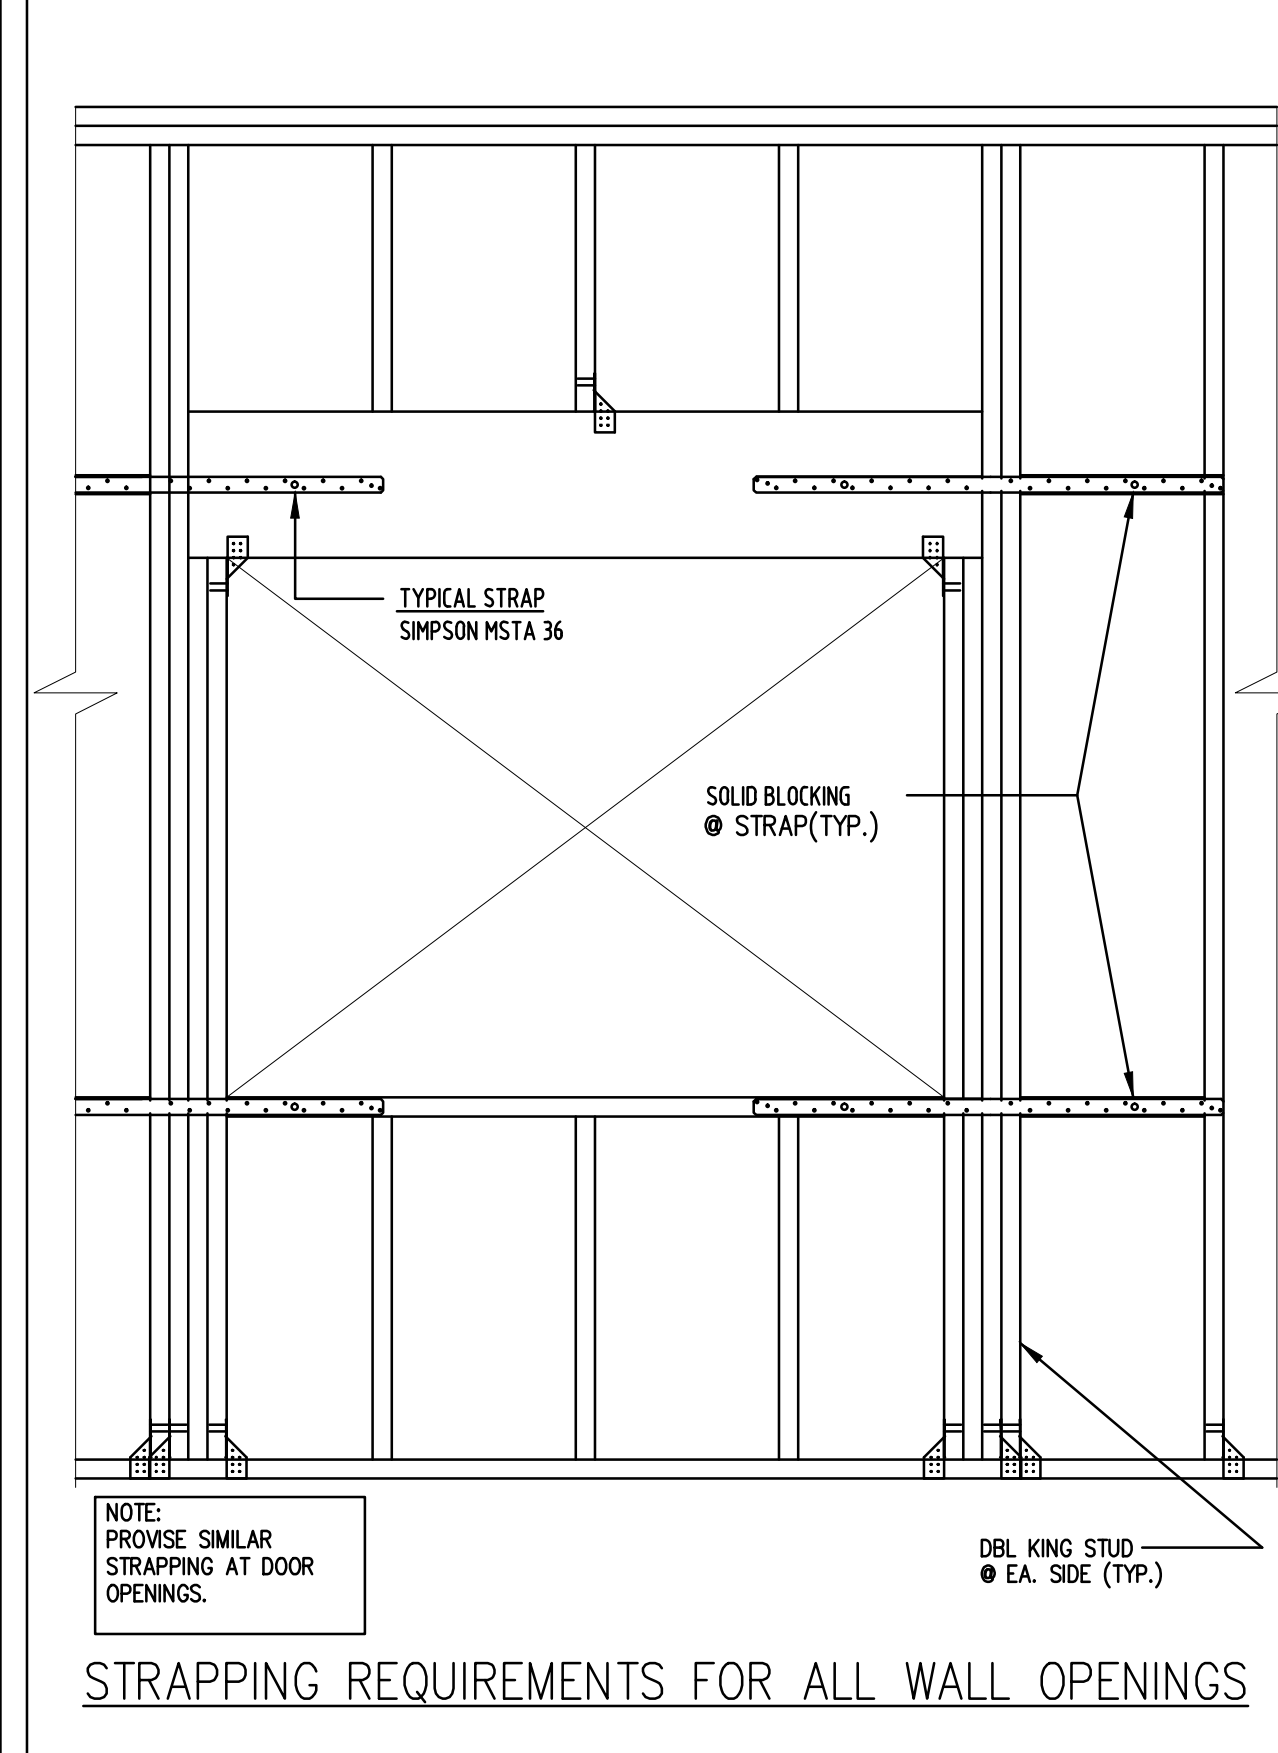

TYPICAL ROOF BRACING DETAILS

GENERAL NOTES

OPTIMUM PERSONAL CARE

1110 LAKEVIEW DRIVE
SUGAR LAND, TX 77478

ISSUE HISTORY

DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION

09/03/13

Z:\SEAL.jpg

PE BUILDINGS BRIDGES INSPECTIONS MARINE STRUCTURES CIVIL ENGINEERING & STRUCTURAL ENGINEERING

PARAMOUNT ENGINEERING LLC



7322 SOUTHWEST FREEWAY STE. 1050 HOUSTON, TX 77074
TEL : (713) 636-9977
FAX : (713) 888-9872
CEL : (713) 204-1742

TBPE REGISTRATION # F-3394








DRAWN BY: E.V. CHECKED BY: M.M.

PROJ. NO.: PE12-225

SHEET: S7

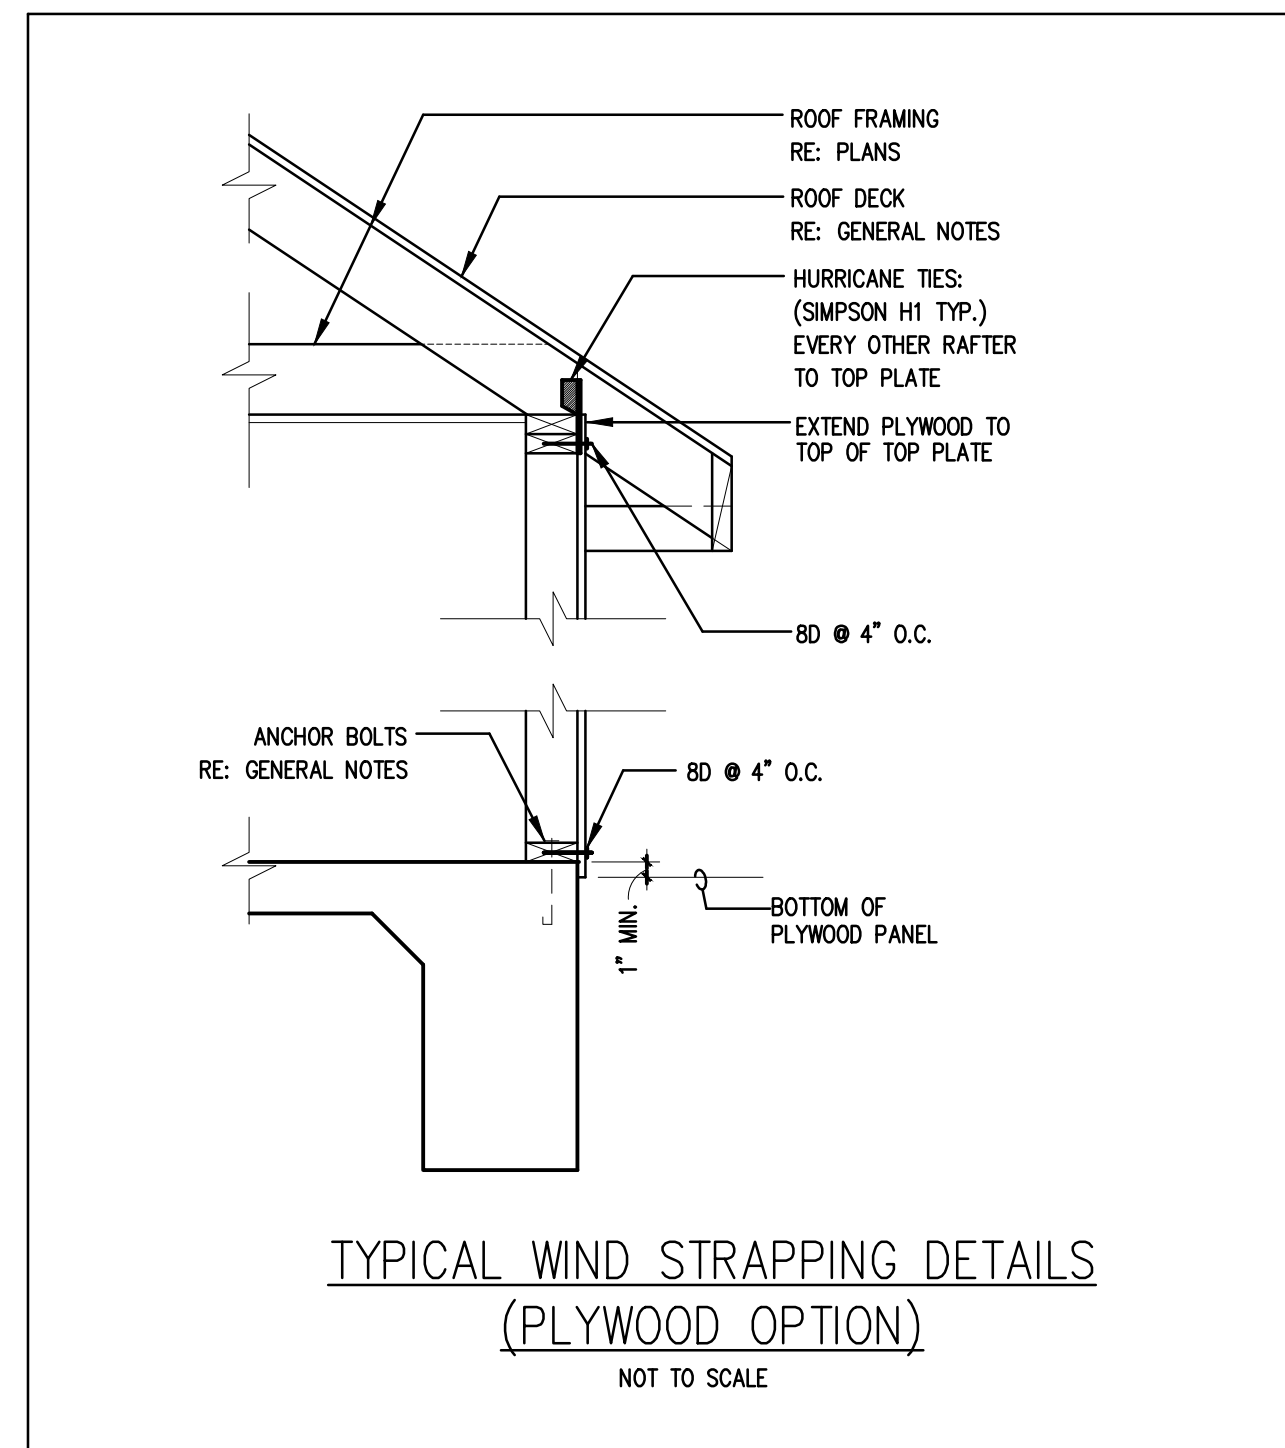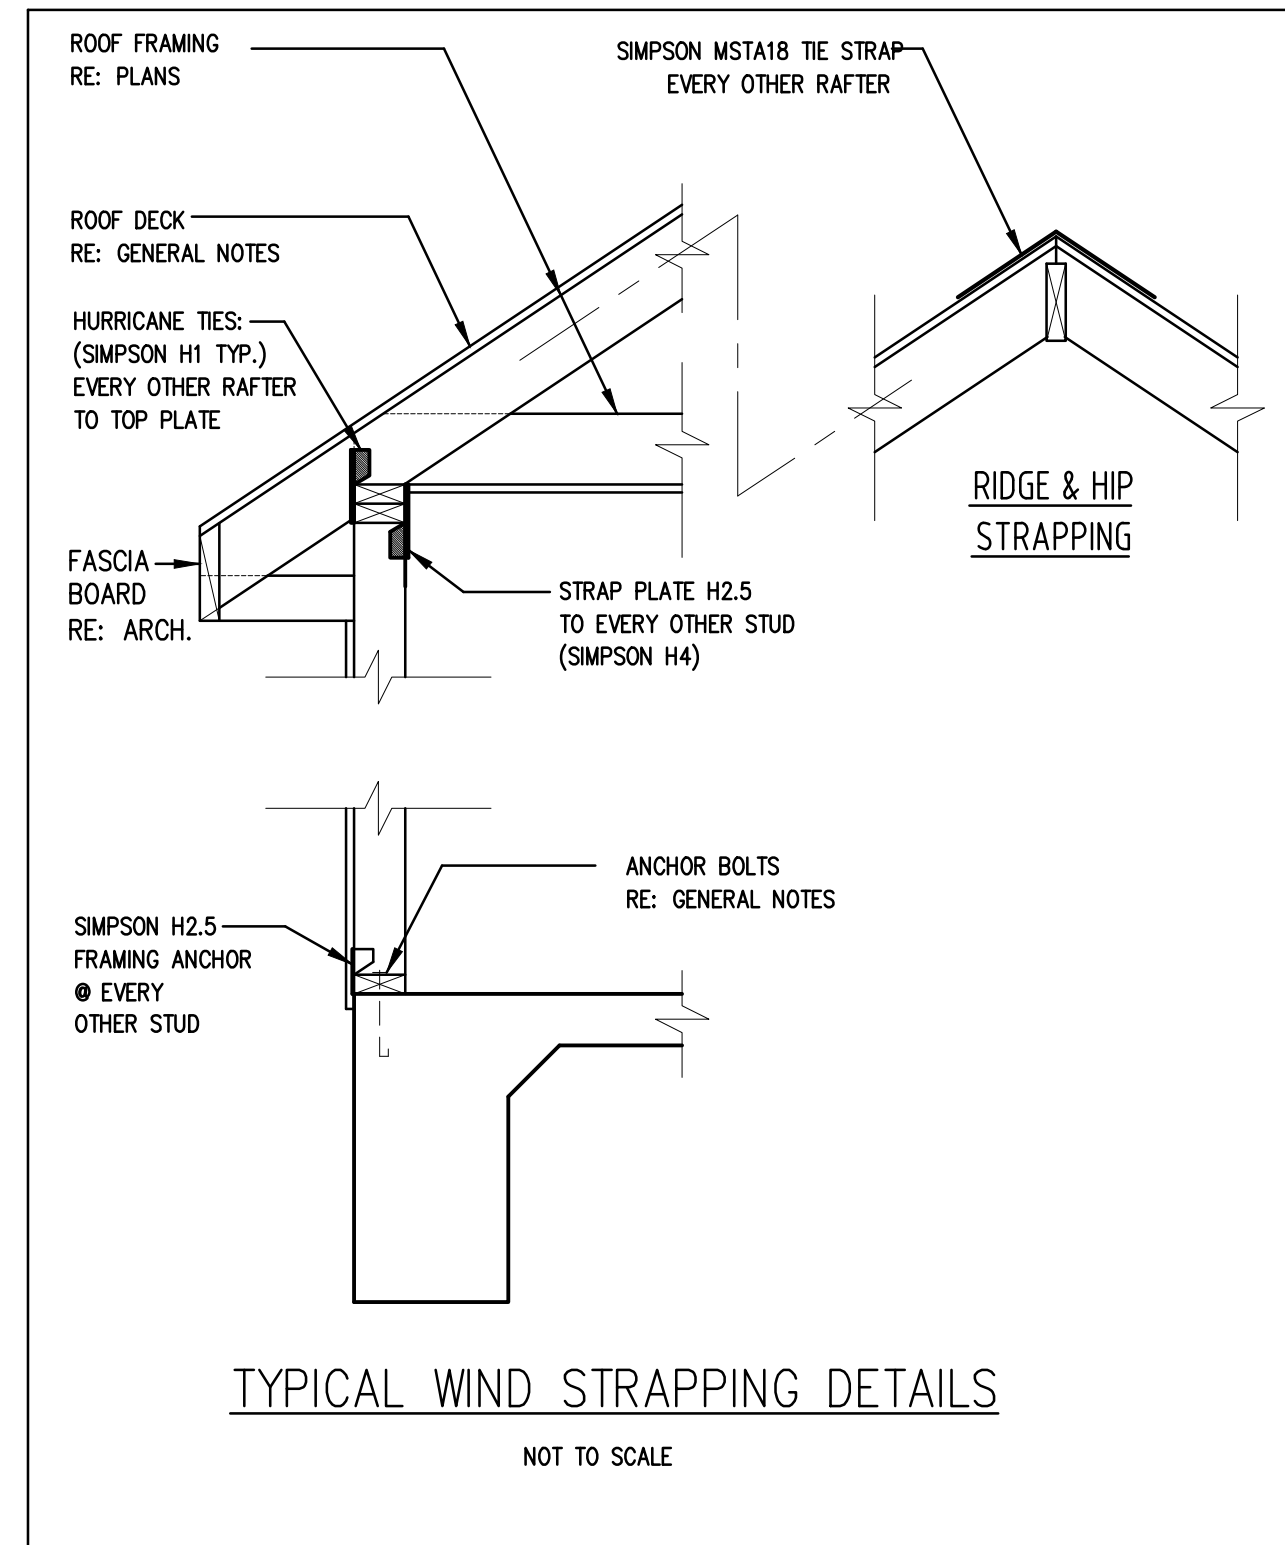

- GENERAL NOTES: STRUCTURAL AND MISC. STEEL**
- CONFORM TO THE FOLLOWING MATERIAL SPECIFICATIONS:
STRUCTURAL & MISC. SHAPES: ASTM A-36
PIPE COLUMNS: ASTM A-53-B
TUBE COLUMNS: ASTM A-500-B
 - ALL DETAILING SHALL BE IN CONFORMANCE WITH THE STANDARDS OF THE AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC).
 - UNLESS NOTED OTHERWISE, PROVIDE FRAMED BEAM CONNECTIONS IN ACCORDANCE WITH PART 4, AISC MANUAL - 3/4" ASTM A-307 BOLTS. DESIGN FOR SHEARS IN TABLES FOR ALLOWABLE LOADS ON BEAMS, PART 2.
 - FIELD CONNECTIONS SHALL BE EQUIVALENT TO STANDARD BOLTED CONNECTIONS USING 3/4" ASTM A-307 BOLTS UNLESS OTHERWISE SHOWN. IF CONNECTION BOLTS ARE IN SINGLE SHEAR, BOLTS SHALL BE PLACED IN TWO VERTICAL ROWS. CONNECTIONS SHALL BE BOLTED OR WELDED - SEE DETAILS.
 - WELDING SHALL CONFORM TO THE "CODE FOR WELDING IN BUILDING CONSTRUCTION" BY THE AMERICAN WELDING SOCIETY, LATEST EDITION. WELDS NOT CALLED OUT ON DRAWINGS SHALL BE 1/4" CONTINUOUS FILLET WELDS. WELDING ELECTRODES SHALL CONFORM TO AWS A5.1 OR A5.5 E70XX.
 - ALL WELDING SHALL PERFORMED BY CERTIFIED WELDERS.
 - ANCHOR BOLTS SHALL CONFORM TO ASTM A-307 FOR HEADED A.B. AND A-36 FOR UNHEADED AND HOOKED A.B., AND SHALL BE SET USING RIGID TEMPLATES.
 - PROVIDE TEMPORARY BRACING & SHORING FOR ALL STEEL FRAMING AS REQ'D TO ENSURE STABILITY DURING CONSTRUCTION. NOTE THAT STEEL FRAMING MEMBERS MAY NOT BE STABLE DURING CONSTRUCTION UNTIL PERMANENTLY CONNECTED WITHIN THE OVERALL STRUCTURE.
 - IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY ALL DIMENSION, ELEVATION AND REVIEW THESE DRAWINGS BEFORE FABRICATION OR ORDERING MATERIALS.

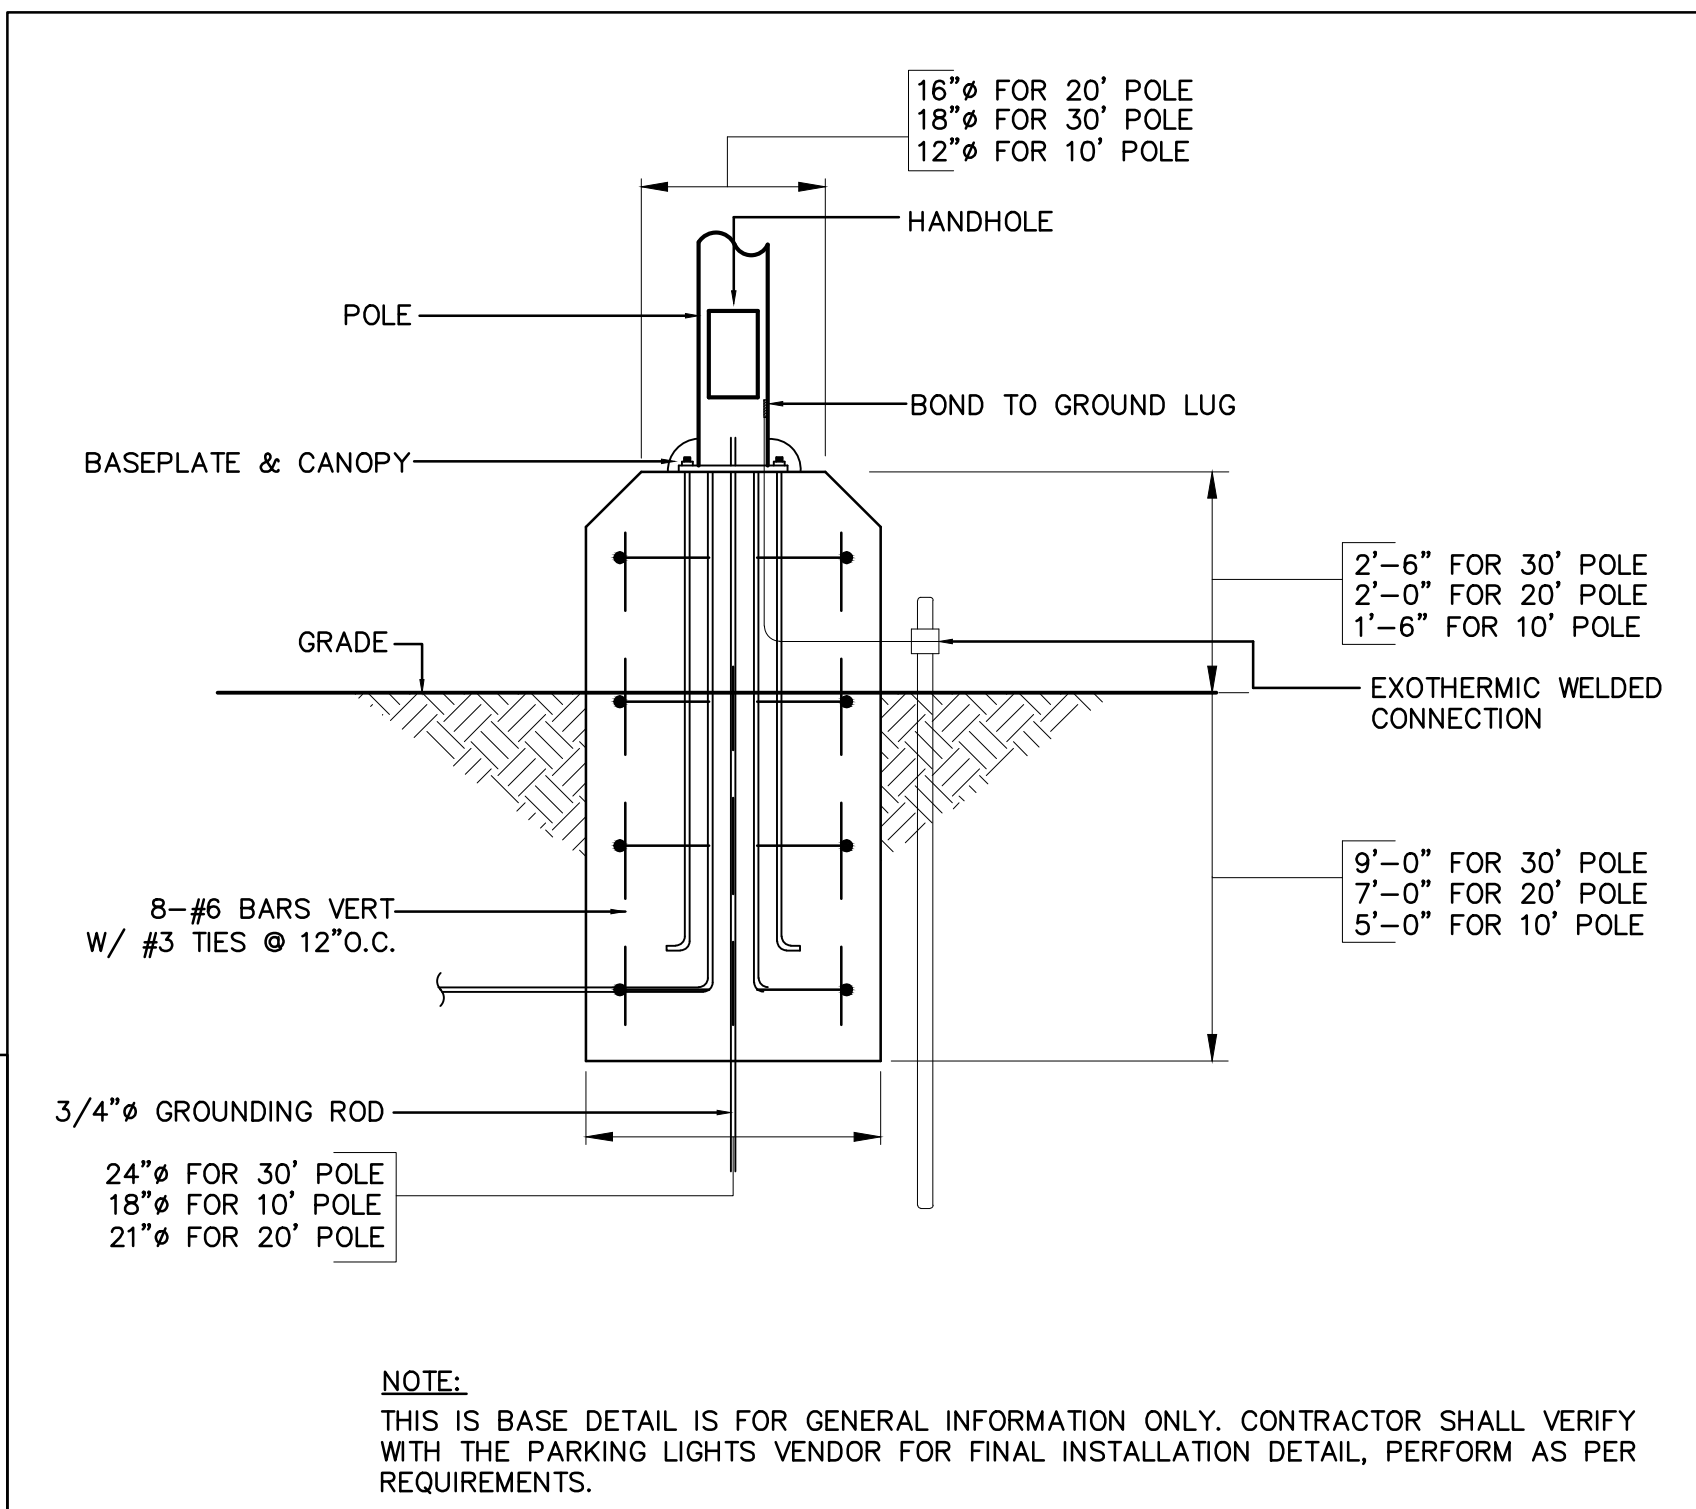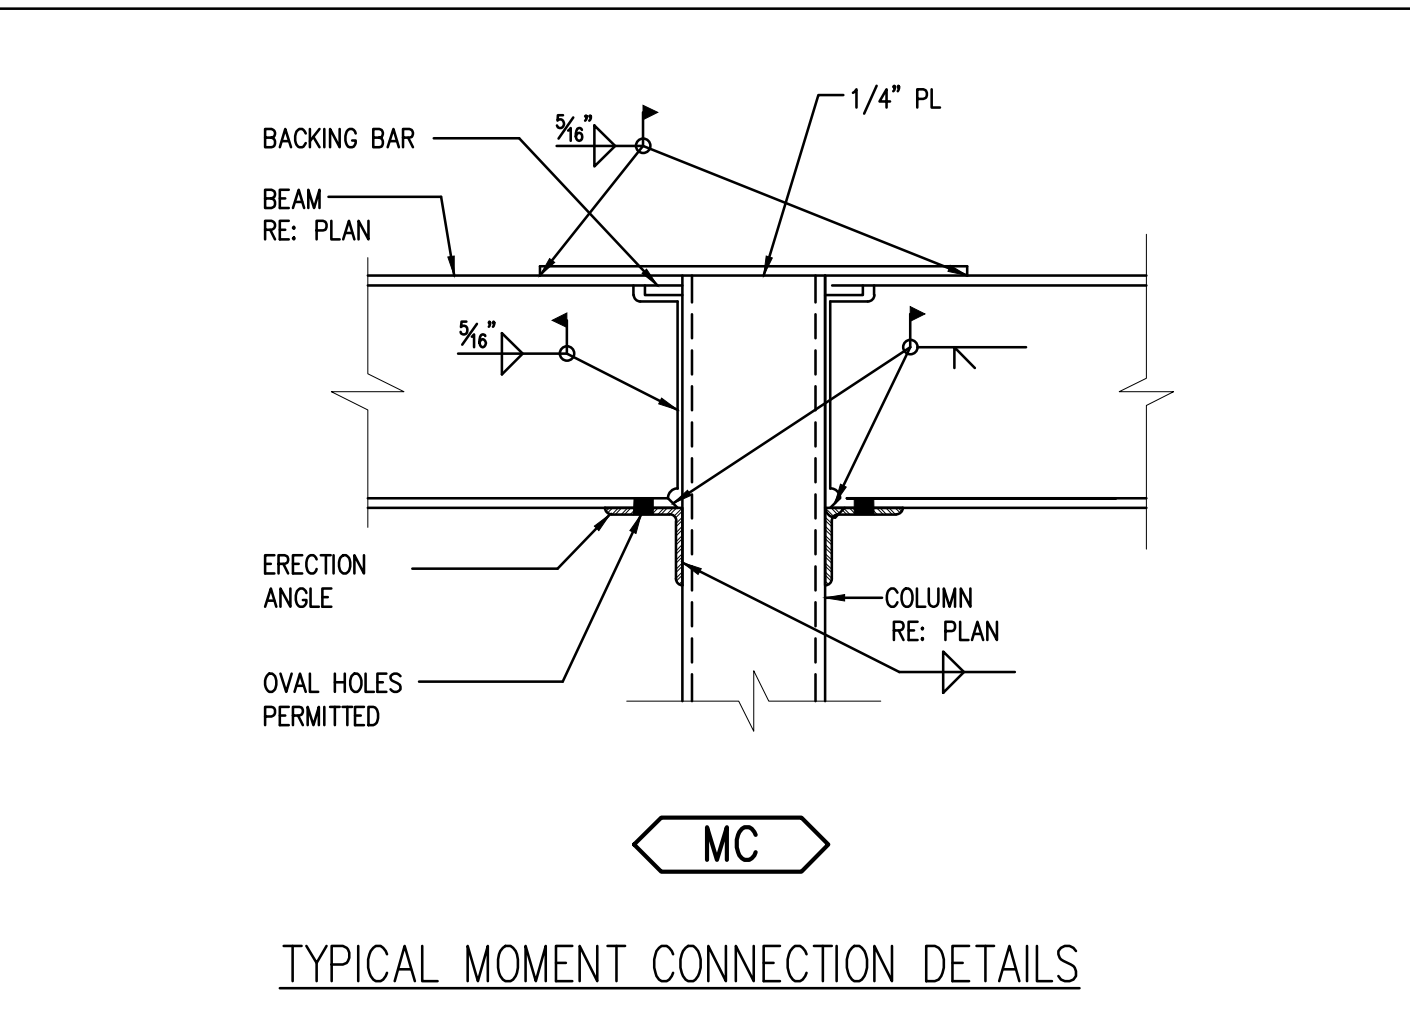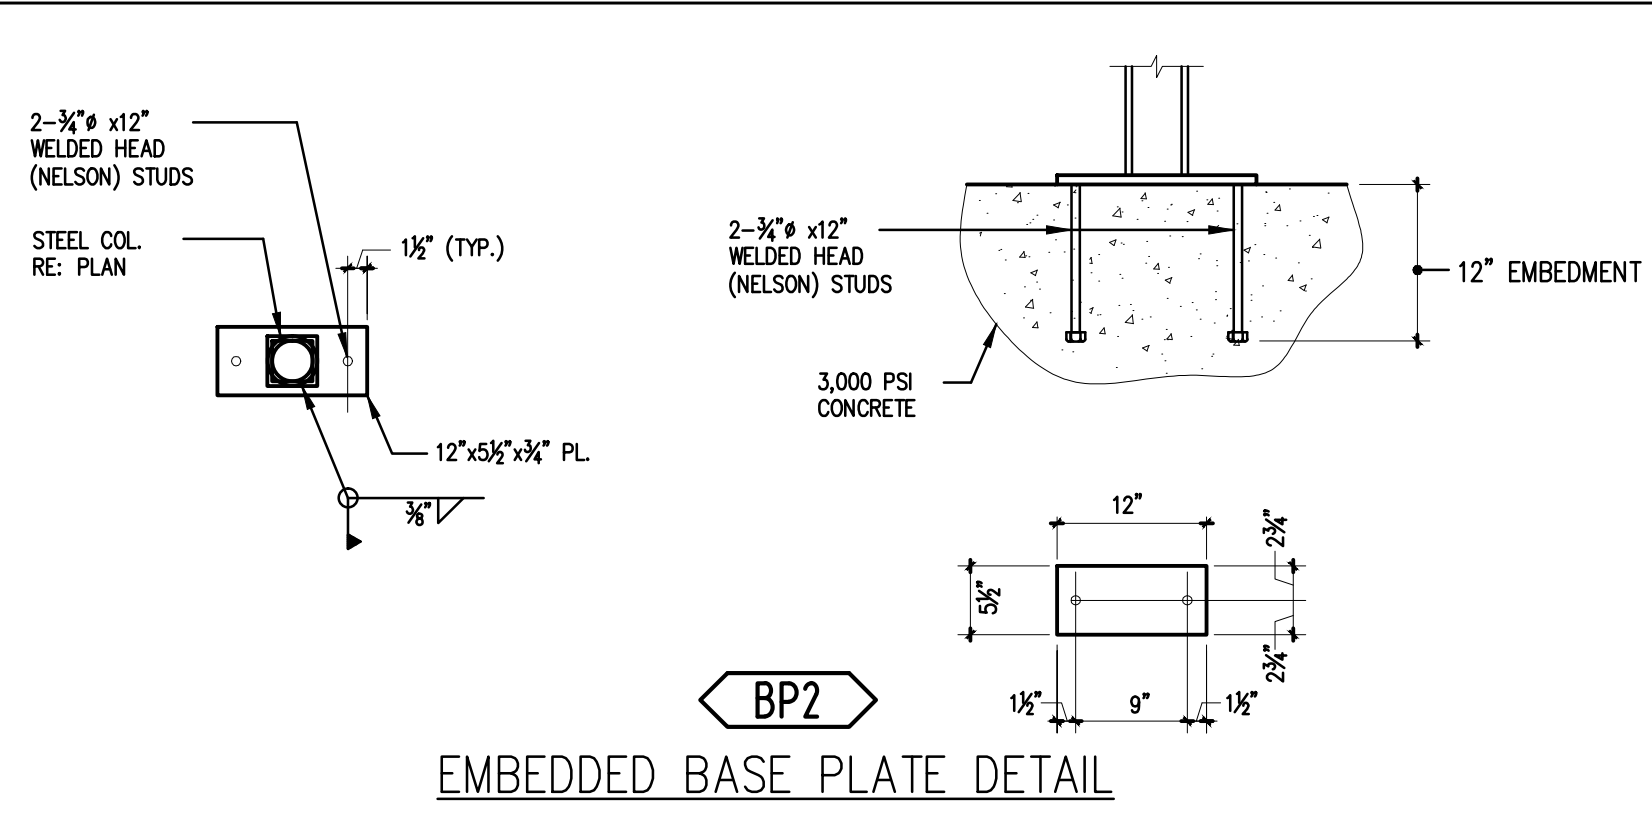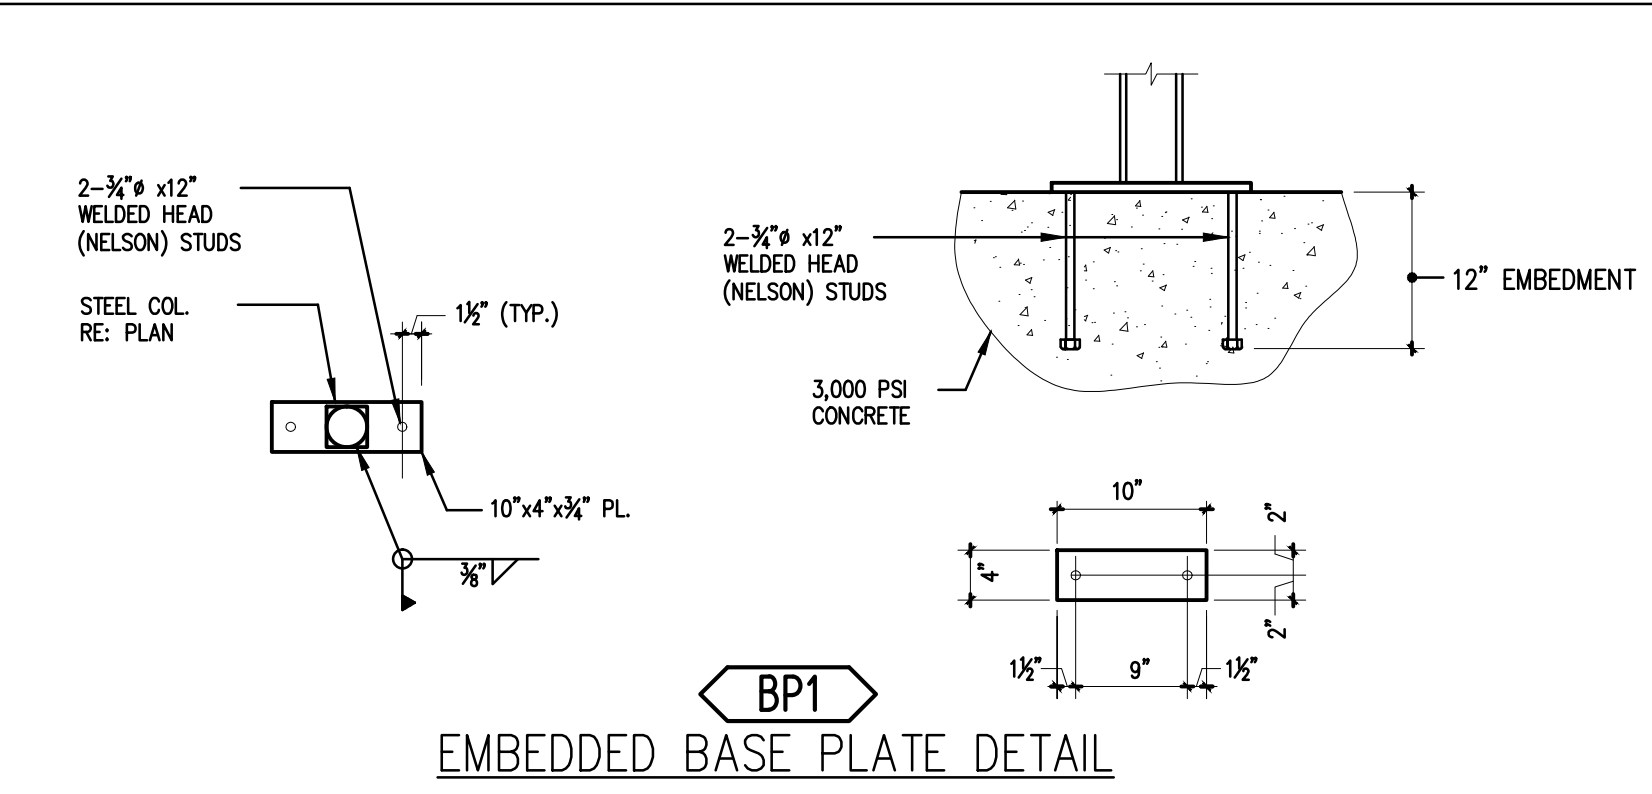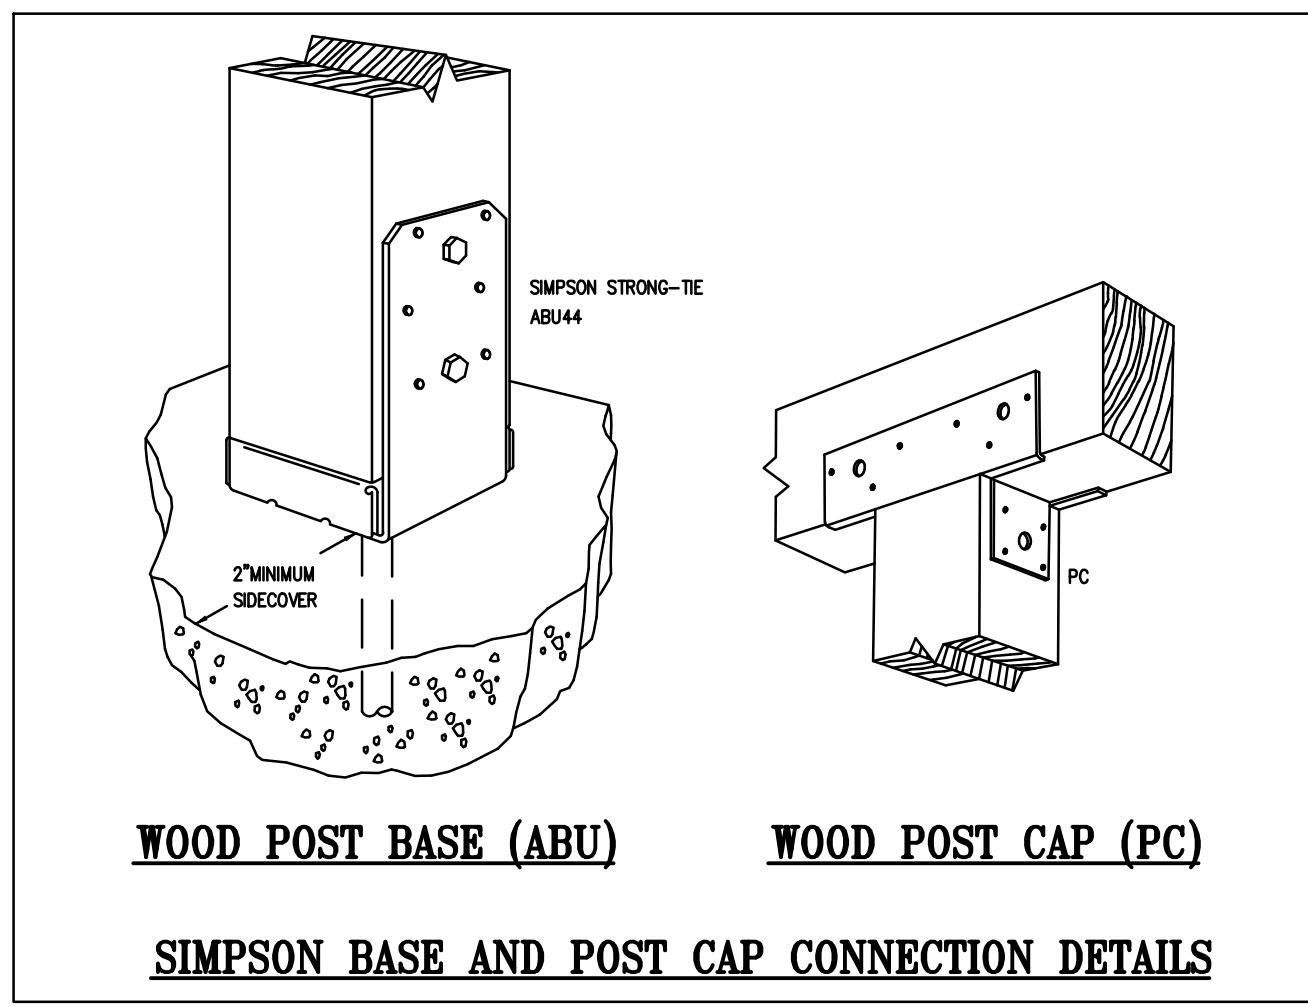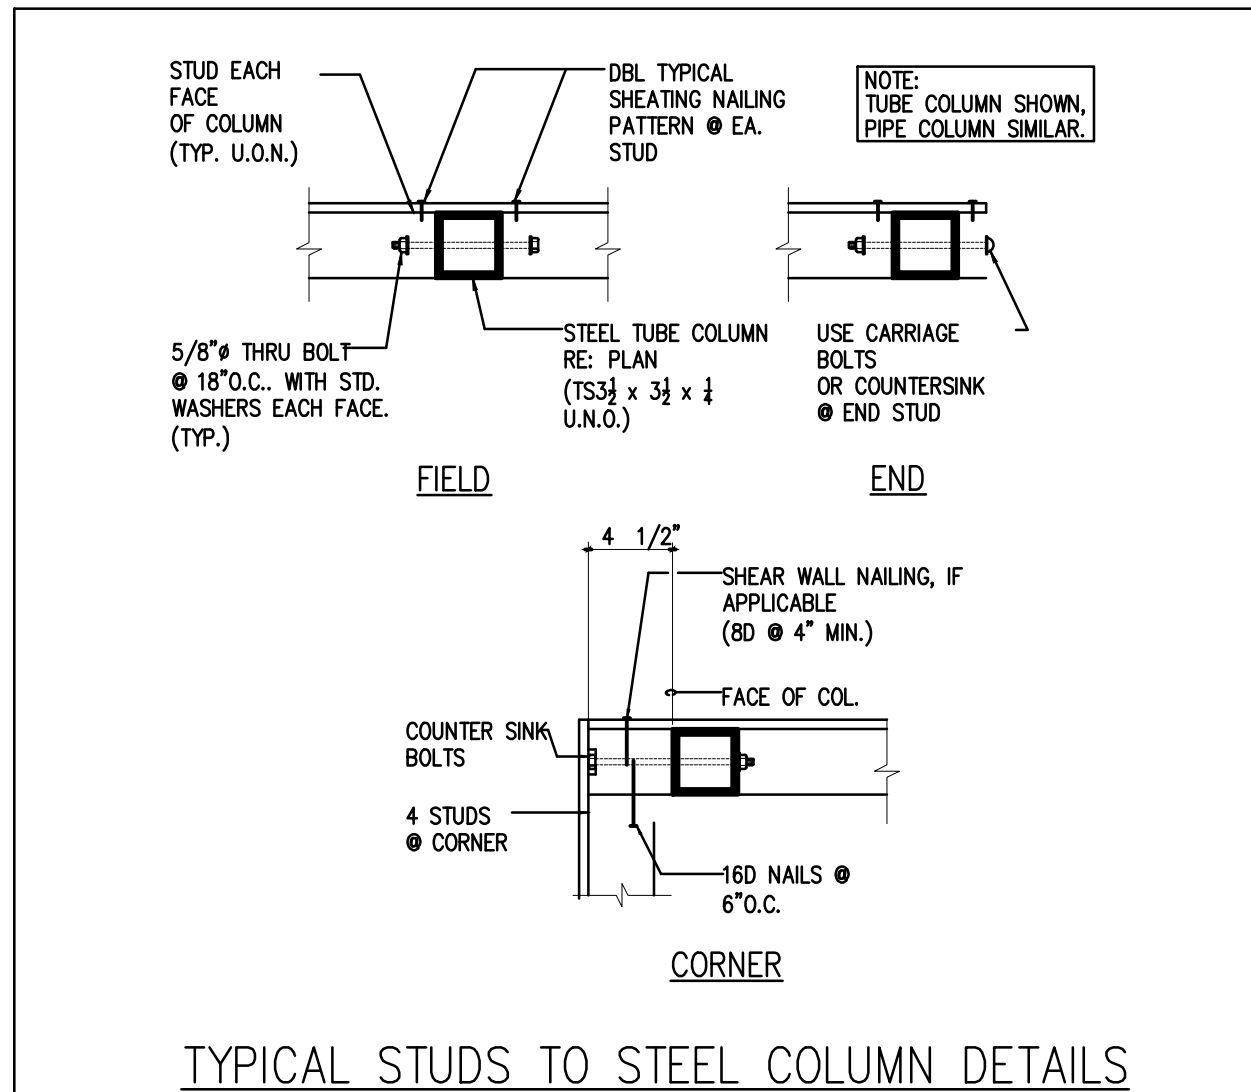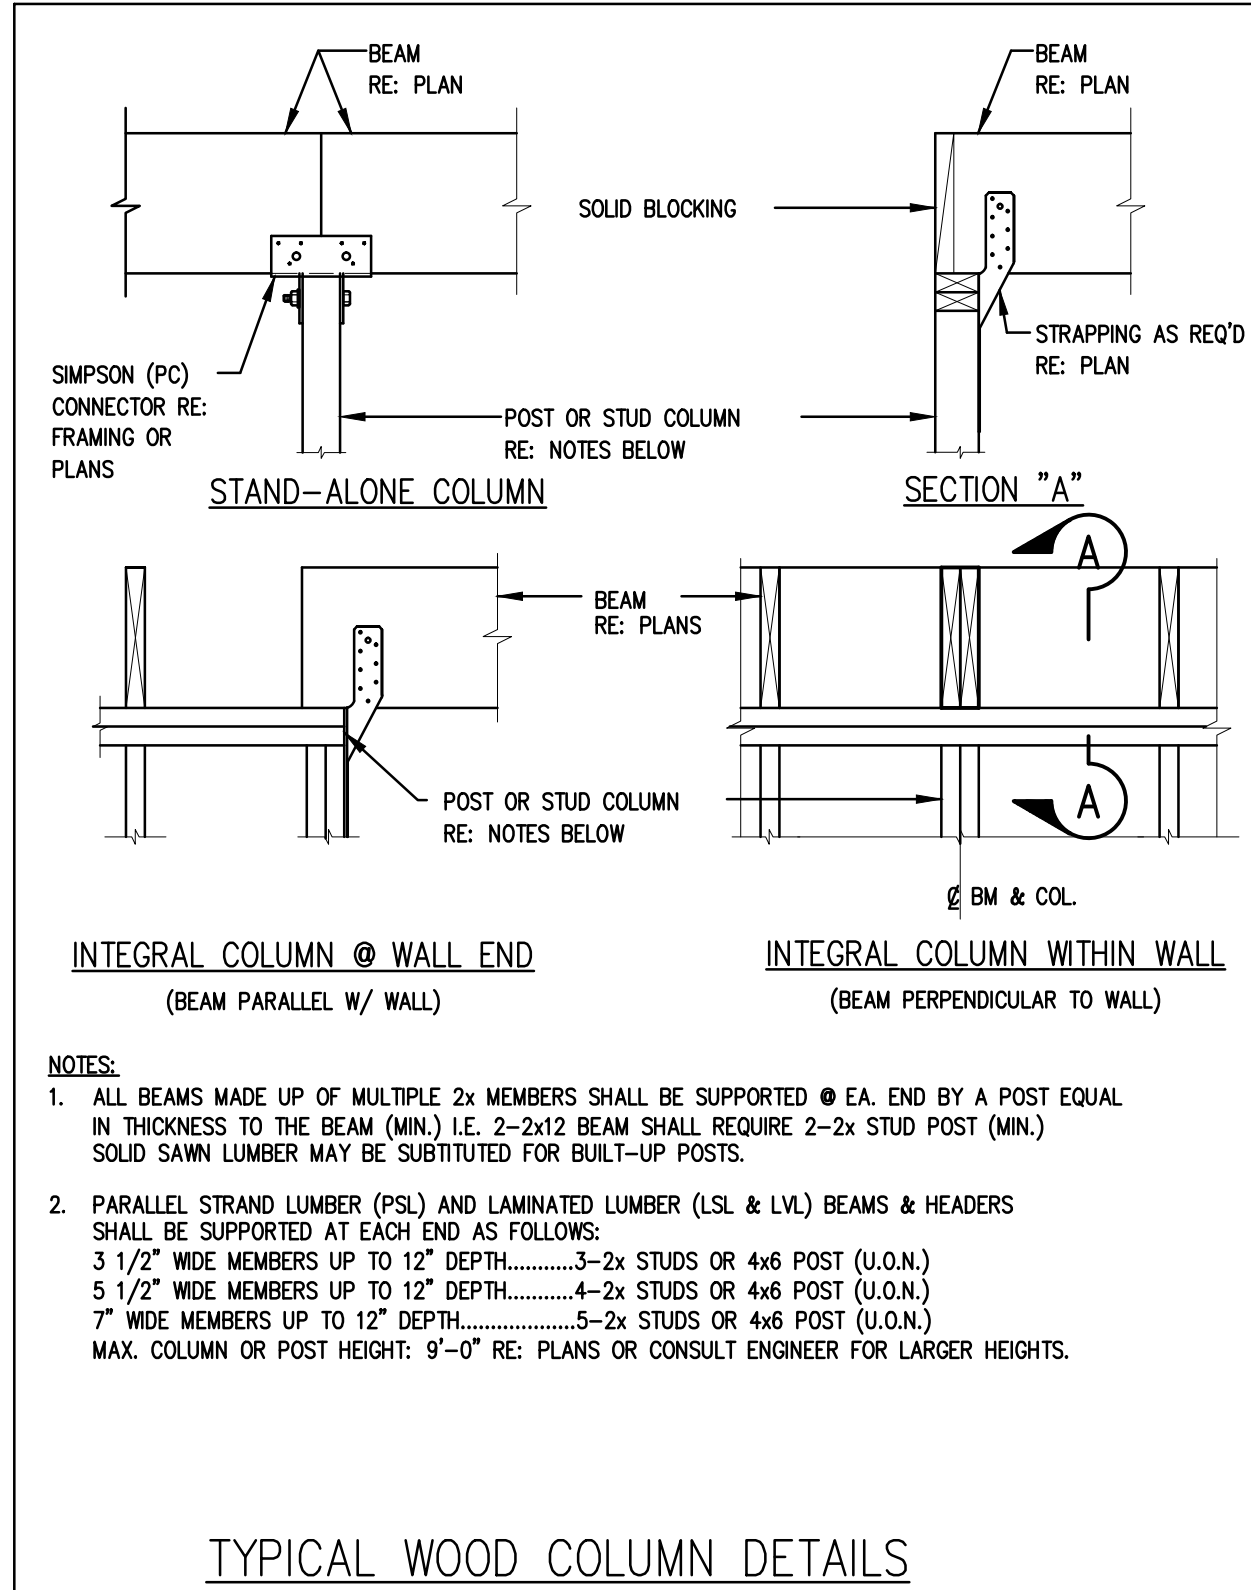

GENERAL NOTES


OPTIMUM PERSONAL CARE
1110 LAKEVIEW DRIVE
SUGAR LAND, TX. 77478

ISSUE HISTORY

DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION

10/25/13

Z:\SEAL.jpg

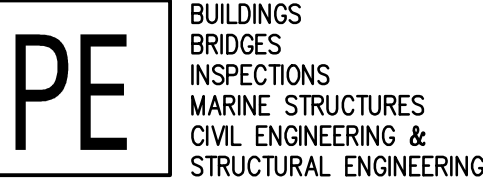

PARAMOUNT ENGINEERING LLC


7322 SOUTHWEST FREEWAY STE. 1050
HOUSTON, TX 77074
TEL : (713) 636-9977
FAX : (713) 888-9872
CEL : (713) 204-1742

TBPE REGISTRATION # F-3394


DRAWN BY: E.V. CHECKED BY: M.M.

PROJ. NO.: PE12-225

SHEET: **S8**

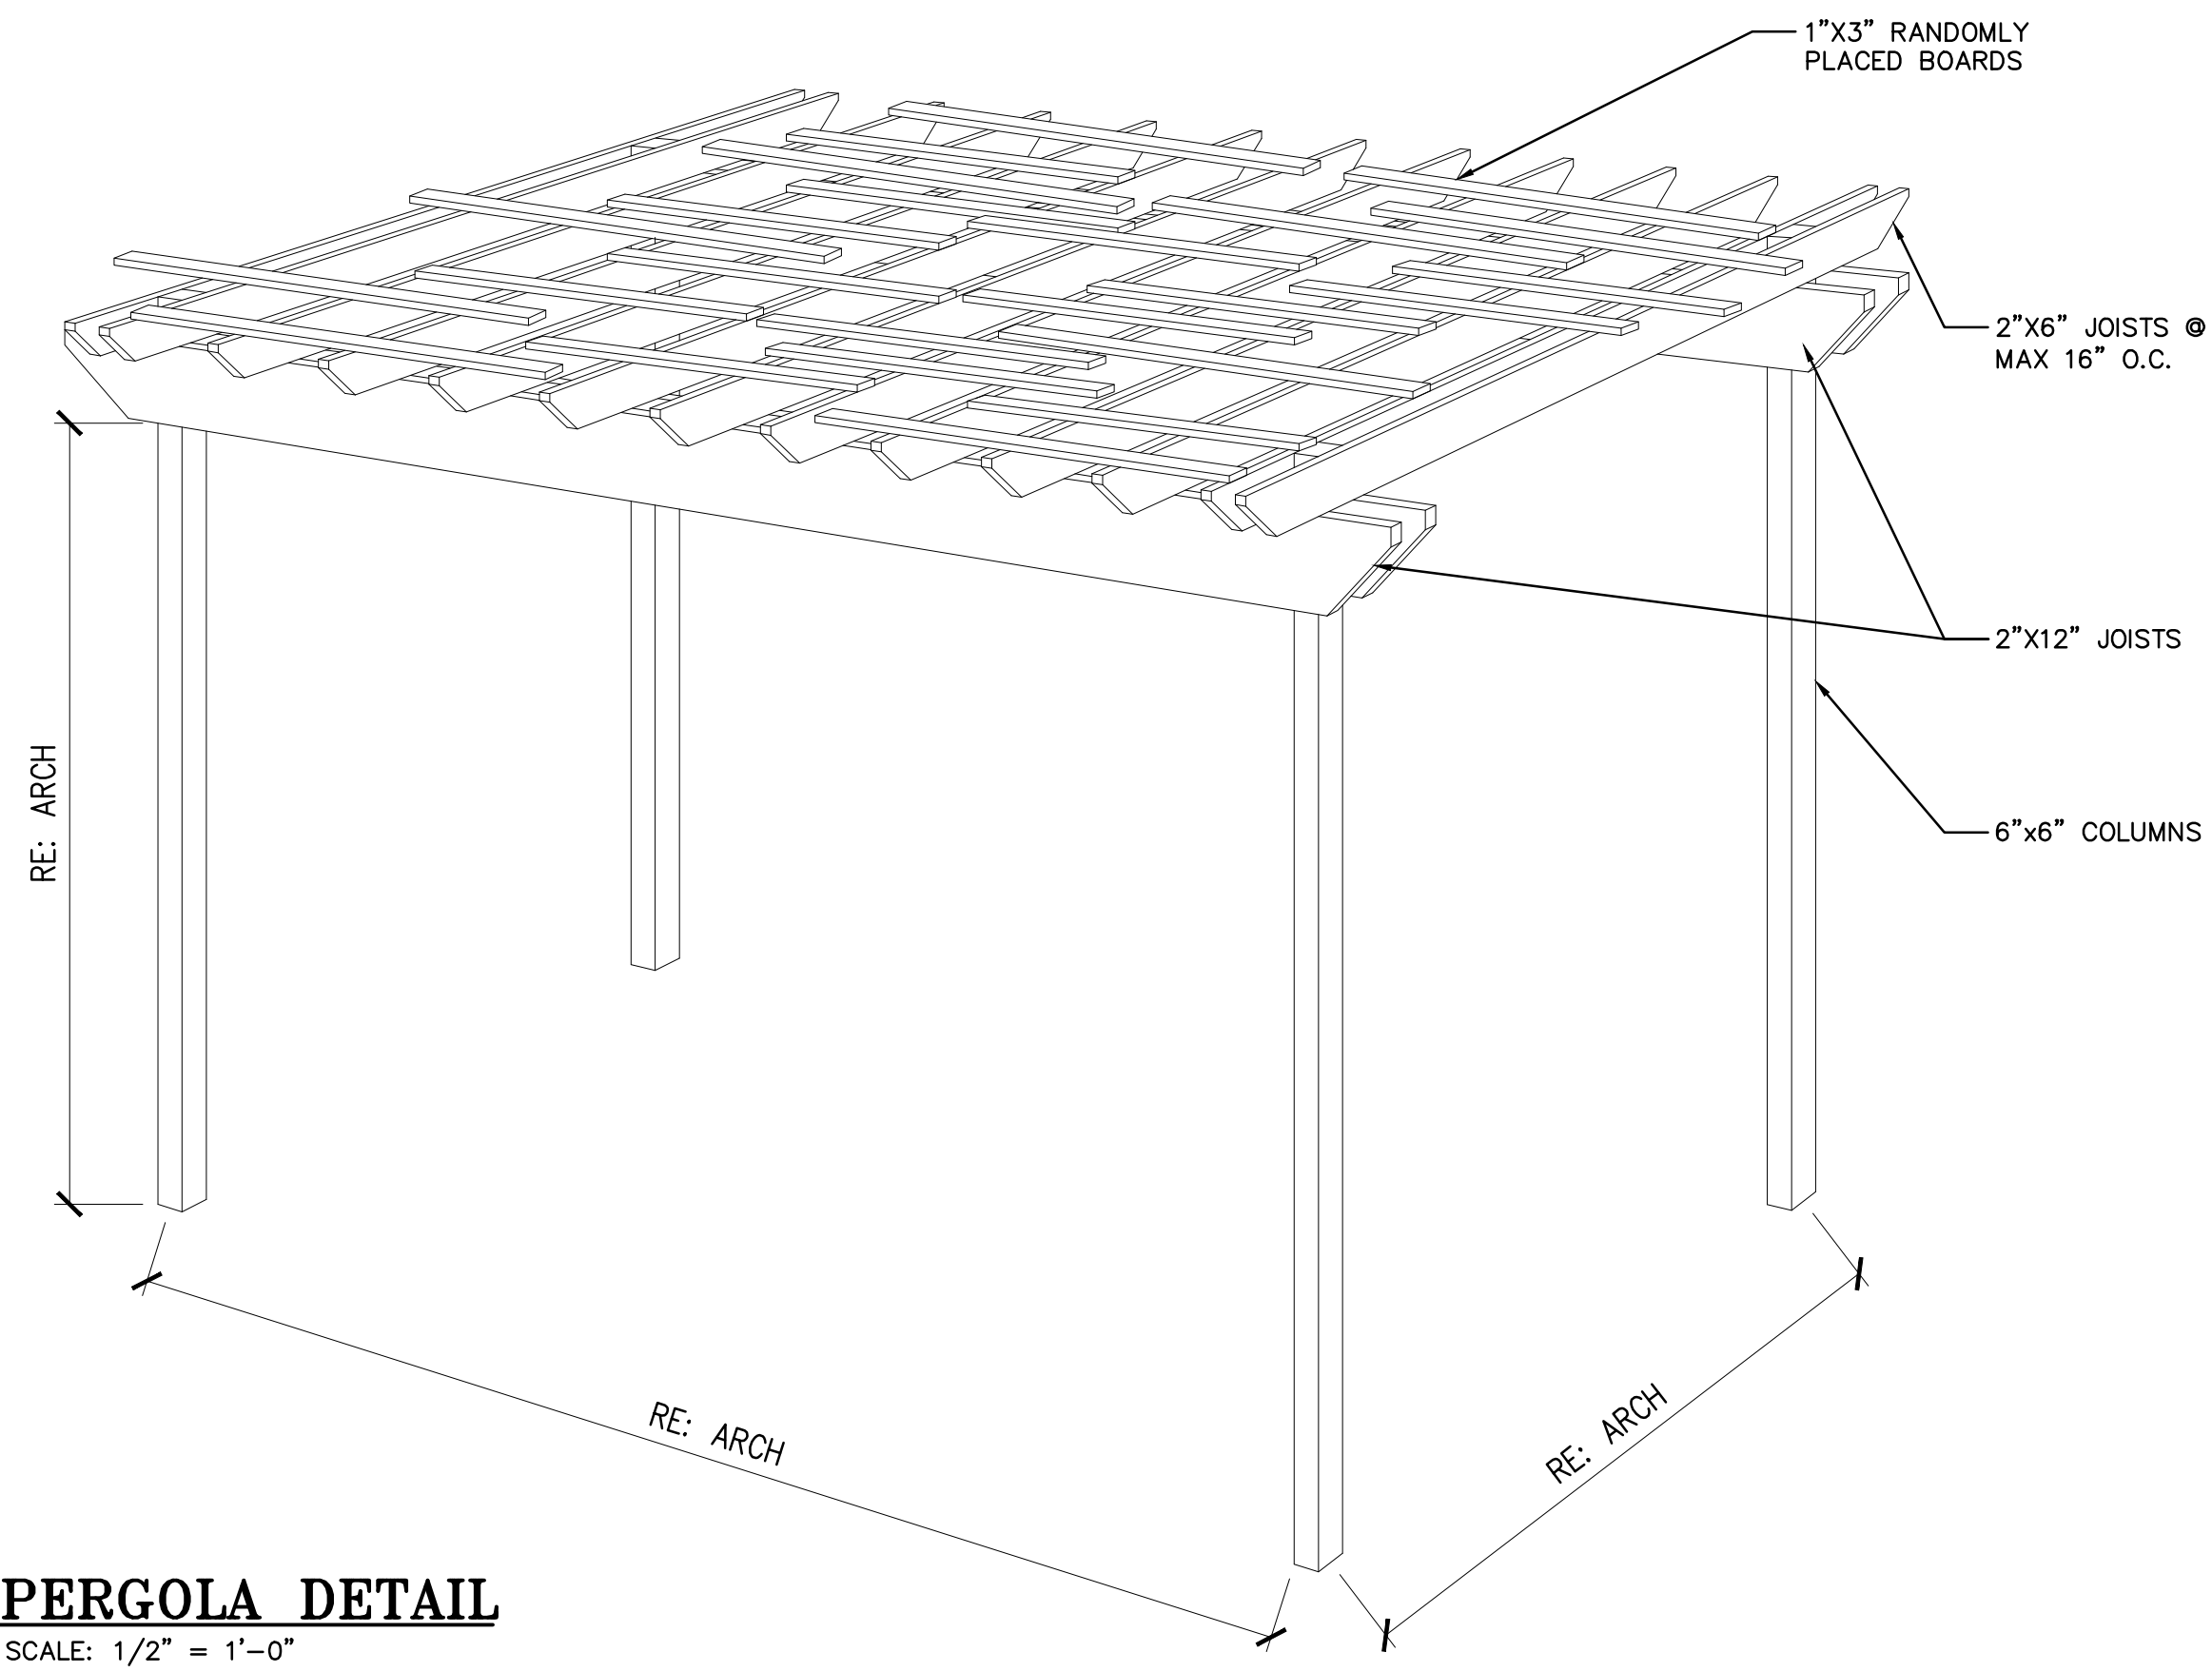


PERGOLA DETAIL
SCALE: 1/2" = 1'-0"

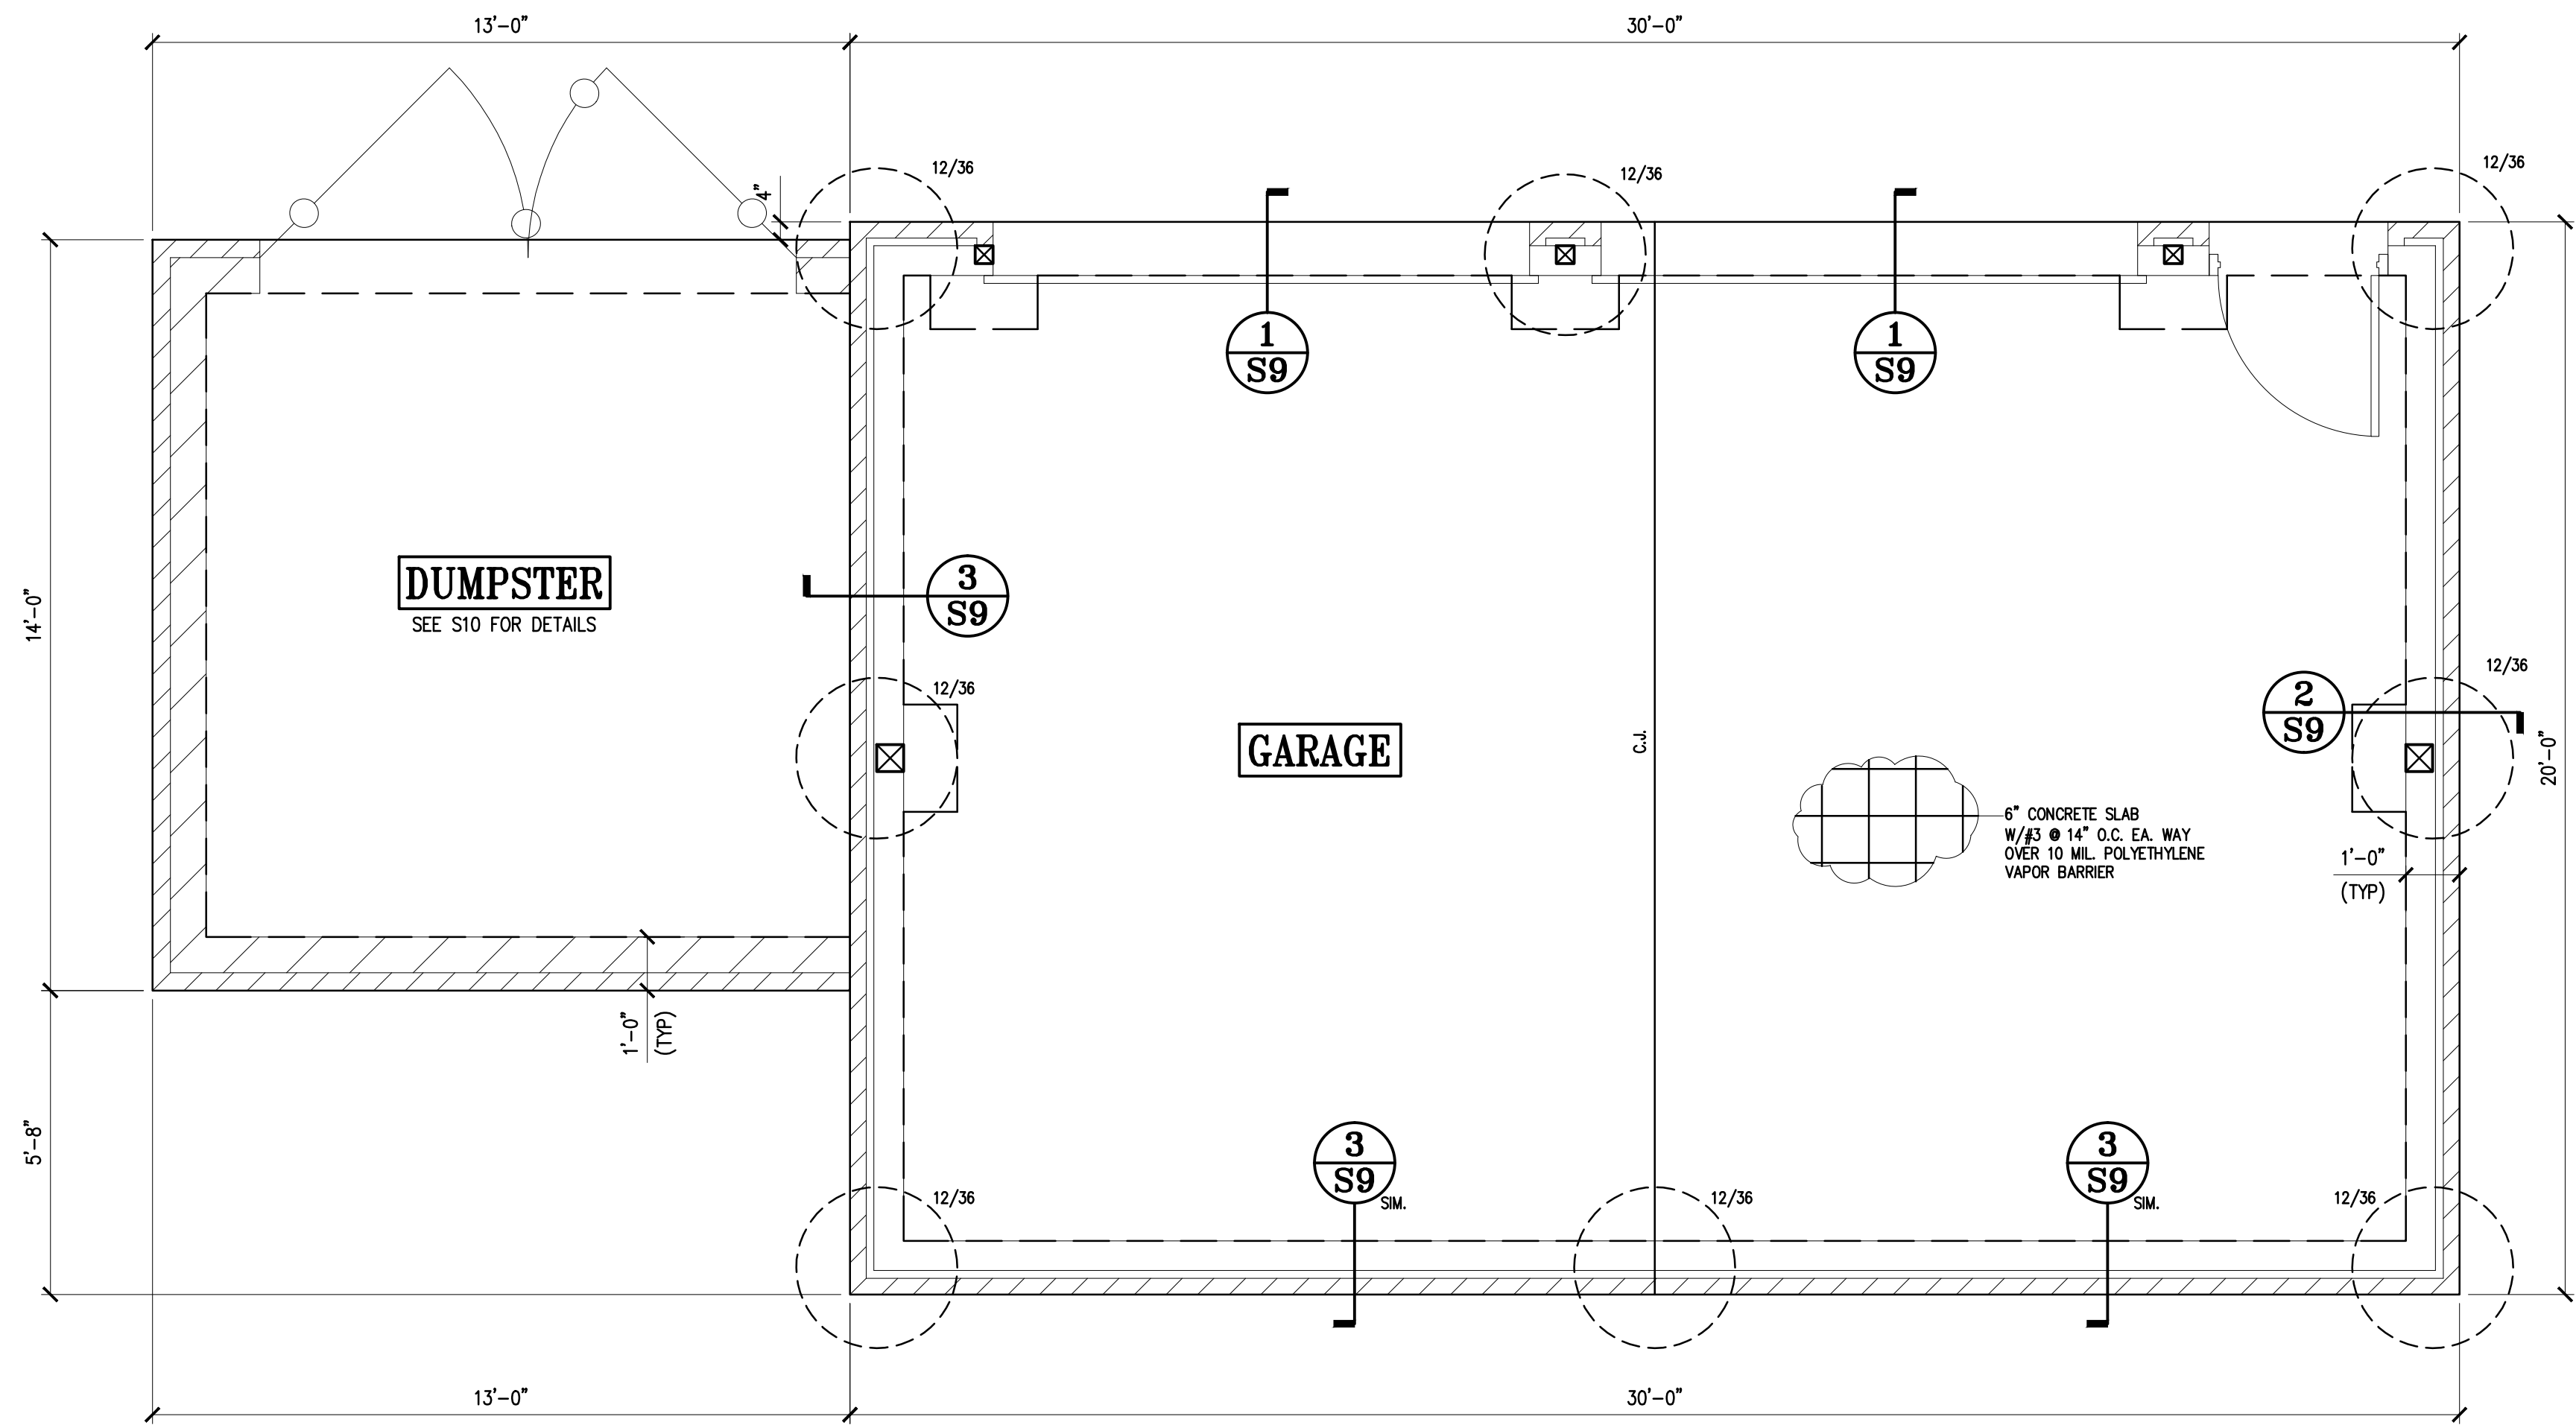


DUMPSTER GARAGE FOUNDATION PLAN


SCALE: 3/8" = 1'-0"

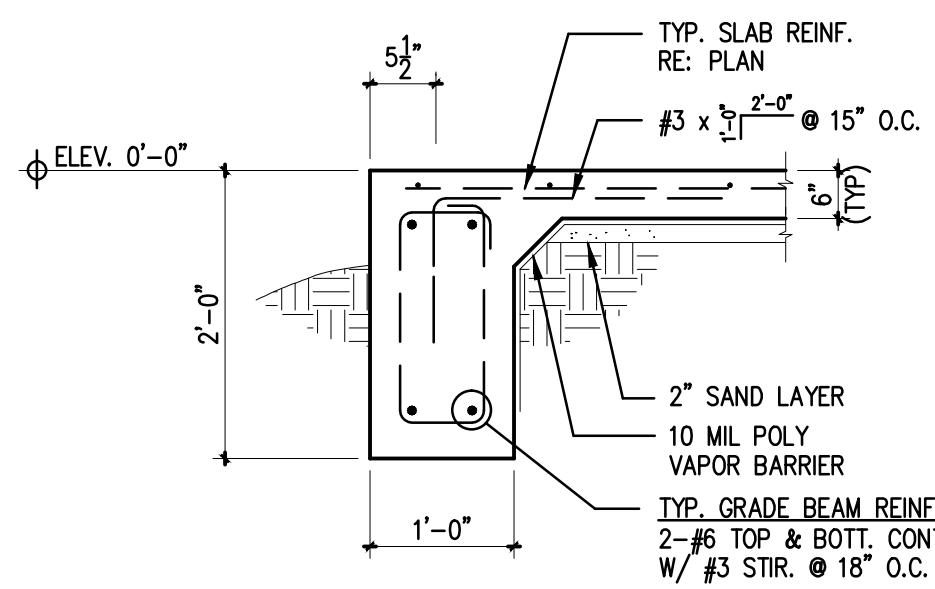


1 SECTION: TYPICAL GRADE BEAM @ O.H. DOOR

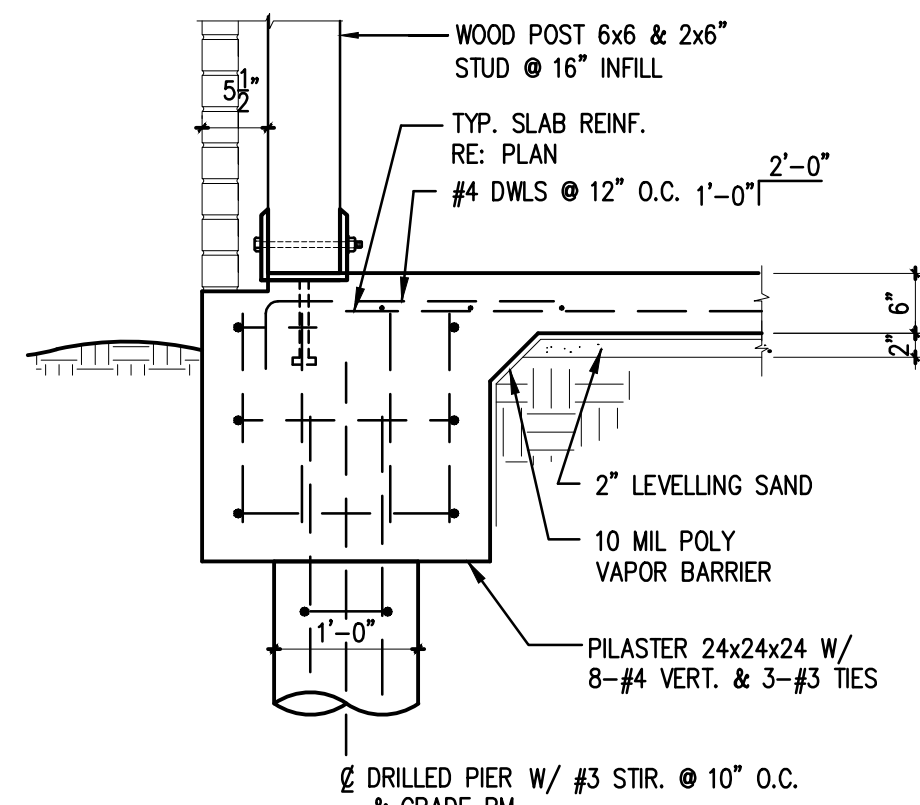

2 SECTION: AT COLUMN & WALL

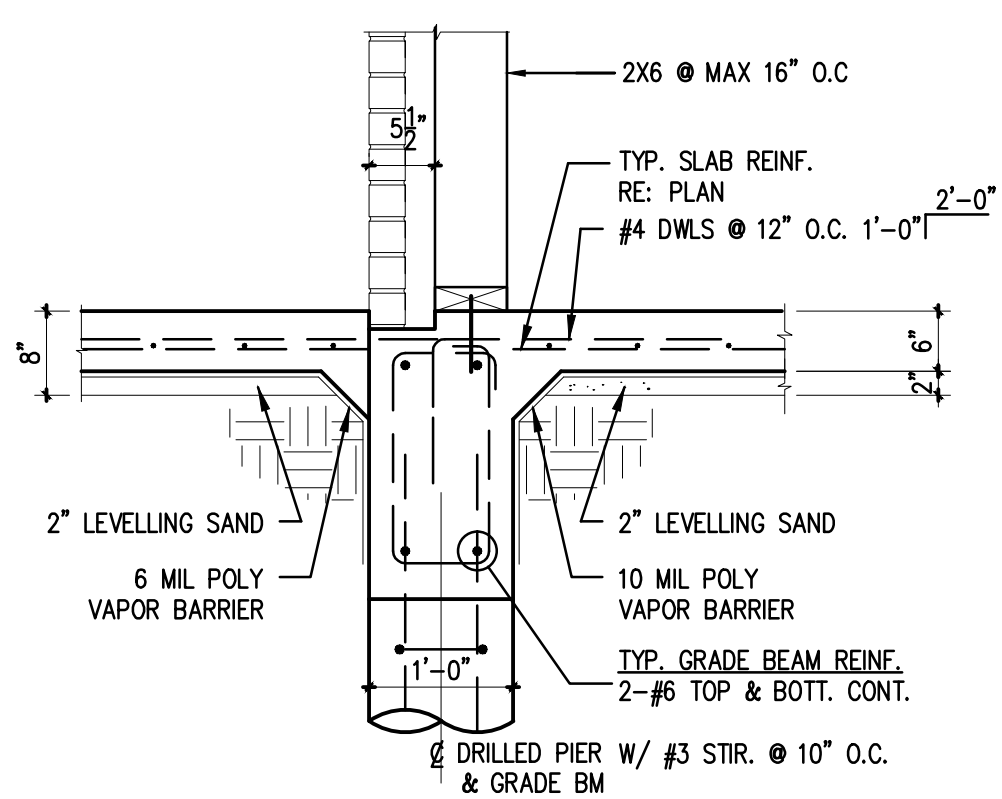


3 SECTION: AT EXTERIOR BEAM & WALL

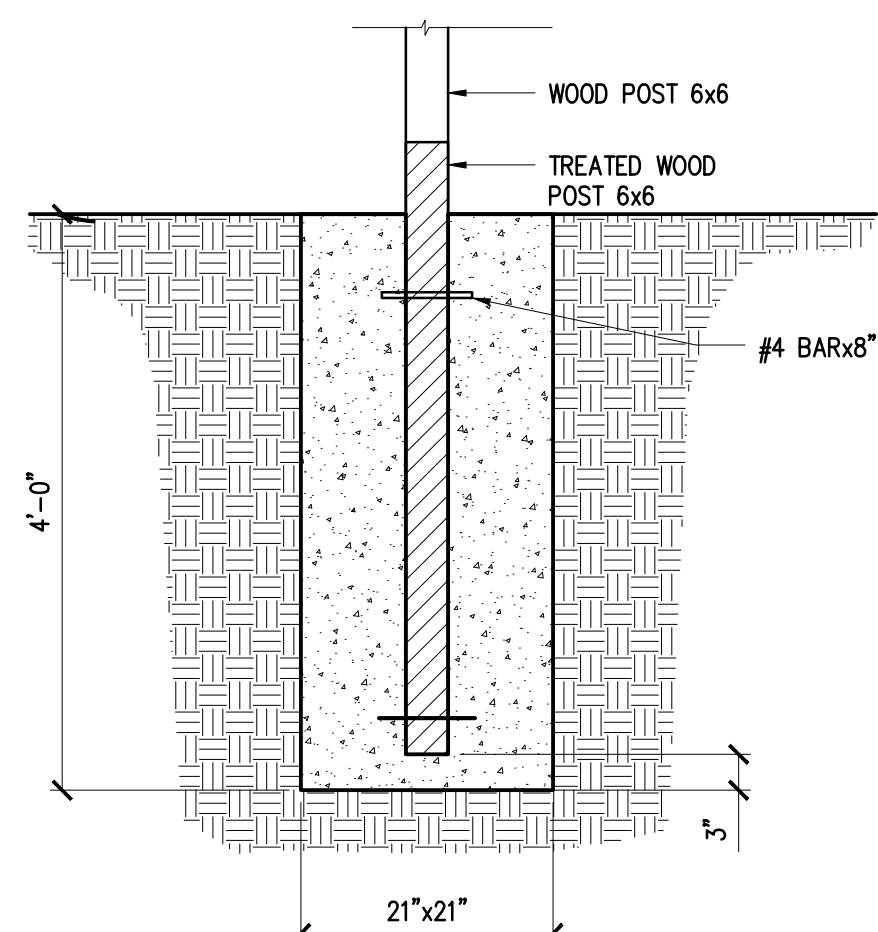

4 SECTION: PERGOLA POST FOUNDATION DETAIL

WALL DETAILS

- 2x6 STUD @ 16"
- 5/8" PLYWOOD ON EXTERIOR FACE OF WALLS
- ROOF DECK 5/8" PLYWOOD EXTERIOR GRADE

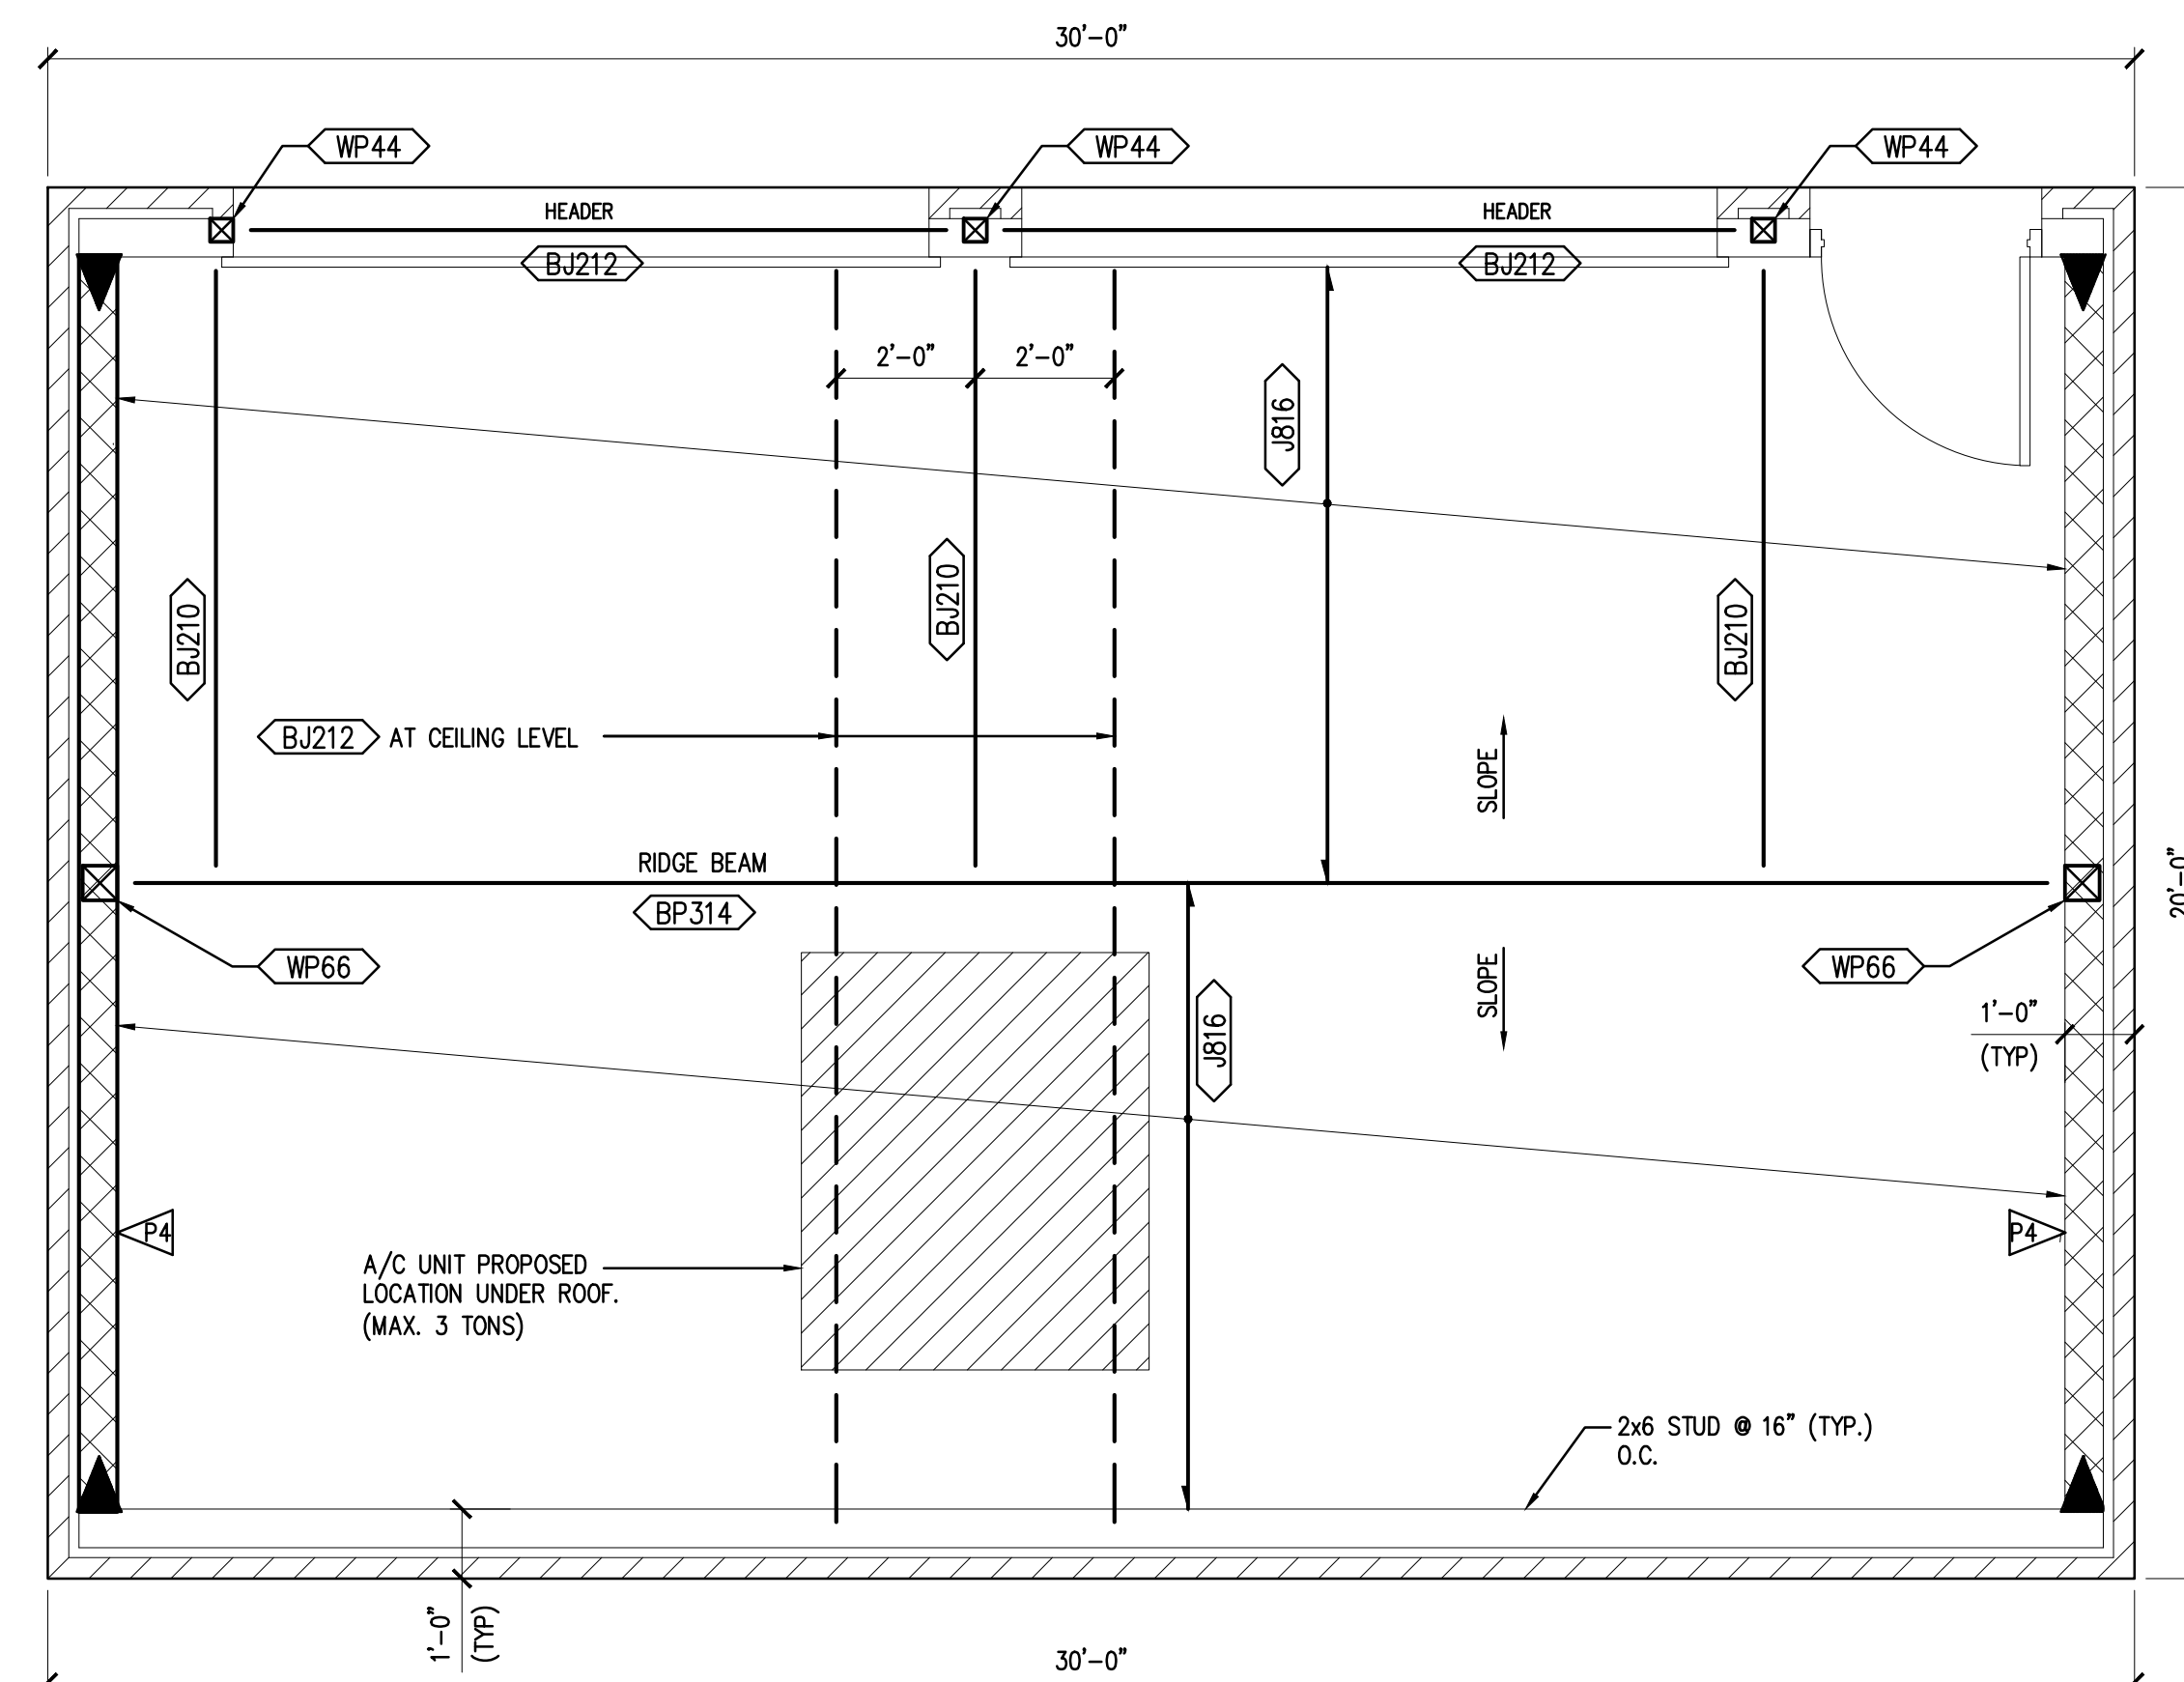

GARAGE ROOF FRAMING PLAN

SCALE: 3/8" = 1'-0"

GARAGE FOUNDATION & ROOF FRAMING

OPTIMUM PERSONAL CARE
1110 LAKEVIEW DRIVE
SUGAR LAND, TX. 77478

ISSUE HISTORY

DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION

09/03/13

Z:\SEAL.jpg

PE BUILDINGS
BRIDGES
INSPECTIONS
MARINE STRUCTURES
CIVIL ENGINEERING &
STRUCTURAL ENGINEERING

PARAMOUNT ENGINEERING LLC

7322 SOUTHWEST FREEWAY STE. 1050
HOUSTON, TX 77074


TEL : (713) 636-9977
FAX : (713) 888-9872
CEL : (713) 204-1742

TBPE REGISTRATION # F-3394


DRAWN BY: E.V. CHECKED BY: M.M.

PROJ. NO.: PE12-225


SHEET: **S9**

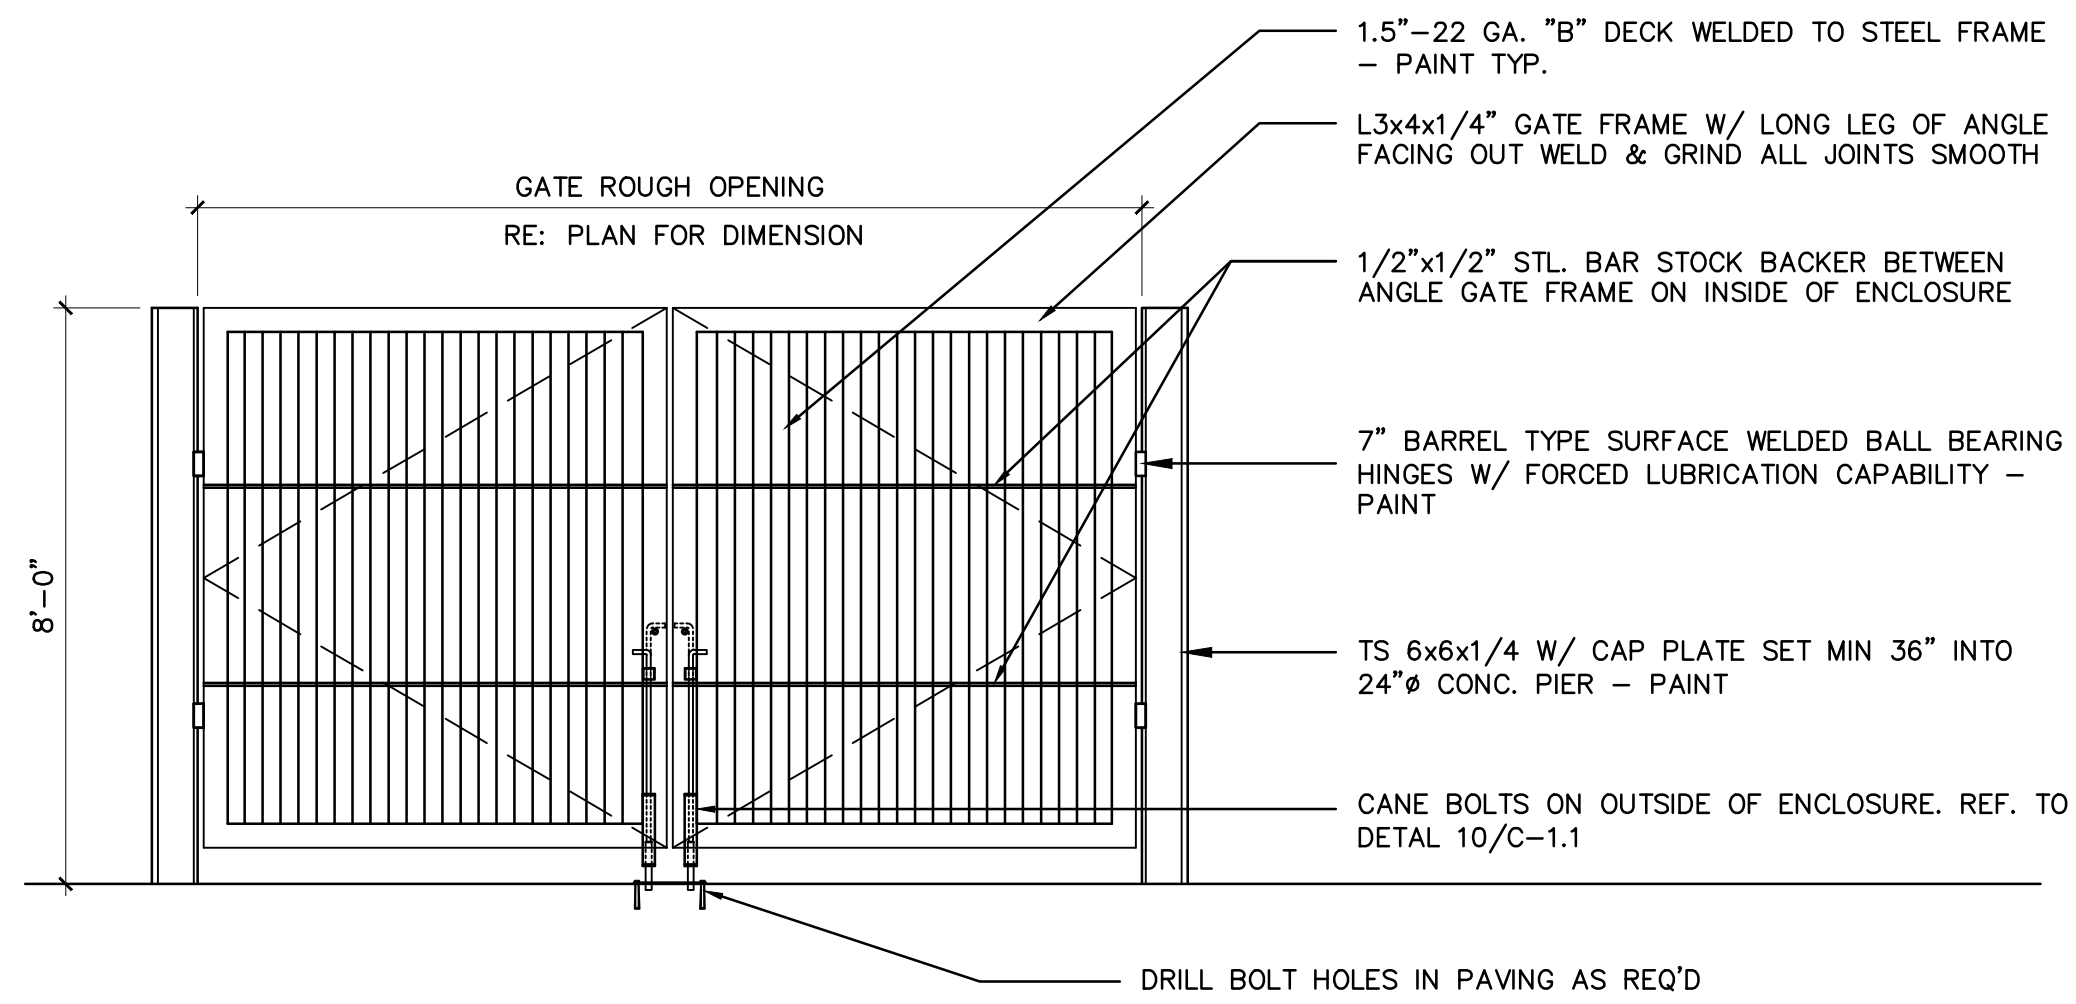


1 TRASH ENCLOSURE GATE ELEV.
SCALE: 3/8" = 1'-0"

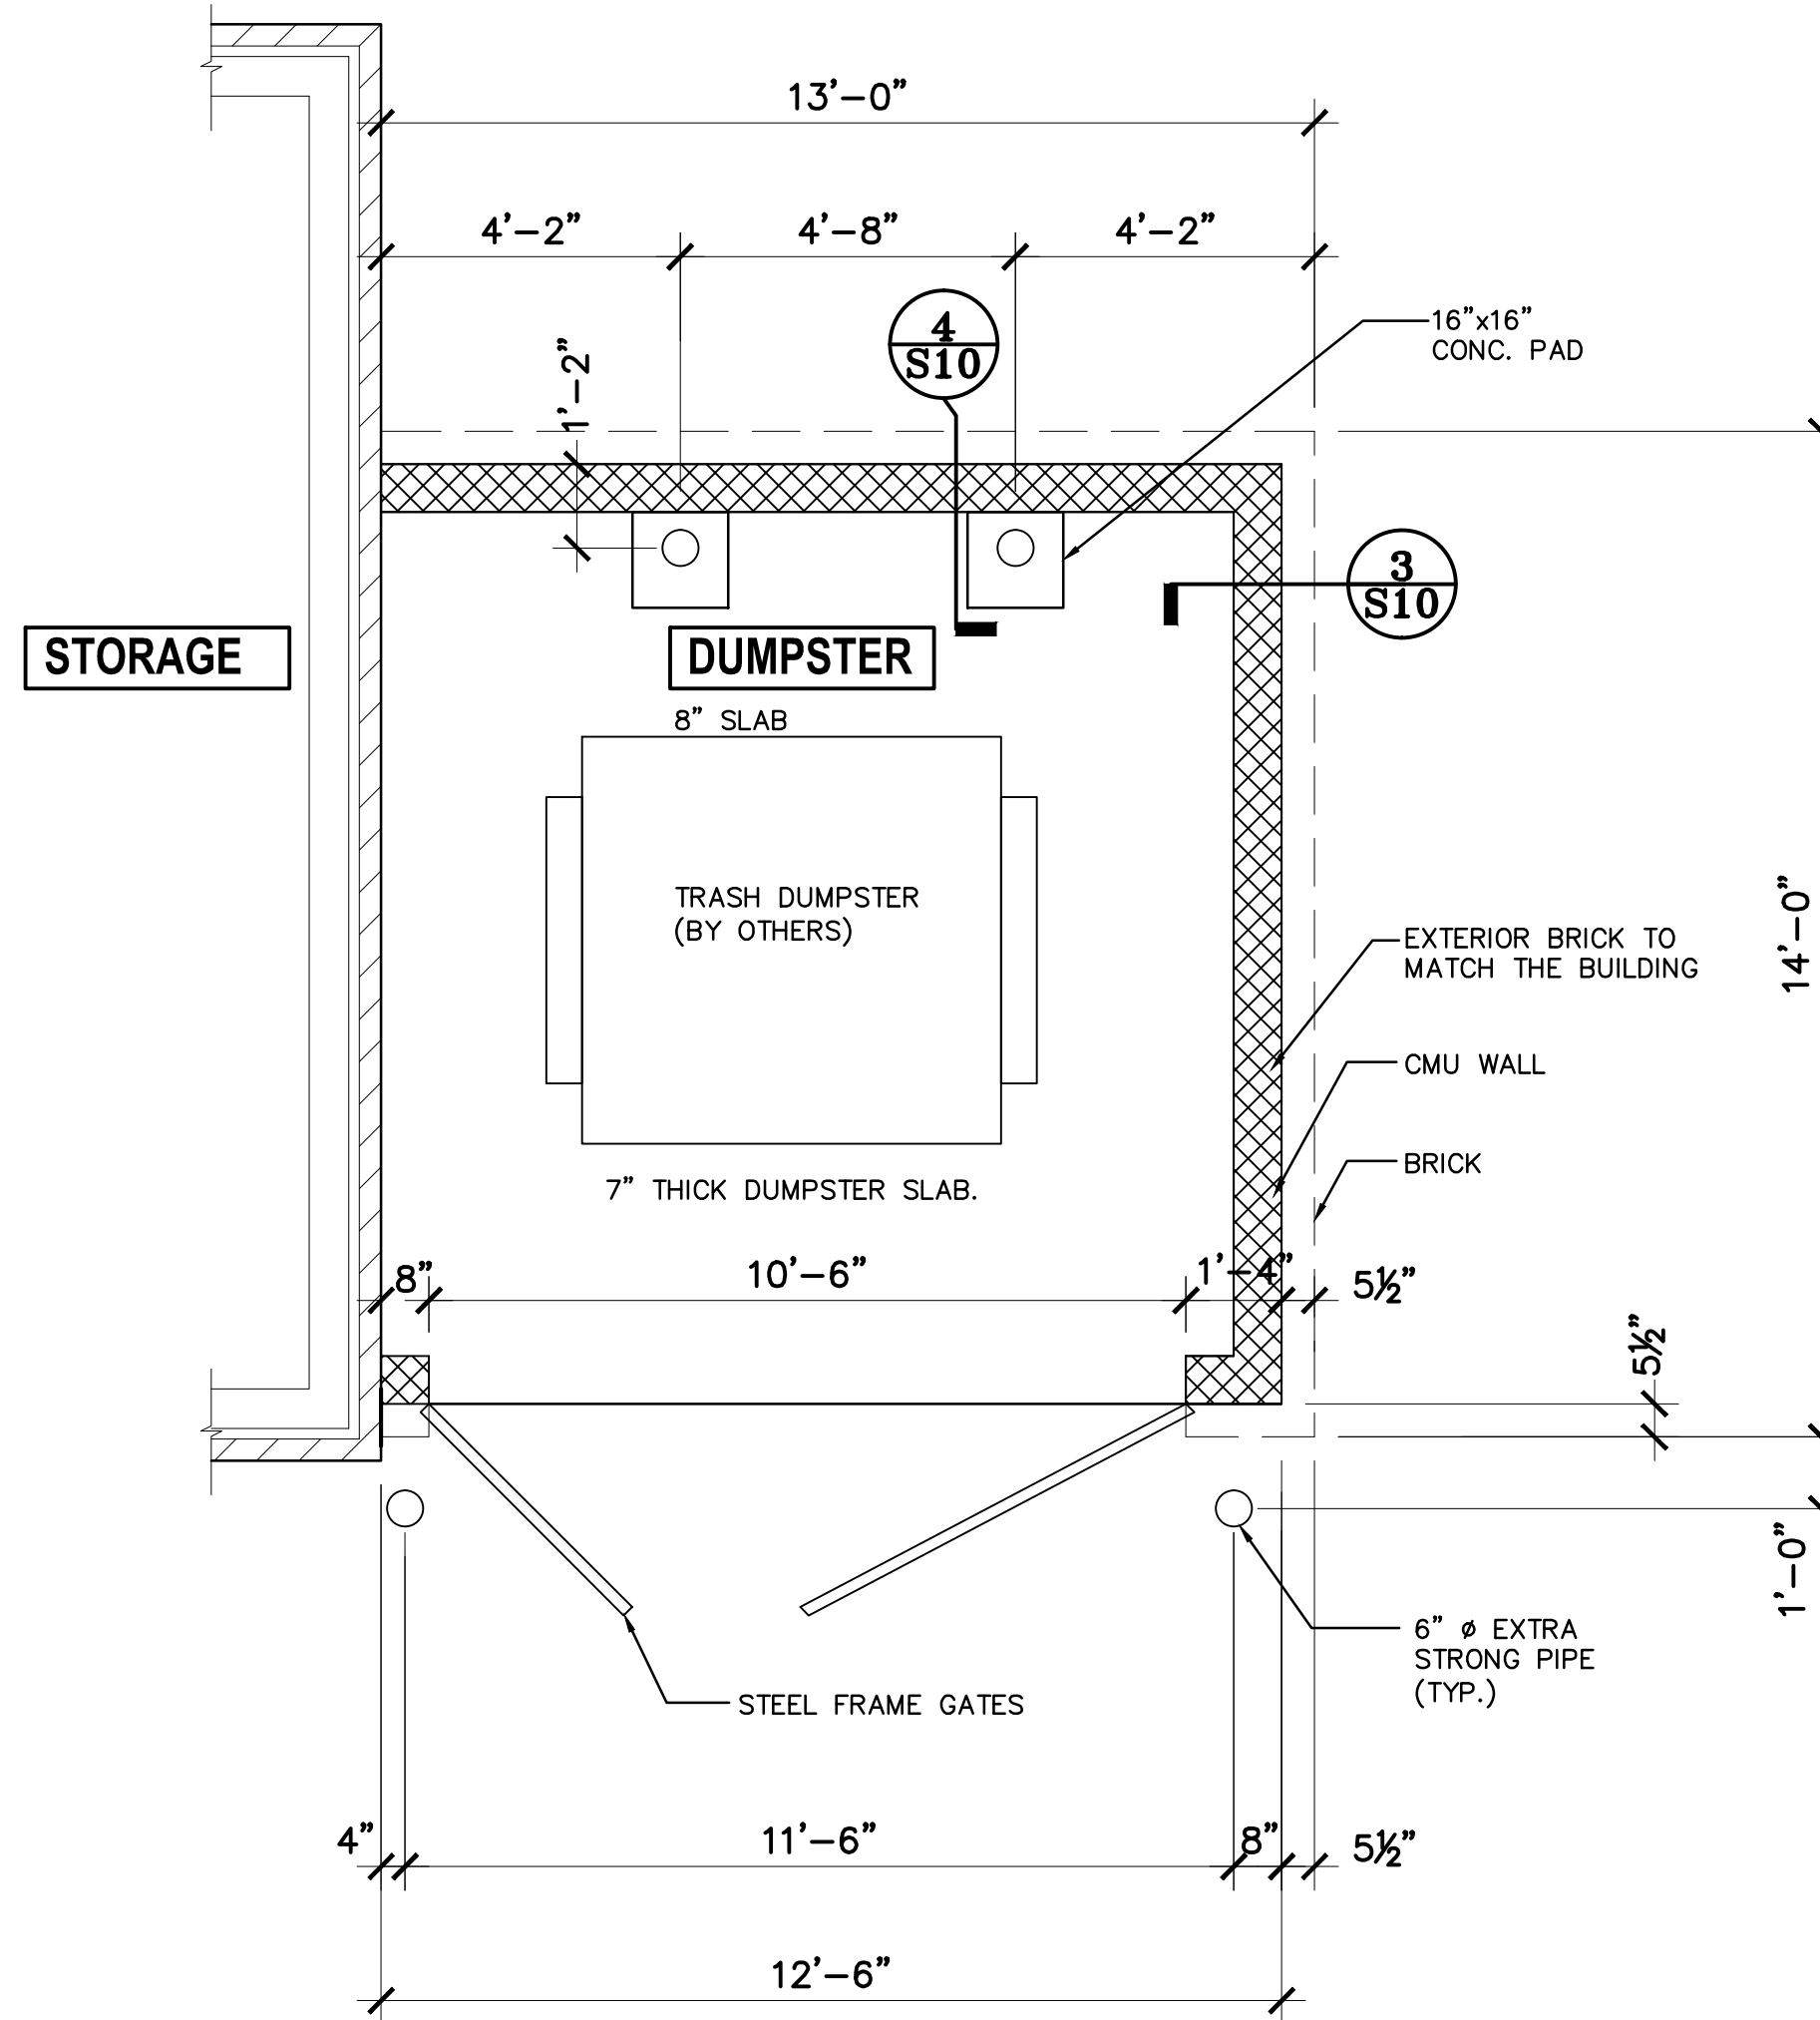


2 TRASH ENCLOSURE PLAN
SCALE: 3/8" = 1'-0"

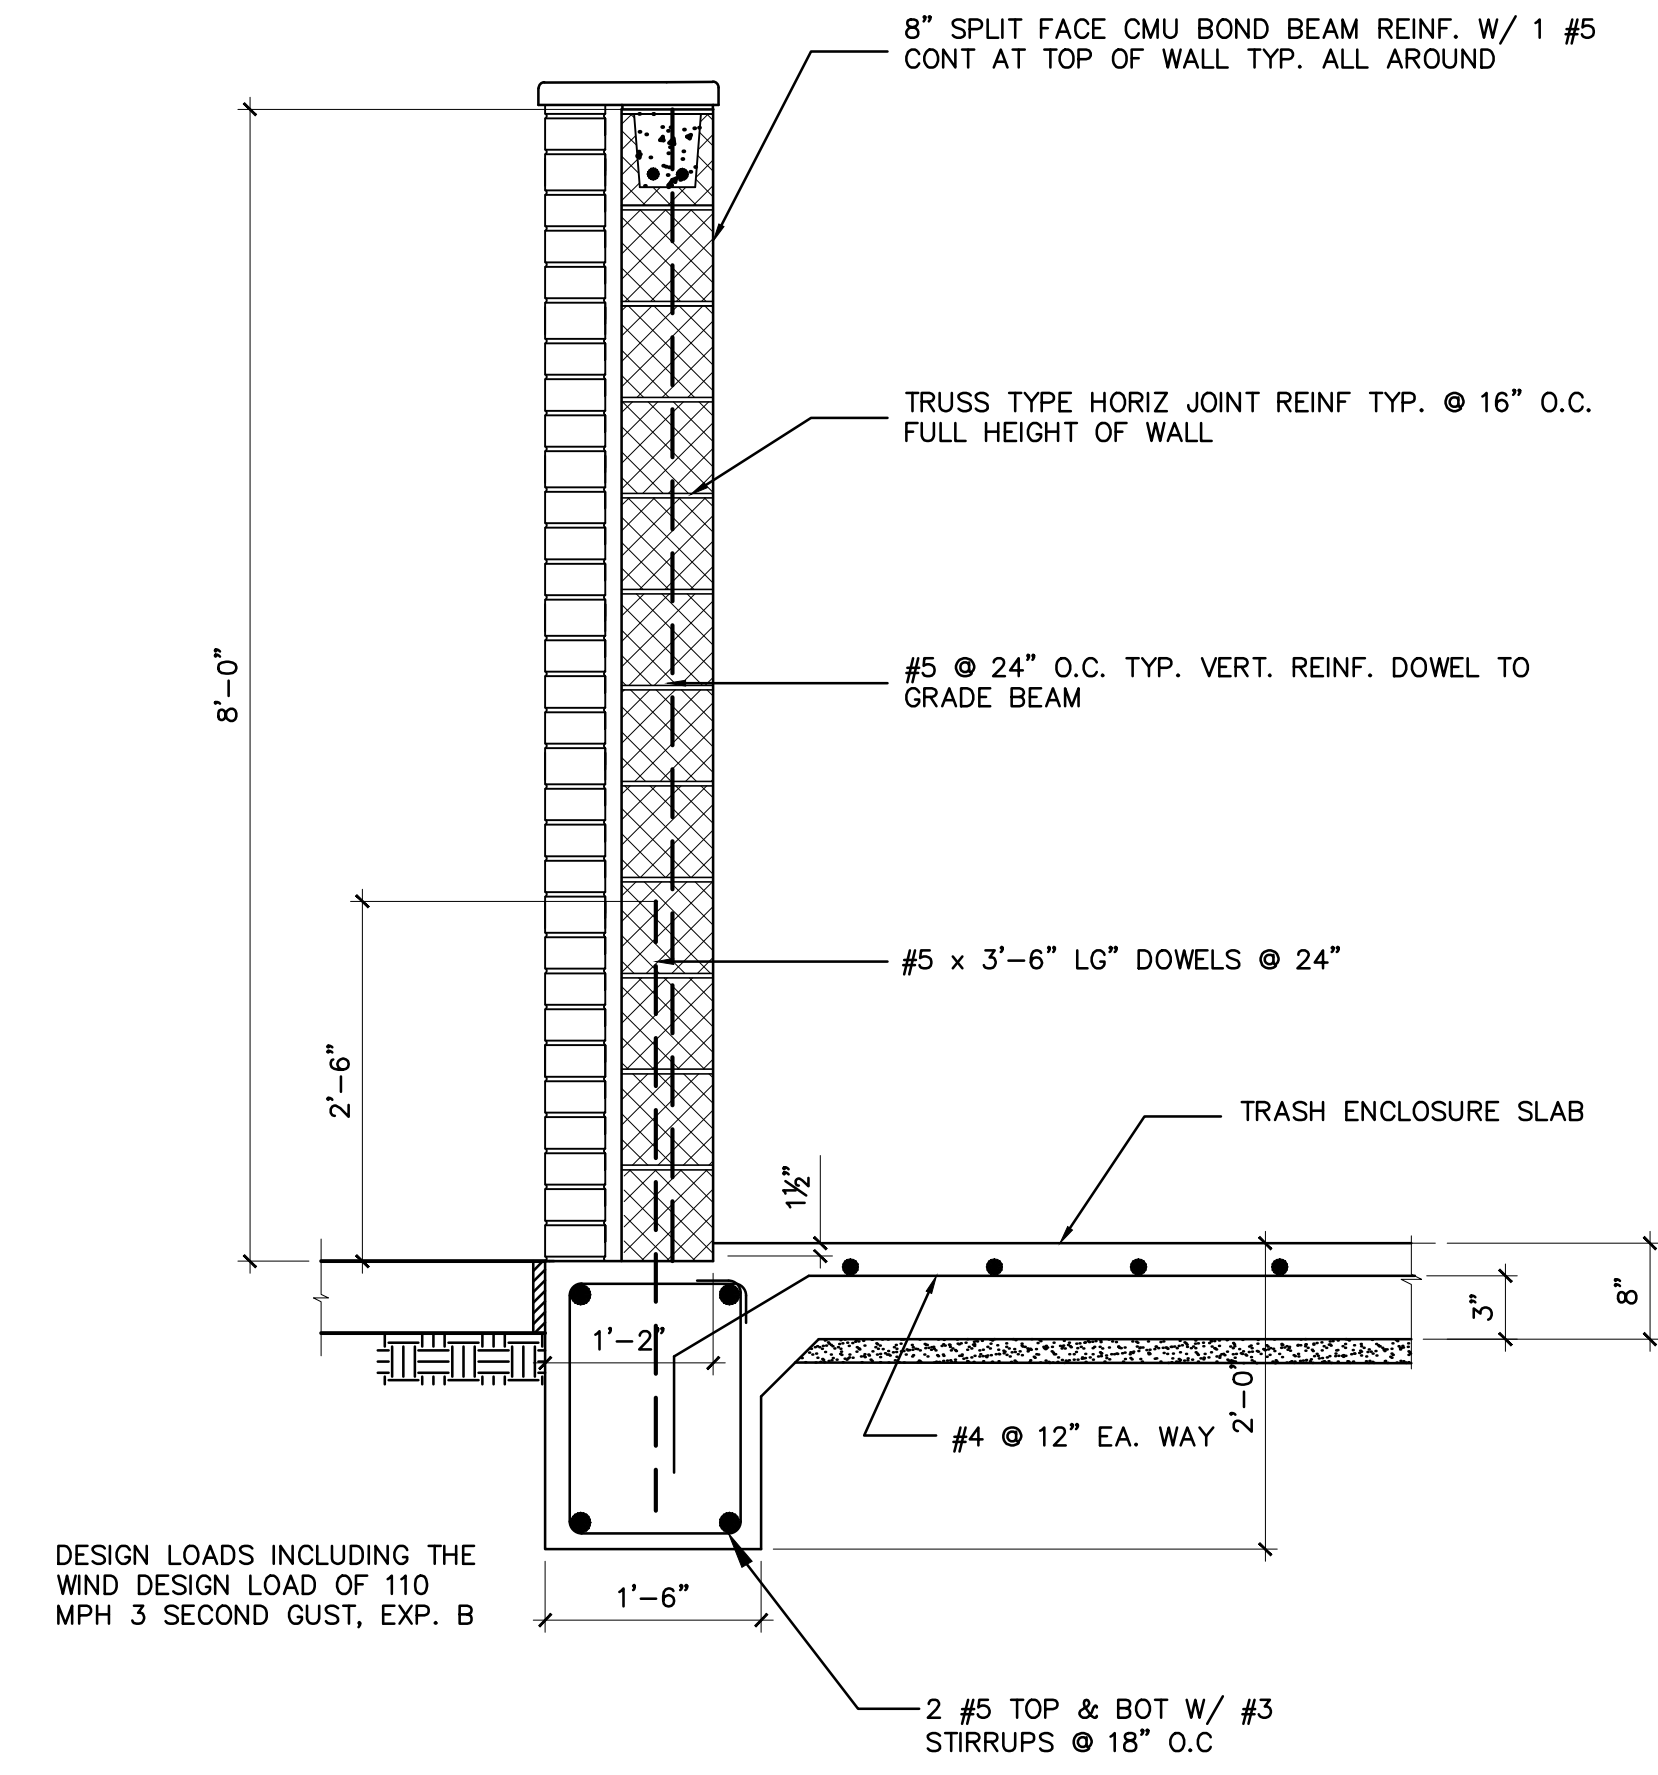


3 TRASH ENCLOSURE WALL/ FOUNDATION
SCALE: 3/4" = 1'-0"

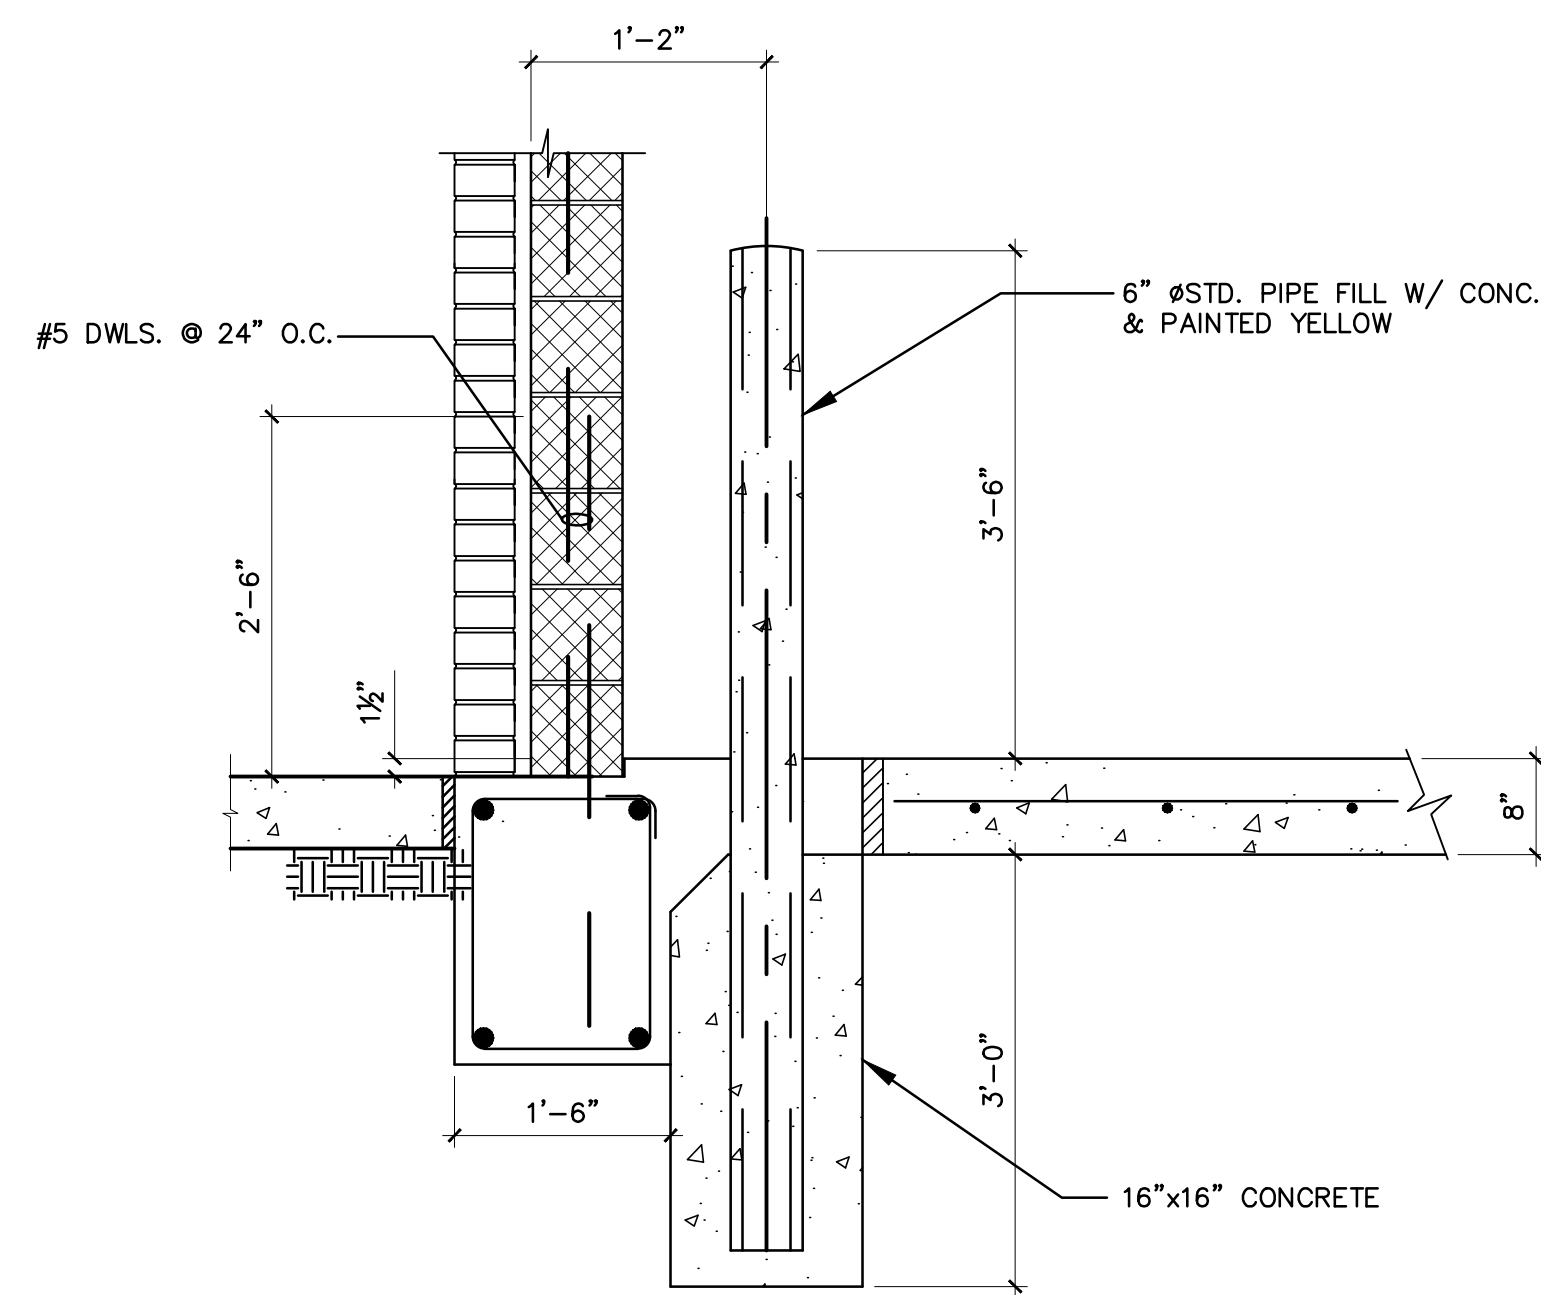

4 SECTION:
SCALE: 3/4" = 1'-0"

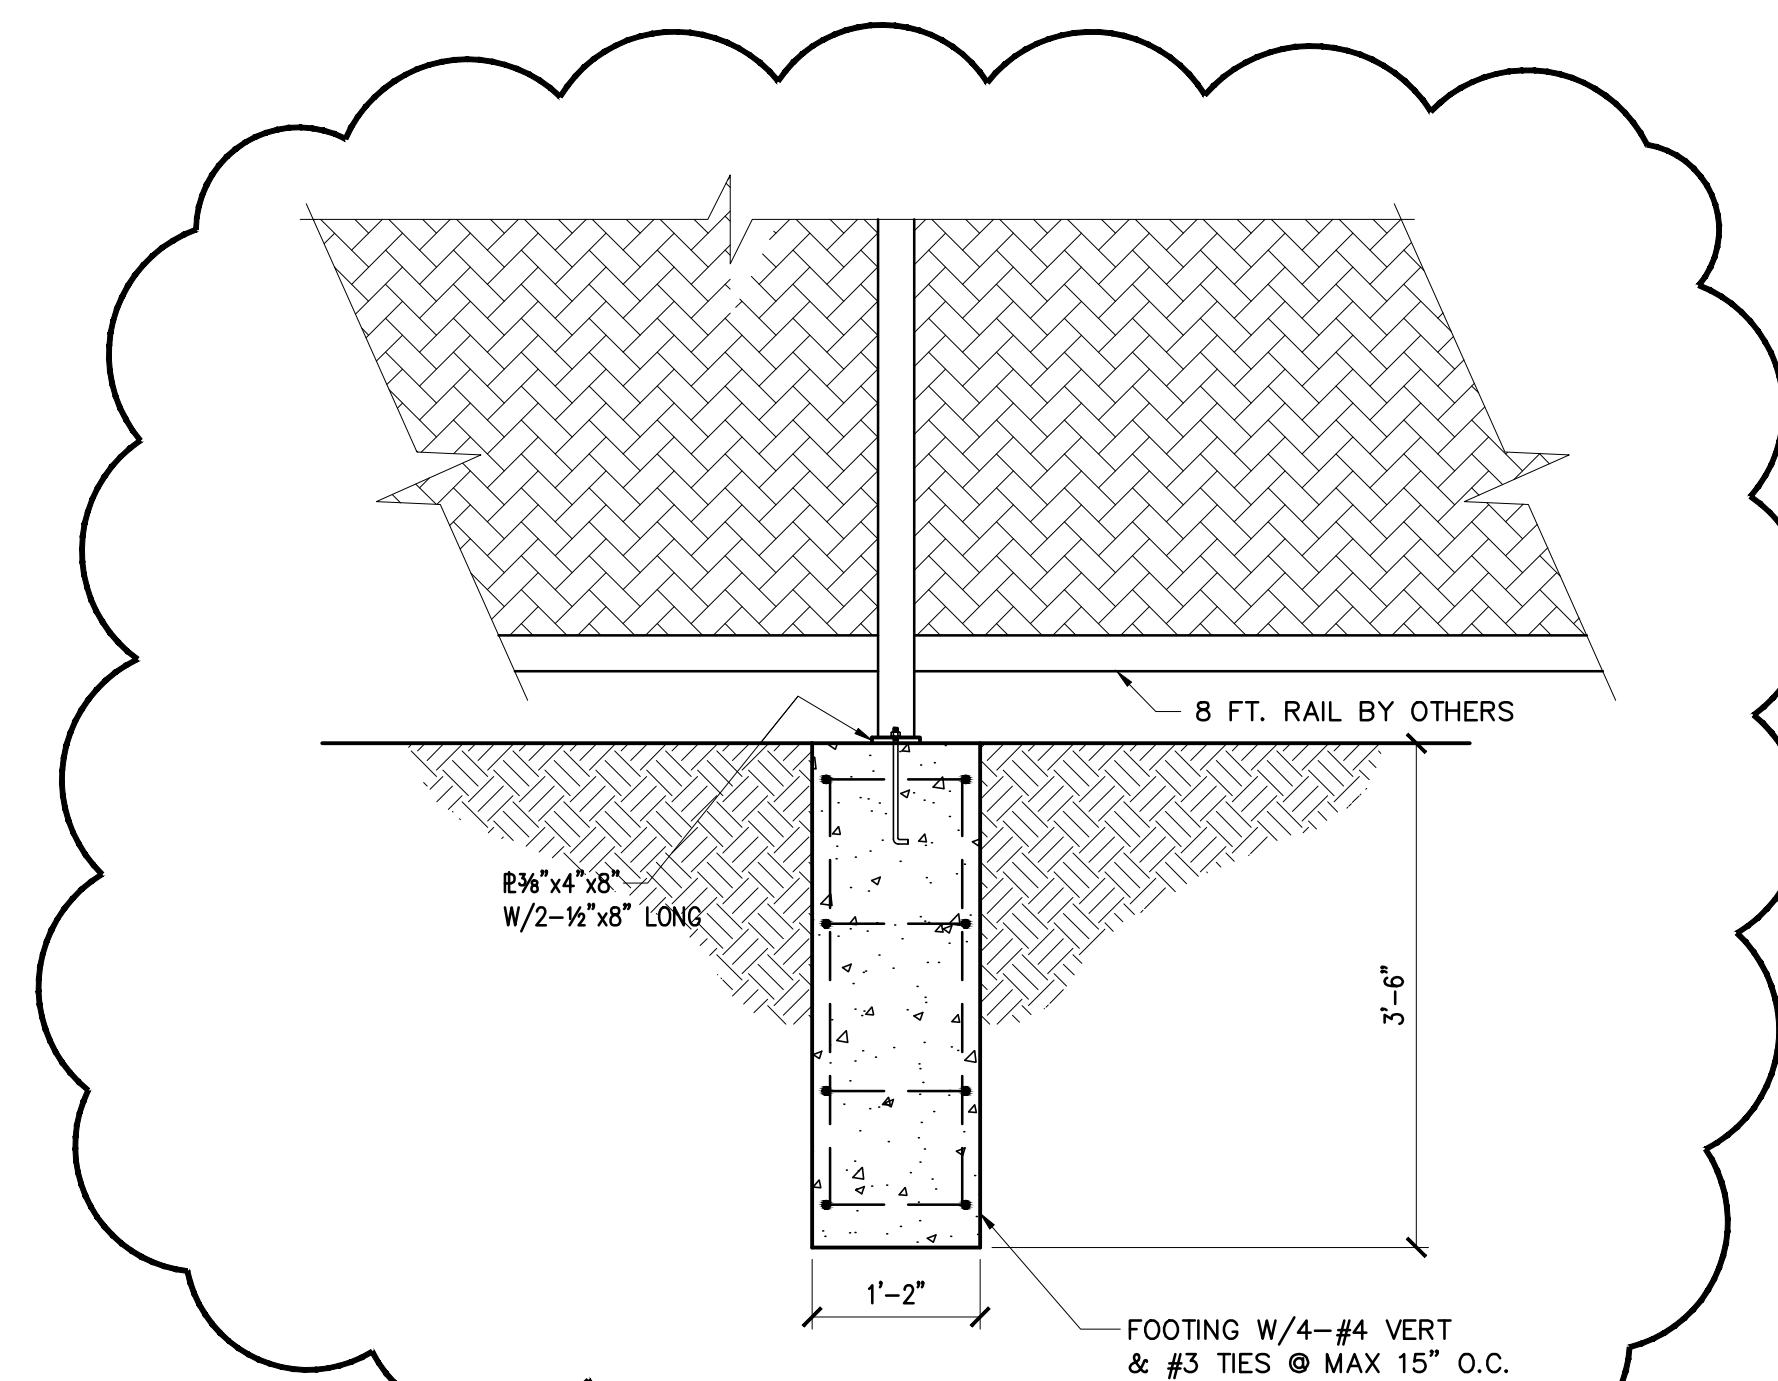

6 SECTION: FENCE POST FOUNDATION
SCALE: 3/4" = 1'-0"

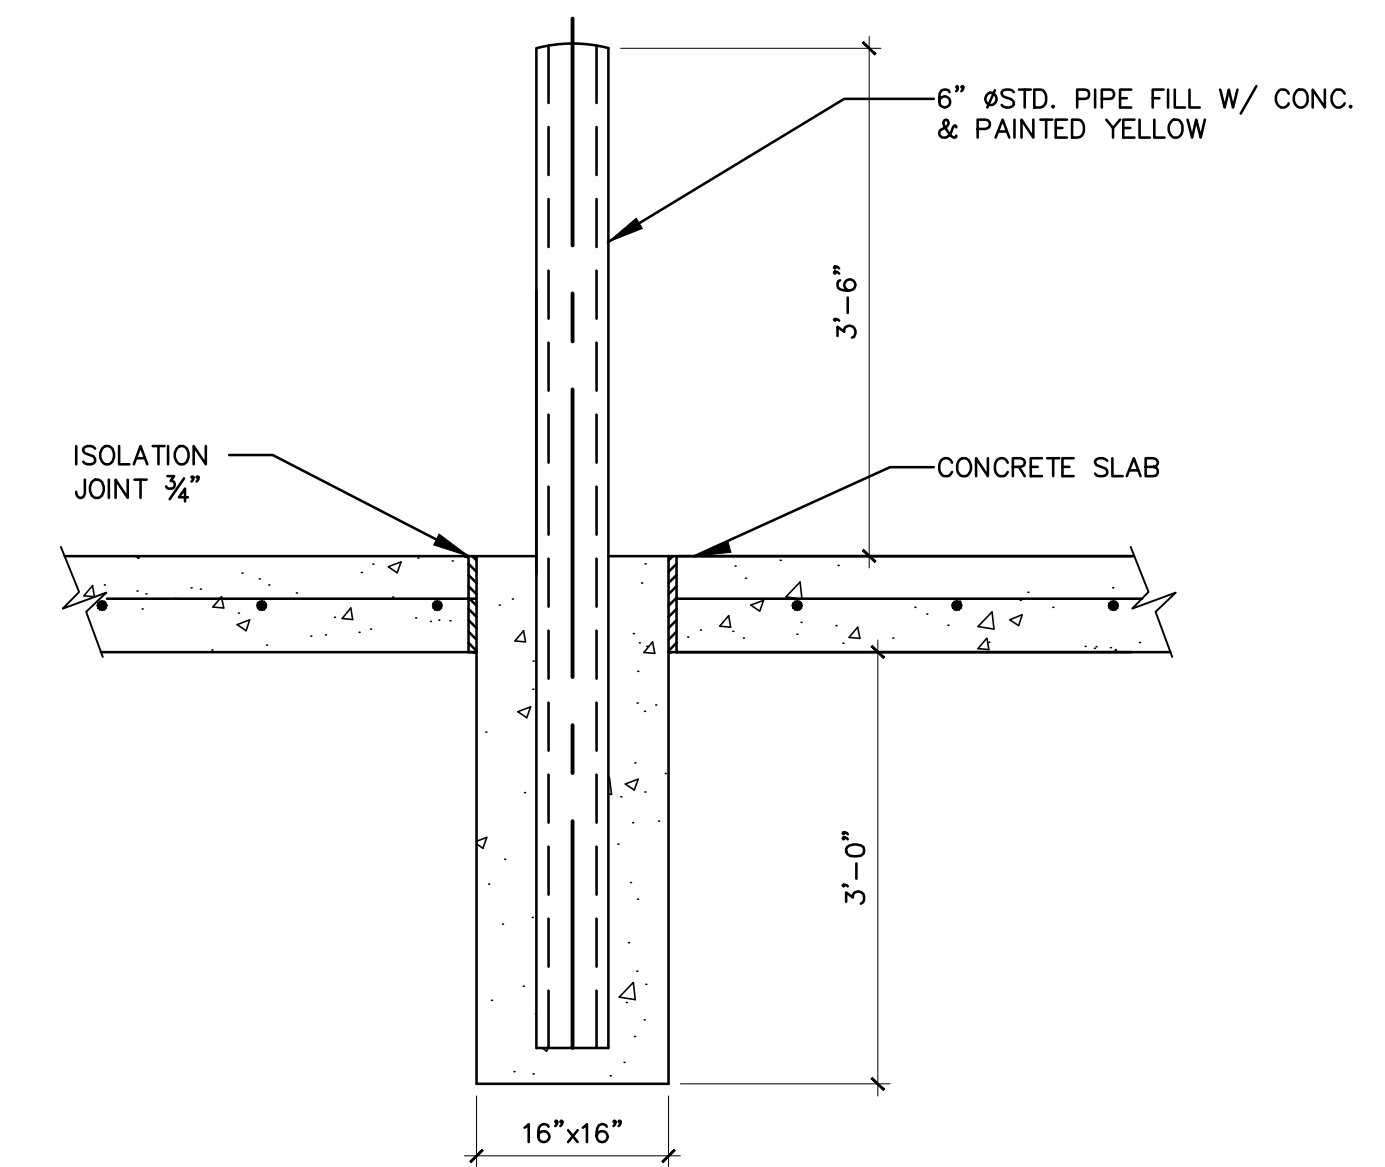

5 SECTION: TYP. BOLLARD DETAIL
SCALE: 3/4" = 1'-0"

GARAGE & DUMPSTER FOUNDATION

OPTIMUM PERSONAL CARE
1110 LAKEVIEW DRIVE
SUGAR LAND, TX. 77478

ISSUE HISTORY

DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION

10/07/13

Z:\SEAL.jpg

PE BUILDINGS
BRIDGES
INSPECTIONS
MARINE STRUCTURES
CIVIL ENGINEERING &
STRUCTURAL ENGINEERING

PARAMOUNT ENGINEERING LLC

7322 SOUTHWEST FREEWAY STE. 1050
HOUSTON, TX 77074


TEL : (713) 636-9977
FAX : (713) 888-9872
CEL : (713) 204-1742

TBPE REGISTRATION # F-3394


DRAWN BY: E.V. CHECKED BY: M.M.

PROJ. NO.: PE12-225


SHEET: **S10**

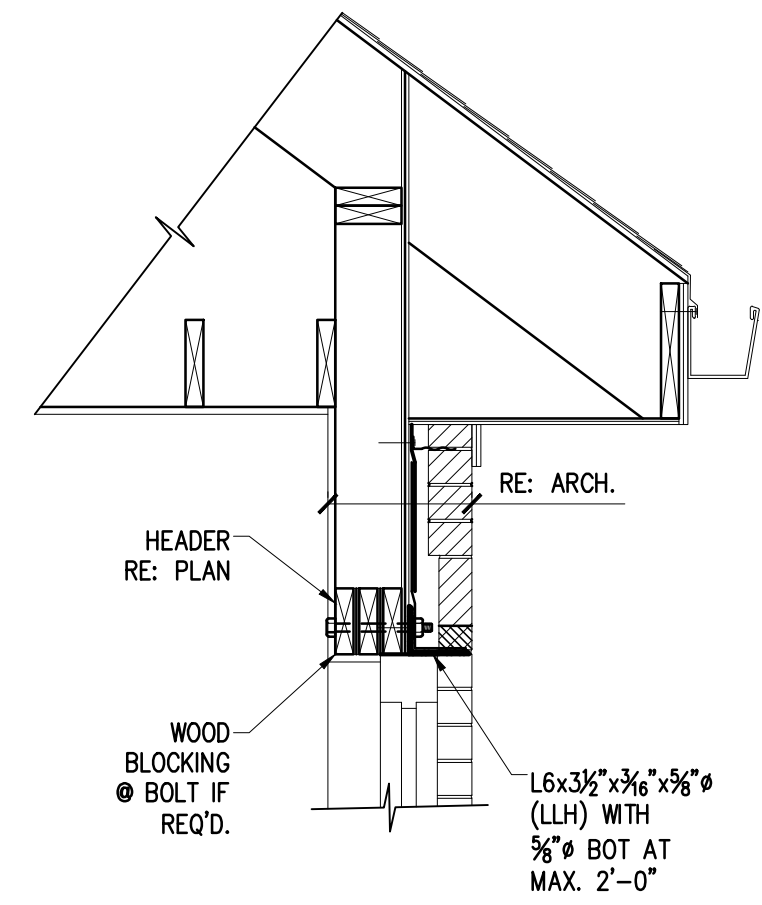


1 DETAIL: AT DOOR LINTEL

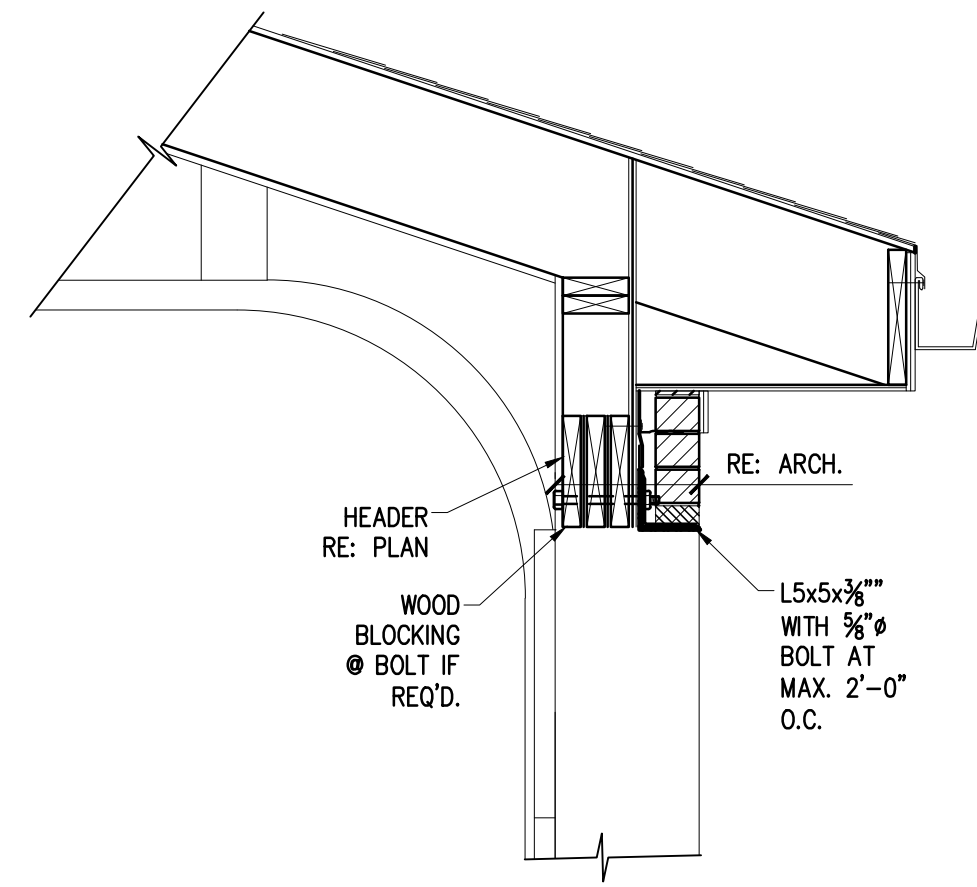


2 DETAIL: AT GARAGE LINTEL

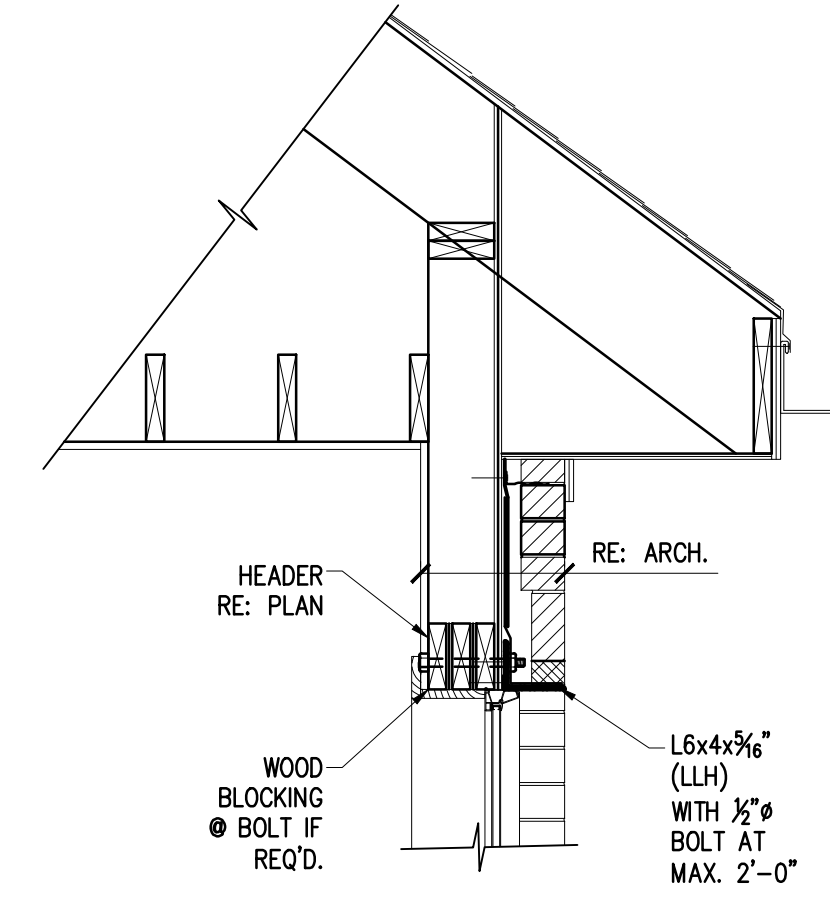



3 DETAIL: AT WINDOW LINTEL

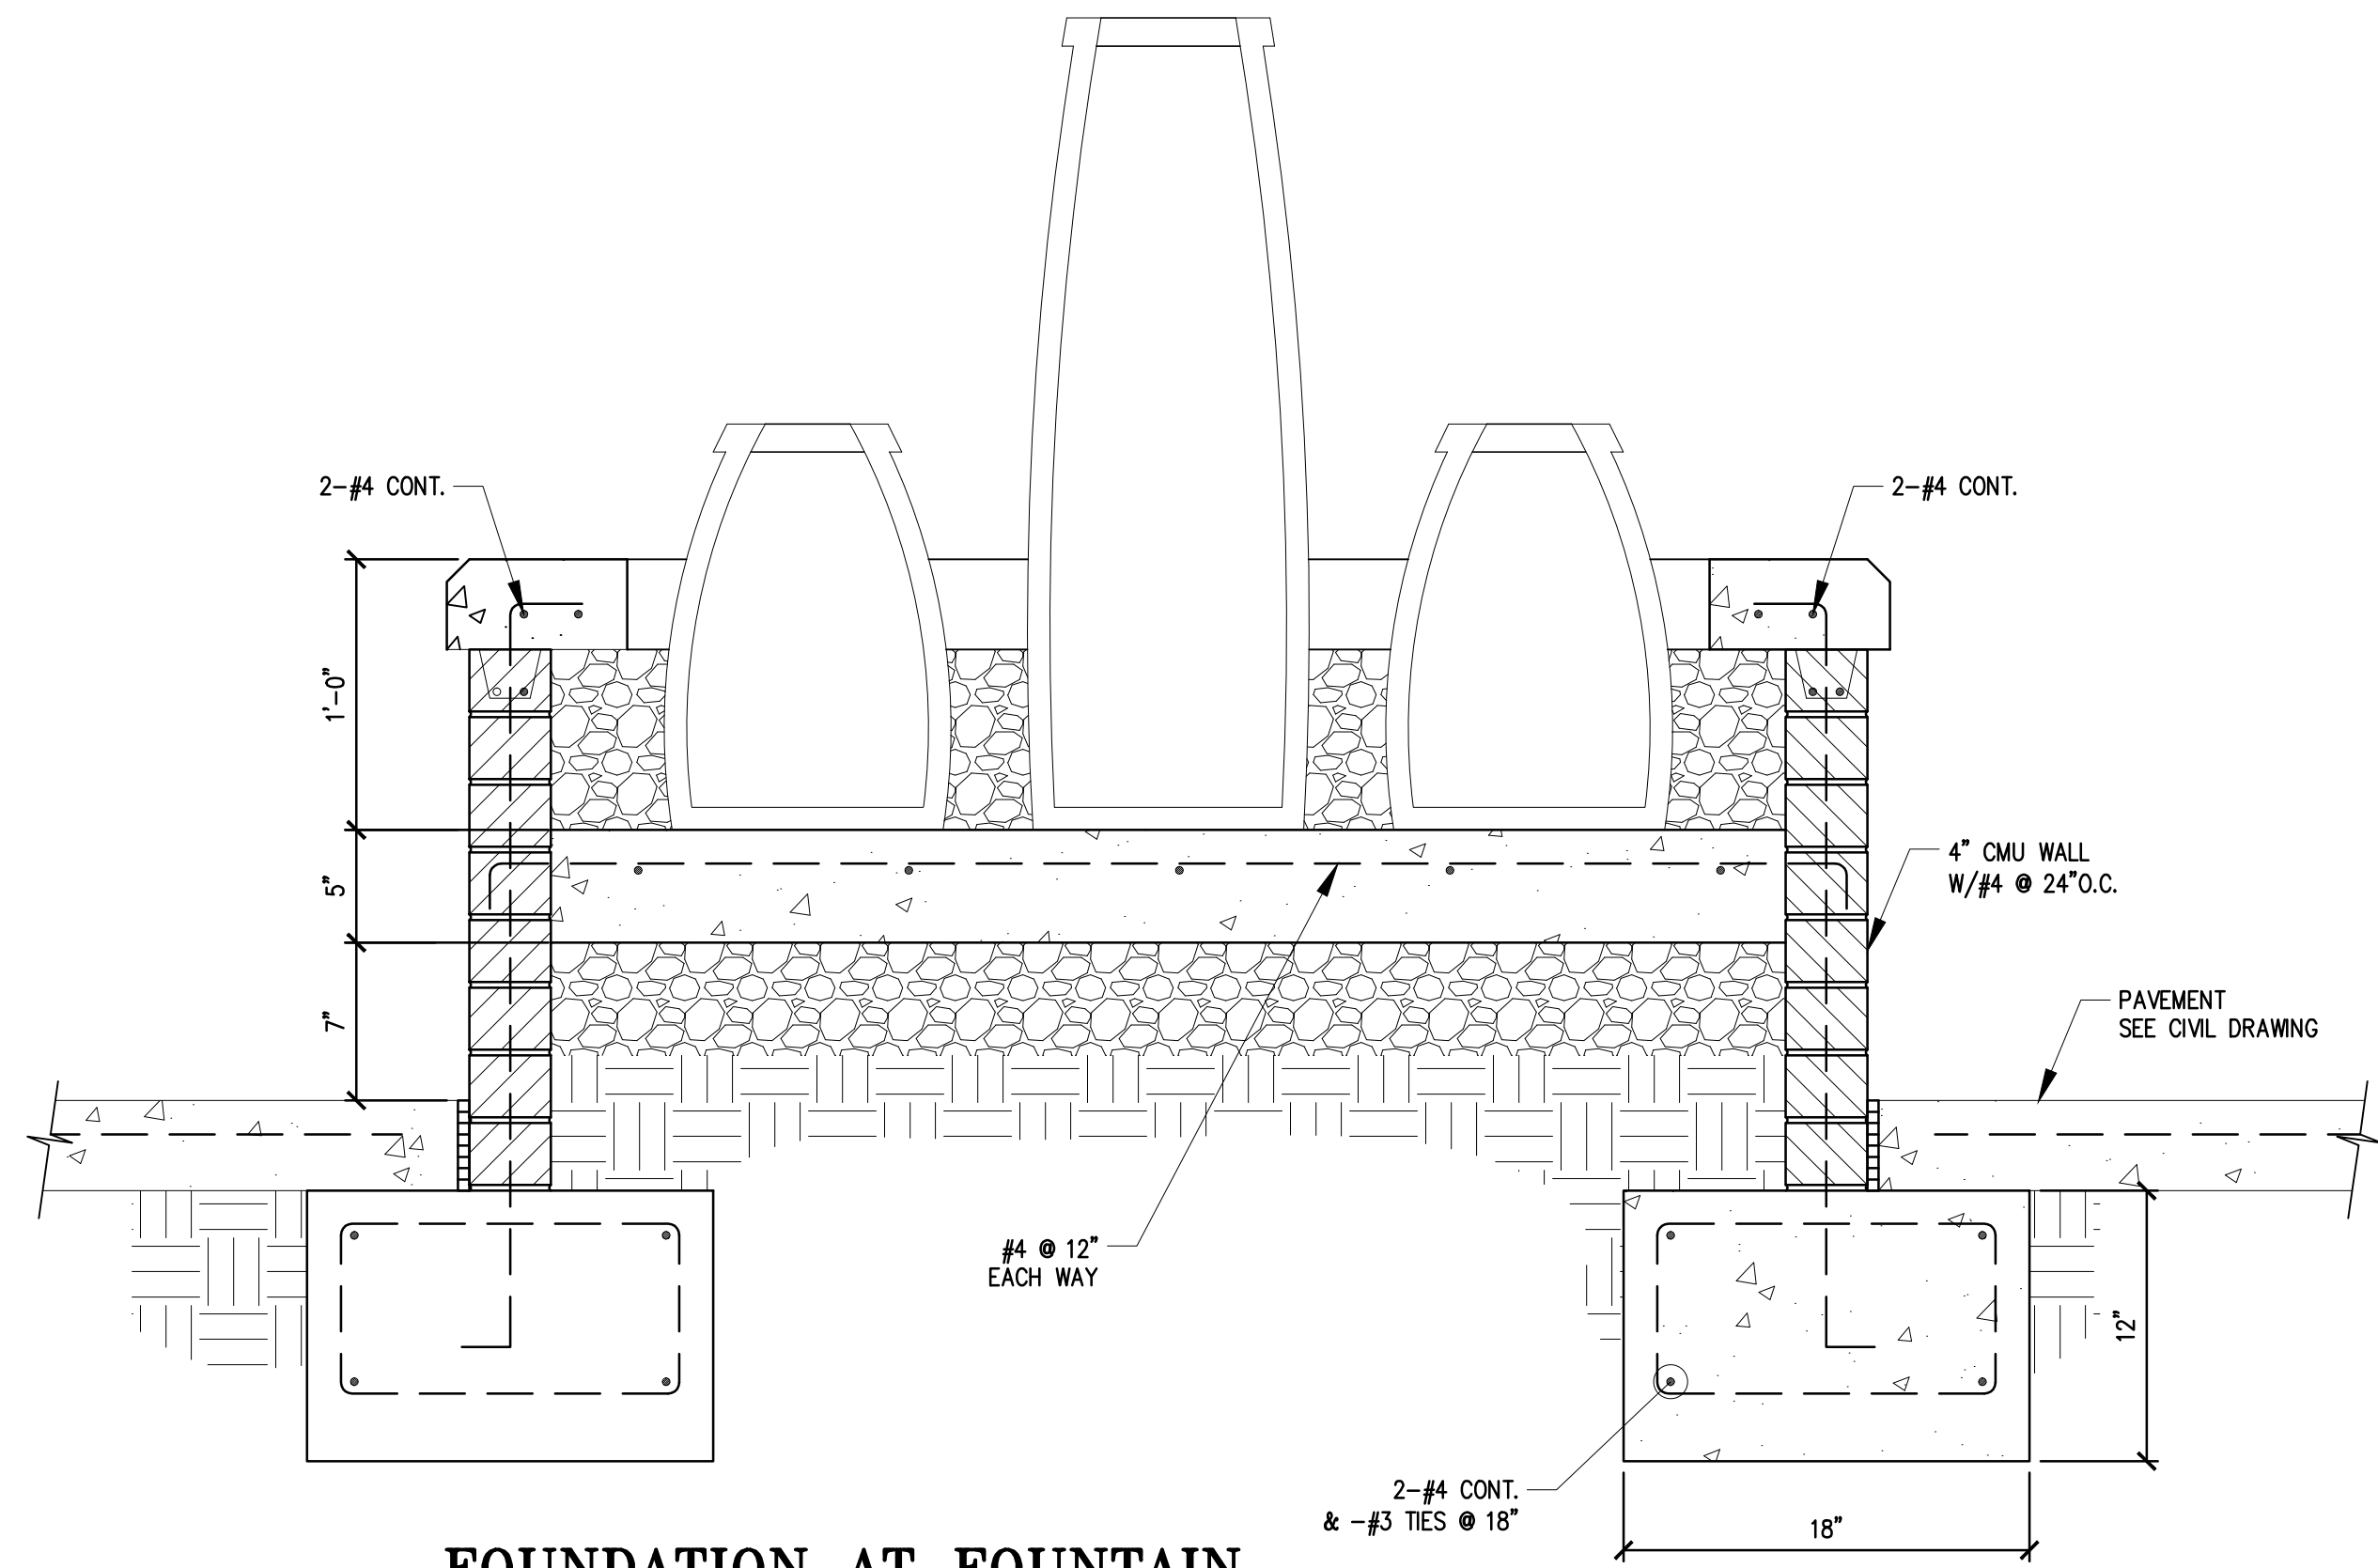

FOUNDATION AT FOUNTAIN
SCALE: 1 1/2" = 1'-0"

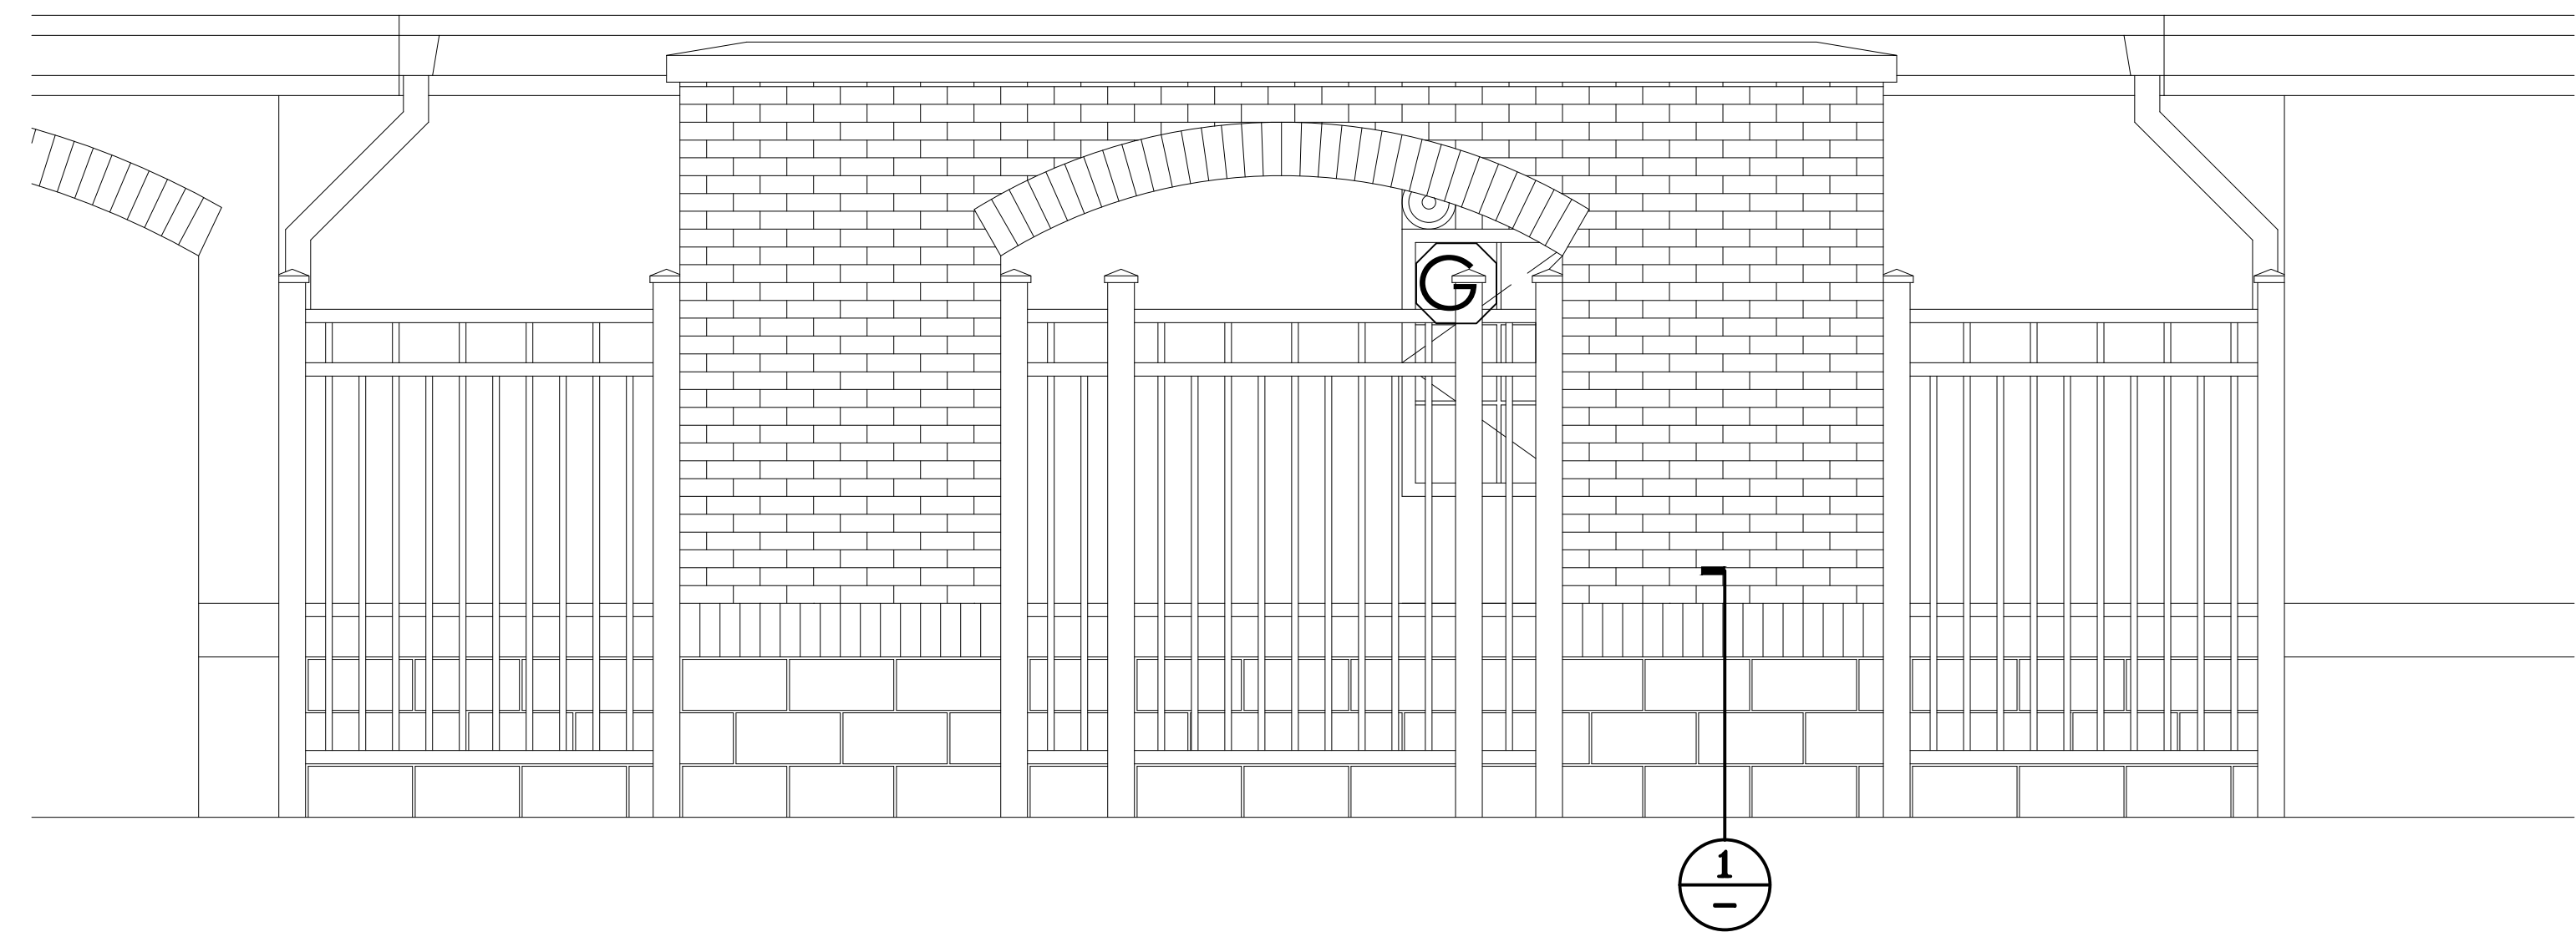

GATE ENTRANCE ELEVATION/FOUNDATION
SCALE: 1 1/2" = 1'-0"

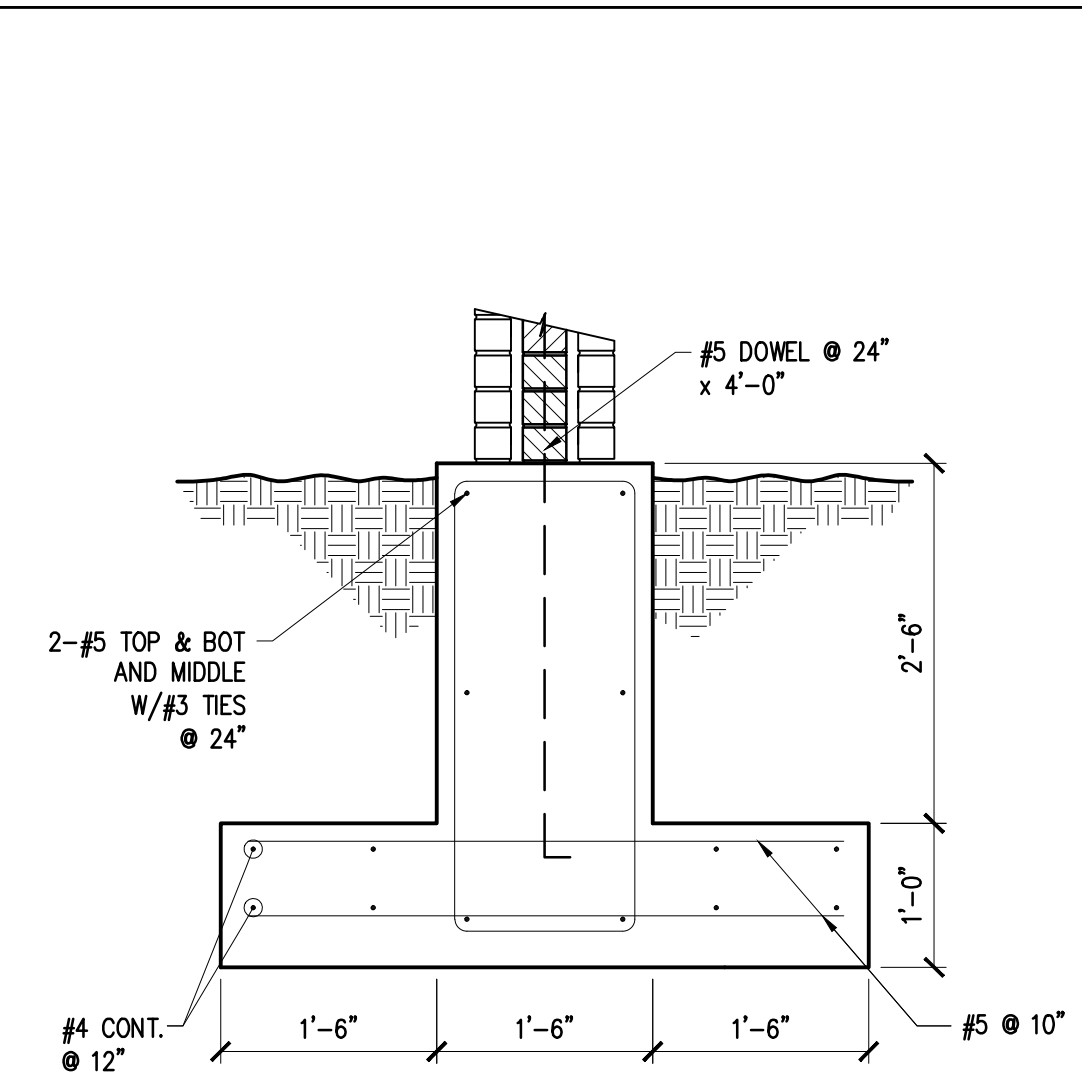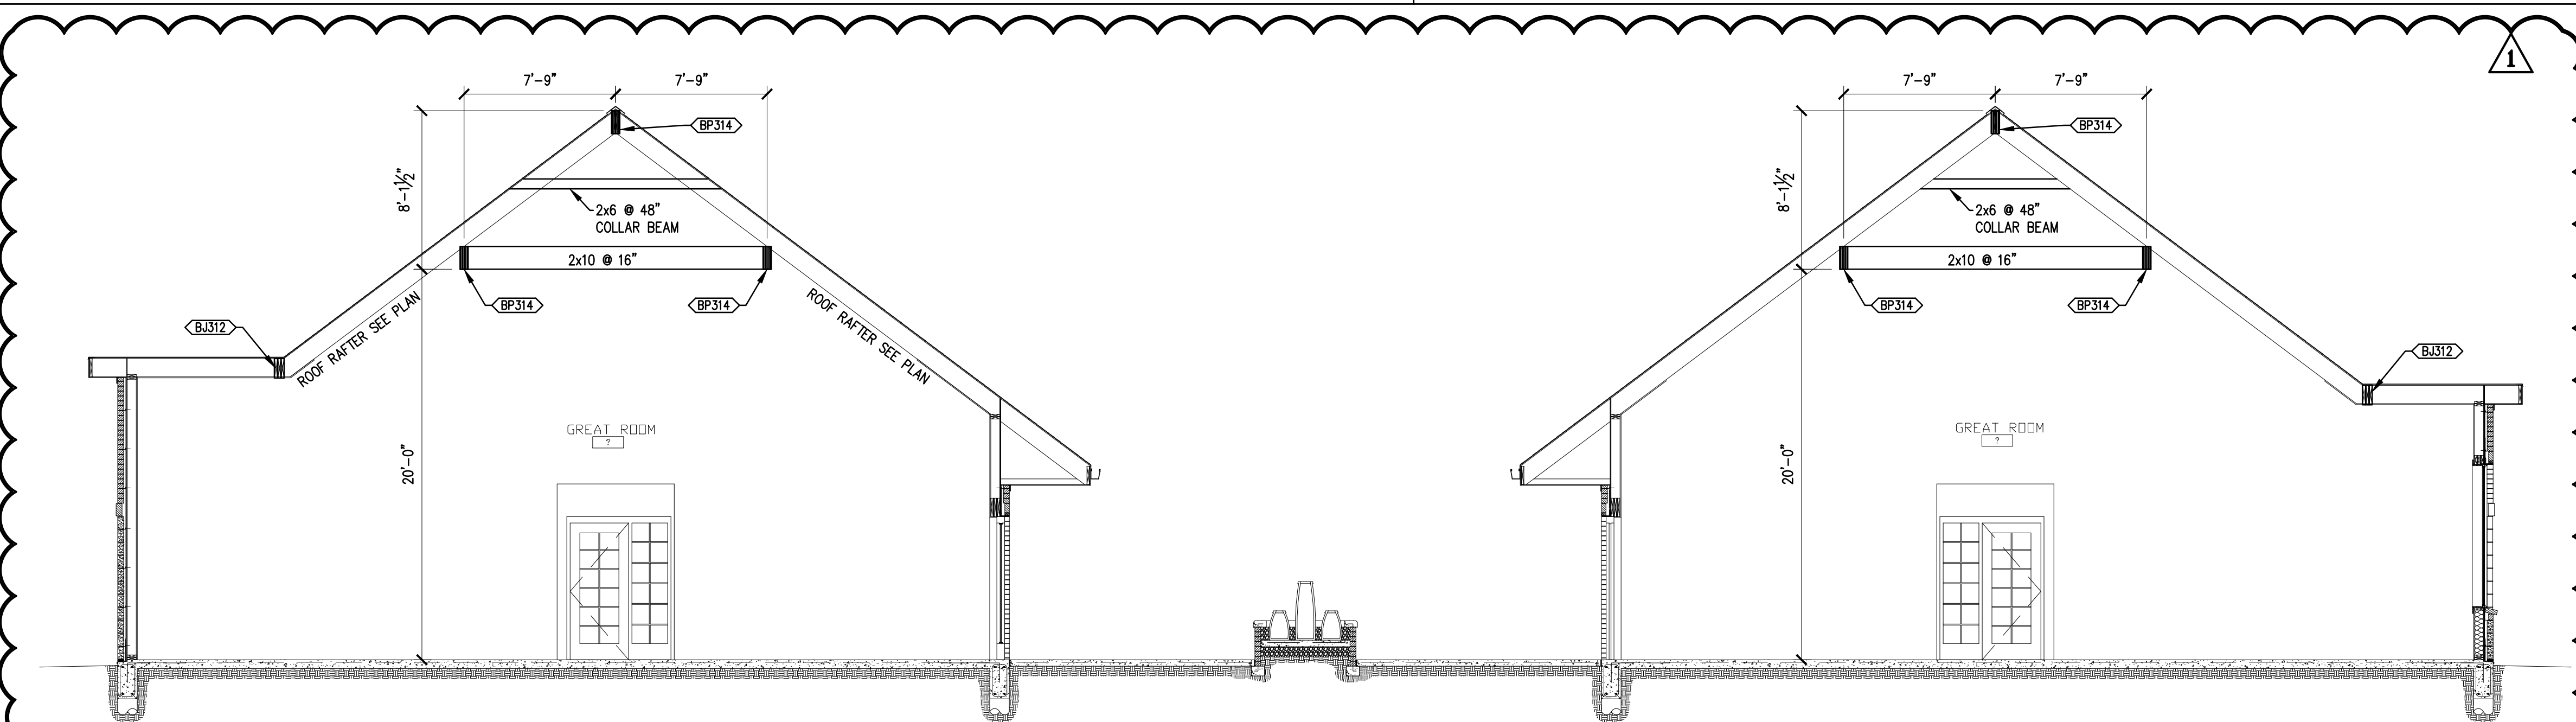

1 SECTION: GATE WALL FOUNDATION DETAIL

LINTEL
&
FOUNDATION
SECTIONS

OPTIMUM PERSONAL CARE
1110 LAKEVIEW DRIVE
SUGAR LAND, TX 77478

ISSUE HISTORY

DATE	ISSUED FOR
	CLIENT REVIEW
	PERMIT
	CONSTRUCTION
09/16/14	REVISION A

09/16/14

Z:\SEAL.jpg

PE BUILDINGS
BRIDGES
INSPECTIONS
MARINE STRUCTURES
CIVIL ENGINEERING &
STRUCTURAL ENGINEERING

PARAMOUNT
ENGINEERING
LLC

7322 SOUTHWEST FREEWAY STE. 1050
HOUSTON, TX 77074

TEL : (713) 636-9977
FAX : (713) 888-9872
CEL : (713) 204-1742

TBPE REGISTRATION # F-3394

DRAWN BY: E.V. CHECKED BY: M.M.

PROJ. NO.: PE12-225

SHEET: S11